

ANNUAL REPORT

Prepared for

STANLEY BLACK & DECKER (U.S.), INC.

Hampstead, Maryland

July 2013

Prepared by

WESTON SOLUTIONS, INC.

West Chester, Pennsylvania 19380-1499

W.O. No. 02501.004.004.0700

TABLE OF CONTENTS

Section	Page
1. INTRODUCTION.....	1-1
2. SITE CHARACTERISTICS.....	2-1
2.1 HYDRAULIC PROPERTIES	2-1
2.2 EFFLUENT CHARACTERISTICS	2-1
2.3 GROUNDWATER QUALITY DATA	2-1
3. OPERATION AND MAINTENANCE OF THE TREATMENT SYSTEM.....	3-1
4. TREATMENT SYSTEM PERFORMANCE EVALUATION.....	4-1
5. RECOMMENDATIONS.....	5-1

LIST OF APPENDICES

APPENDIX A – WITHDRAWAL REPORTS

APPENDIX B – DISCHARGE MONITORING REPORTS

APPENDIX C – GROUNDWATER TREATMENT SYSTEM ANALYTICAL RESULTS

APPENDIX D - GROUNDWATER ANALYTICAL DATA PACKAGE (MAY 2013)

LIST OF FIGURES

Figure	Page
Figure 2-1 Groundwater Elevation Contour Map Under Pumping Conditions (June 2013).....	2-6

LIST OF TABLES

Table	Page
Table 2-1 Treatment System Pumping Records (July 2012 through June 2013)	2-2
Table 2-2 Groundwater Elevation Data (July 2012 through June 2013)	2-3
Table 2-3 Effluent Characteristics Summary (July 2012 through June 2013).....	2-7
Table 2-4 Summary of Groundwater Analytical Results – August 2012	2-10
Table 2-5 Summary of Groundwater Analytical Results – November 2012.....	2-13
Table 2-6 Summary of Groundwater Analytical Results – February 2013	2-16
Table 2-7 Summary of Groundwater Analytical Results – May 2013	2-19
Table 3-1 Treatment System Maintenance Activities (July 2012 through June 2013).....	3-2

1. INTRODUCTION

This Annual Report has been prepared to meet the requirements of Condition IV.L of the Administrative Consent Order between the State of Maryland Department of the Environment (MDE) and Black & Decker (U.S.) Inc. (April 1995) (Consent Order) and the Addendum to Administrative Consent Order dated 29 June 1995. Specifically, Condition IV.L calls for preparation of an Annual Report containing a summary of the information contained in the Discharge Monitoring Reports (Table 2-3), a summary of all analyses of water samples (Tables 2-4 to 2-7), an explanation of all problems encountered and the manner in which they were resolved (Table 3-1), a performance evaluation of the treatment system (Section 4), and recommendations for continuation of, or changes to, the treatment system (Section 5). This document is one of several that are being prepared in response to the Consent Order; each of these documents are to be submitted to the MDE in accordance with the schedule outlined in the Consent Order. This document will become part of the Administrative Record for the site, which is maintained at the Hampstead Public Library.

2. SITE CHARACTERISTICS

2.1 HYDRAULIC PROPERTIES

In accordance with the Consent Order and the Water Appropriation Permit issued to the Black & Decker (U.S.) Inc. Hampstead, Maryland, facility, the following pumping and water level information is included for the period of July 2012 through June 2013.

Pumping records showing the total gallons pumped per month of treatment system operation are presented in Table 2-1. Copies of the Withdrawal Reports, for the periods of April through June 2013, are included in Appendix A.

Water levels (Water Level Monitoring Report) for wells included in the water level monitoring plan are presented in Table 2-2. Based on the June 2013 water levels, a representative groundwater elevation contour map under pumping conditions is presented in Figure 2-1. At the time the data were collected, the extraction wells were pumping at a combined rate of approximately 176 gpm.

2.2 EFFLUENT CHARACTERISTICS

Effluent characteristics of the NPDES discharge points are recorded monthly on Discharge Monitoring Reports (DMRs) and are submitted to MDE, Water Management Administration on a quarterly basis. A summary of the sample results from the DMRs is presented in Table 2-3. DMRs for the period of April 2013 through June 2013 are included in Appendix B.

2.3 GROUNDWATER QUALITY DATA

For the reporting period of July 2012 through June 2013, approximately 48 pounds (lbs) of total volatile organic compounds (VOCs) were removed from the groundwater by the extraction and treatment system. In general, the total VOCs were comprised of trichloroethene (TCE) (81.5%) and tetrachloroethene (PCE) (18.5%). Analytical results for the air stripper discharge for the period of April 2013 through June 2013 are included in Appendix C.

Table 2-1
Treatment System Pumping Records
(July 2012 through June 2013)

Black & Decker
Hampstead, Maryland

Date	Water Pumped (gallons)
July 2012	7,558,744
August 2012	7,570,966
September 2012	7,177,687
October 2012	7,327,763
November 2012	7,047,445
December 2012	7,216,348
January 2013	6,456,215
February 2013	6,709,473
March 2013	7,486,802
April 2013	7,395,167
May 2013	7,686,905
June 2013	7,326,169

Table 2-2
Groundwater Elevation Data (July 2011 through June 2012)
Black & Decker
Hampstead, Maryland

WELL NO.	TOC ELEV	TOTAL DEPTH	7/13/2012		8/23/2012		9/5/2012		10/10/2012	
			DTW	ELEV	DTW	ELEV	DTW	ELEV	DTW	ELEV
EW-1	847.21	55	DRY	NC	DRY	NC	DRY	NC	DRY	NC
EW-2	849.21	110	93.51	755.70	93.27	755.94	63.12	786.09	93.14	756.07
EW-3	846.64	118	86.84	759.80	83.64	763.00	84.12	762.52	83.60	763.04
EW-4	858.01	97.5	PC	NC	PC	NC	PC	NC	PC	NC
EW-5	864.17	98	89.47	774.70	90.12	774.05	90.26	773.91	90.19	773.98
EW-6	831.98	115	102.50	729.48	103.00	728.98	103.00	728.98	103.00	728.98
EW-7	818.38	78	71.40	746.98	73.00	745.38	73.00	745.38	73.00	745.38
EW-8	811.13	98	93.50	717.63	96.00	715.13	96.00	715.13	96.00	715.13
EW-9	811.35	141	103.00	708.35	103.00	708.35	103.00	708.35	103.50	707.85
EW-10	807.74	NA	57.41	750.33	49.02	758.72	49.13	758.61	56.11	751.63
RFW-1A	864.37	78	50.46	813.91	50.31	814.06	50.40	813.97	50.51	813.86
RFW-1B	864.23	200	50.51	813.72	50.36	813.87	50.43	813.80	50.55	813.68
RFW-2A	857.41	35	13.40	844.01	14.93	842.48	15.01	842.40	15.12	842.29
RFW-2B	857.73	75	14.06	843.67	15.61	842.12	15.82	841.91	15.49	842.24
RFW-3B	839.21	153	30.79	808.42	31.08	808.13	30.96	808.25	31.13	808.08
RFW-4A	830.37	62	38.41	791.96	36.80	793.57	36.67	793.70	37.44	792.93
RFW-4B	830.37	120	38.99	791.38	36.71	793.66	36.54	793.83	37.30	793.07
RFW-5A	817.50	30	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-6	785.04	120	4.41	780.63	2.31	782.73	2.74	782.30	2.87	782.17
RFW-7	805.14	29	6.99	798.15	6.41	798.73	6.82	798.32	6.90	798.24
RFW-8	860.07	53	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-9	862.02	49	25.49	836.53	26.07	835.95	26.21	835.81	26.17	835.85
RFW-10	852.06	58	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-11A	849.32	72	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
RFW-11B	849.62	116	65.11	784.51	63.10	786.52	62.91	786.71	63.28	786.34
RFW-12B	844.87	264	51.24	793.63	49.88	794.99	49.94	794.93	50.04	794.83
RFW-13	849.11	150	62.91	786.20	61.38	787.73	61.29	787.82	61.44	787.67
RFW-14B	812.39	281	53.60	758.79	51.26	761.13	51.89	760.50	52.03	760.36
RFW-16	856.14	41	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-17	834.66	60.5	26.12	808.54	25.96	808.70	25.94	808.72	25.83	808.83
RFW-20	842.29	142	32.89	809.40	34.88	807.41	33.91	808.38	34.46	807.83
RFW-21	832.65	102	20.80	811.85	21.03	811.62	20.96	811.69	20.94	811.71
PH-7	805.94	89	27.41	778.53	29.10	776.84	28.87	777.07	32.40	773.54
PH-9	814.94	98	53.10	761.84	51.87	763.07	52.26	762.68	52.26	762.68
PH-11	820.68	78	53.33	767.35	49.42	771.26	48.98	771.70	49.53	771.15
PH-12	828.35	87	51.73	776.62	52.67	775.68	51.63	776.72	52.75	775.60
B-3	803.02	83	10.62	792.40	10.74	792.28	10.69	792.33	10.40	792.62
Amoco	842.29	NA	NA	NC	NA	NC	NA	NC	NA	NC
Hamp. Town #22	804.96	NA	0.41	804.55	1.12	803.84	0.76	804.20	1.58	803.38
Pembroke #1	NA	NA	11.41	NC	10.97	NC	11.43	NC	11.43	NC
Pembroke #2	NA	NA	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
N. Houcks. Rd.	NA	NA	10.53	NC	10.96	NC	10.69	NC	9.89	NC
E. Century St.	NA	NA	19.23	NC	19.18	NC	19.27	NC	19.22	NC
Lwr. Beckleys. Rd.	NA	NA	55.47	NC	54.93	NC	54.86	NC	56.44	NC

Table 2-2
Groundwater Elevation Data (July 2011 through June 2012)
Black & Decker
Hampstead, Maryland

WELL NO.	TOC ELEV	TOTAL DEPTH	11/1/2012		12/28/2012		1/18/2013		2/21/2013	
			DTW	ELEV	DTW	ELEV	DTW	ELEV	DTW	ELEV
EW-1	847.21	55	DRY	NC	DRY	NC	DRY	NC	DRY	NC
EW-2	849.21	110	93.01	756.20	92.88	756.33	92.40	756.81	92.63	756.58
EW-3	846.64	118	85.95	760.69	85.06	761.58	84.50	762.14	84.91	761.73
EW-4	858.01	97.5	PC	NC	PC	NC	PC	NC	PC	NC
EW-5	864.17	98	90.22	773.95	89.77	774.40	88.71	775.46	89.91	774.26
EW-6	831.98	115	103.00	728.98	103.00	728.98	103.00	728.98	102.87	729.11
EW-7	818.38	78	73.00	745.38	73.00	745.38	73.00	745.38	73.00	745.38
EW-8	811.13	98	96.00	715.13	96.00	715.13	96.00	715.13	95.87	715.26
EW-9	811.35	141	103.00	708.35	103.00	708.35	103.00	708.35	103.00	708.35
EW-10	807.74	NA	55.88	751.86	55.14	752.60	49.63	758.11	47.50	760.24
RFW-1A	864.37	78	51.51	812.86	51.43	812.94	49.61	814.76	49.32	815.05
RFW-1B	864.23	200	51.62	812.61	51.44	812.79	49.69	814.54	49.40	814.83
RFW-2A	857.41	35	13.33	844.08	14.71	842.70	12.68	844.73	12.72	844.69
RFW-2B	857.73	75	13.45	844.28	15.02	842.71	13.20	844.53	13.30	844.43
RFW-3B	839.21	153	30.17	809.04	32.41	806.80	32.13	807.08	31.57	807.64
RFW-4A	830.37	62	37.01	793.36	37.12	793.25	36.13	794.24	35.88	794.49
RFW-4B	830.37	120	36.81	793.56	36.84	793.53	36.04	794.33	35.76	794.61
RFW-5A	817.50	30	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-6	785.04	120	2.94	782.10	3.67	781.37	4.73	780.31	3.39	781.65
RFW-7	805.14	29	4.63	800.51	7.55	797.59	6.18	798.96	5.29	799.85
RFW-8	860.07	53	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-9	862.02	49	25.85	836.17	27.11	834.91	24.71	837.31	24.67	837.35
RFW-10	852.06	58	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-11A	849.32	72	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
RFW-11B	849.62	116	63.41	786.21	63.06	786.56	64.10	785.52	63.36	786.26
RFW-12B	844.87	264	50.46	794.41	50.14	794.73	50.38	794.49	50.46	794.41
RFW-13	849.11	150	62.98	786.13	60.86	788.25	62.73	786.38	63.80	785.31
RFW-14B	812.39	281	52.09	760.30	51.89	760.50	53.12	759.27	54.09	758.30
RFW-16	856.14	41	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-17	834.66	60.5	27.13	807.53	26.20	808.46	27.43	807.23	27.61	807.05
RFW-20	842.29	142	35.57	806.72	34.13	808.16	33.20	809.09	33.22	809.07
RFW-21	832.65	102	21.61	811.04	21.41	811.24	20.19	812.46	20.28	812.37
PH-7	805.94	89	29.53	776.41	29.41	776.53	24.01	781.93	23.66	782.28
PH-9	814.94	98	51.94	763.00	51.87	763.07	50.07	764.87	49.87	765.07
PH-11	820.68	78	48.26	772.42	48.73	771.95	48.88	771.80	48.63	772.05
PH-12	828.35	87	50.98	777.37	51.60	776.75	51.06	777.29	51.11	777.24
B-3	803.02	83	10.47	792.55	10.83	792.19	9.83	793.19	10.16	792.86
Amoco	842.29	NA	NA	NC	NA	NC	NA	NC	NA	NC
Hamp. Town #22	804.96	NA	2.19	802.77	0.79	804.17	1.68	803.28	2.15	802.81
Pembroke #1	NA	NA	11.33	NC	11.12	NC	10.59	NC	10.86	NC
Pembroke #2	NA	NA	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
N. Houcks. Rd.	NA	NA	9.53	NC	9.74	NC	9.98	NC	11.01	NC
E. Century St.	NA	NA	19.19	NC	19.21	NC	19.23	NC	19.21	NC
Lwr. Beckleys. Rd.	NA	NA	55.49	NC	55.77	NC	53.68	NC	54.83	NC

Table 2-2
Groundwater Elevation Data (July 2011 through June 2012)
Black & Decker
Hampstead, Maryland

WELL NO.	TOC ELEV	TOTAL DEPTH	3/10/2013		4/10/2013		5/20/2013		6/27/2013	
			DTW	ELEV	DTW	ELEV	DTW	ELEV	DTW	ELEV
EW-1	847.21	55	DRY	NC	DRY	NC	DRY	NC	DRY	NC
EW-2	849.21	110	92.27	756.94	92.46	756.75	93.41	755.80	92.40	756.81
EW-3	846.64	118	84.46	762.18	83.96	762.68	84.09	762.55	85.25	761.39
EW-4	858.01	97.5	PC	NC	PC	NC	PC	NC	PC	NC
EW-5	864.17	98	88.84	775.33	90.11	774.06	89.84	774.33	89.86	774.31
EW-6	831.98	115	102.46	729.52	103.00	728.98	103.00	728.98	103.00	728.98
EW-7	818.38	78	73.00	745.38	73.00	745.38	74.50	743.88	75.00	743.38
EW-8	811.13	98	95.18	715.95	96.00	715.13	95.00	716.13	96.00	715.13
EW-9	811.35	141	103.50	707.85	103.00	708.35	103.00	708.35	103.00	708.35
EW-10	807.74	NA	50.77	756.97	49.98	757.76	48.02	759.72	49.11	758.63
RFW-1A	864.37	78	49.43	814.94	50.11	814.26	49.36	815.01	49.33	815.04
RFW-1B	864.23	200	49.46	814.77	50.15	814.08	49.42	814.81	49.35	814.88
RFW-2A	857.41	35	12.74	844.67	13.06	844.35	13.81	843.60	13.69	843.72
RFW-2B	857.73	75	13.10	844.63	13.41	844.32	14.46	843.27	14.38	843.35
RFW-3B	839.21	153	32.64	806.57	32.68	806.53	30.18	809.03	29.98	809.23
RFW-4A	830.37	62	36.22	794.15	37.10	793.27	35.77	794.60	35.97	794.40
RFW-4B	830.37	120	36.18	794.19	36.94	793.43	35.70	794.67	35.89	794.48
RFW-5A	817.50	30	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-6	785.04	120	4.83	780.21	4.86	780.18	2.82	782.22	2.43	782.61
RFW-7	805.14	29	7.11	798.03	7.84	797.30	5.43	799.71	5.87	799.27
RFW-8	860.07	53	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-9	862.02	49	25.26	836.76	25.83	836.19	25.09	836.93	25.13	836.89
RFW-10	852.06	58	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-11A	849.32	72	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
RFW-11B	849.62	116	64.26	785.36	64.33	785.29	62.32	787.30	62.41	787.21
RFW-12B	844.87	264	51.04	793.83	51.61	793.26	49.33	795.54	49.26	795.61
RFW-13	849.11	150	62.88	786.23	63.12	785.99	60.09	789.02	60.41	788.70
RFW-14B	812.39	281	54.26	758.13	54.36	758.03	53.15	759.24	53.29	759.10
RFW-16	856.14	41	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-17	834.66	60.5	26.99	807.67	27.27	807.39	25.47	809.19	25.43	809.23
RFW-20	842.29	142	33.41	808.88	33.84	808.45	32.70	809.59	32.60	809.69
RFW-21	832.65	102	20.26	812.39	21.32	811.33	19.42	813.23	19.72	812.93
PH-7	805.94	89	24.32	781.62	24.61	781.33	24.88	781.06	24.84	781.10
PH-9	814.94	98	50.19	764.75	50.34	764.60	50.45	764.49	50.17	764.77
PH-11	820.68	78	49.13	771.55	49.70	770.98	50.71	769.97	50.53	770.15
PH-12	828.35	87	52.08	776.27	52.11	776.24	52.48	775.87	52.16	776.19
B-3	803.02	83	10.22	792.80	9.94	793.08	9.86	793.16	9.72	793.30
Amoco	842.29	NA	NA	NC	NA	NC	NA	NC	NA	NC
Hamp. Town #22	804.96	NA	2.68	802.28	1.32	803.64	2.55	NC	2.40	802.56
Pembroke #1	NA	NA	11.27	NC	11.26	NC	11.19	NC	10.98	NC
Pembroke #2	NA	NA	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
N. Houcks. Rd.	NA	NA	10.71	NC	10.87	NC	10.86	NC	10.27	NC
E. Century St.	NA	NA	19.27	NC	19.22	NC	19.21	NC	19.23	NC
Lwr. Beckleys. Rd.	NA	NA	54.91	NC	54.91	NC	55.02	NC	54.71	NC

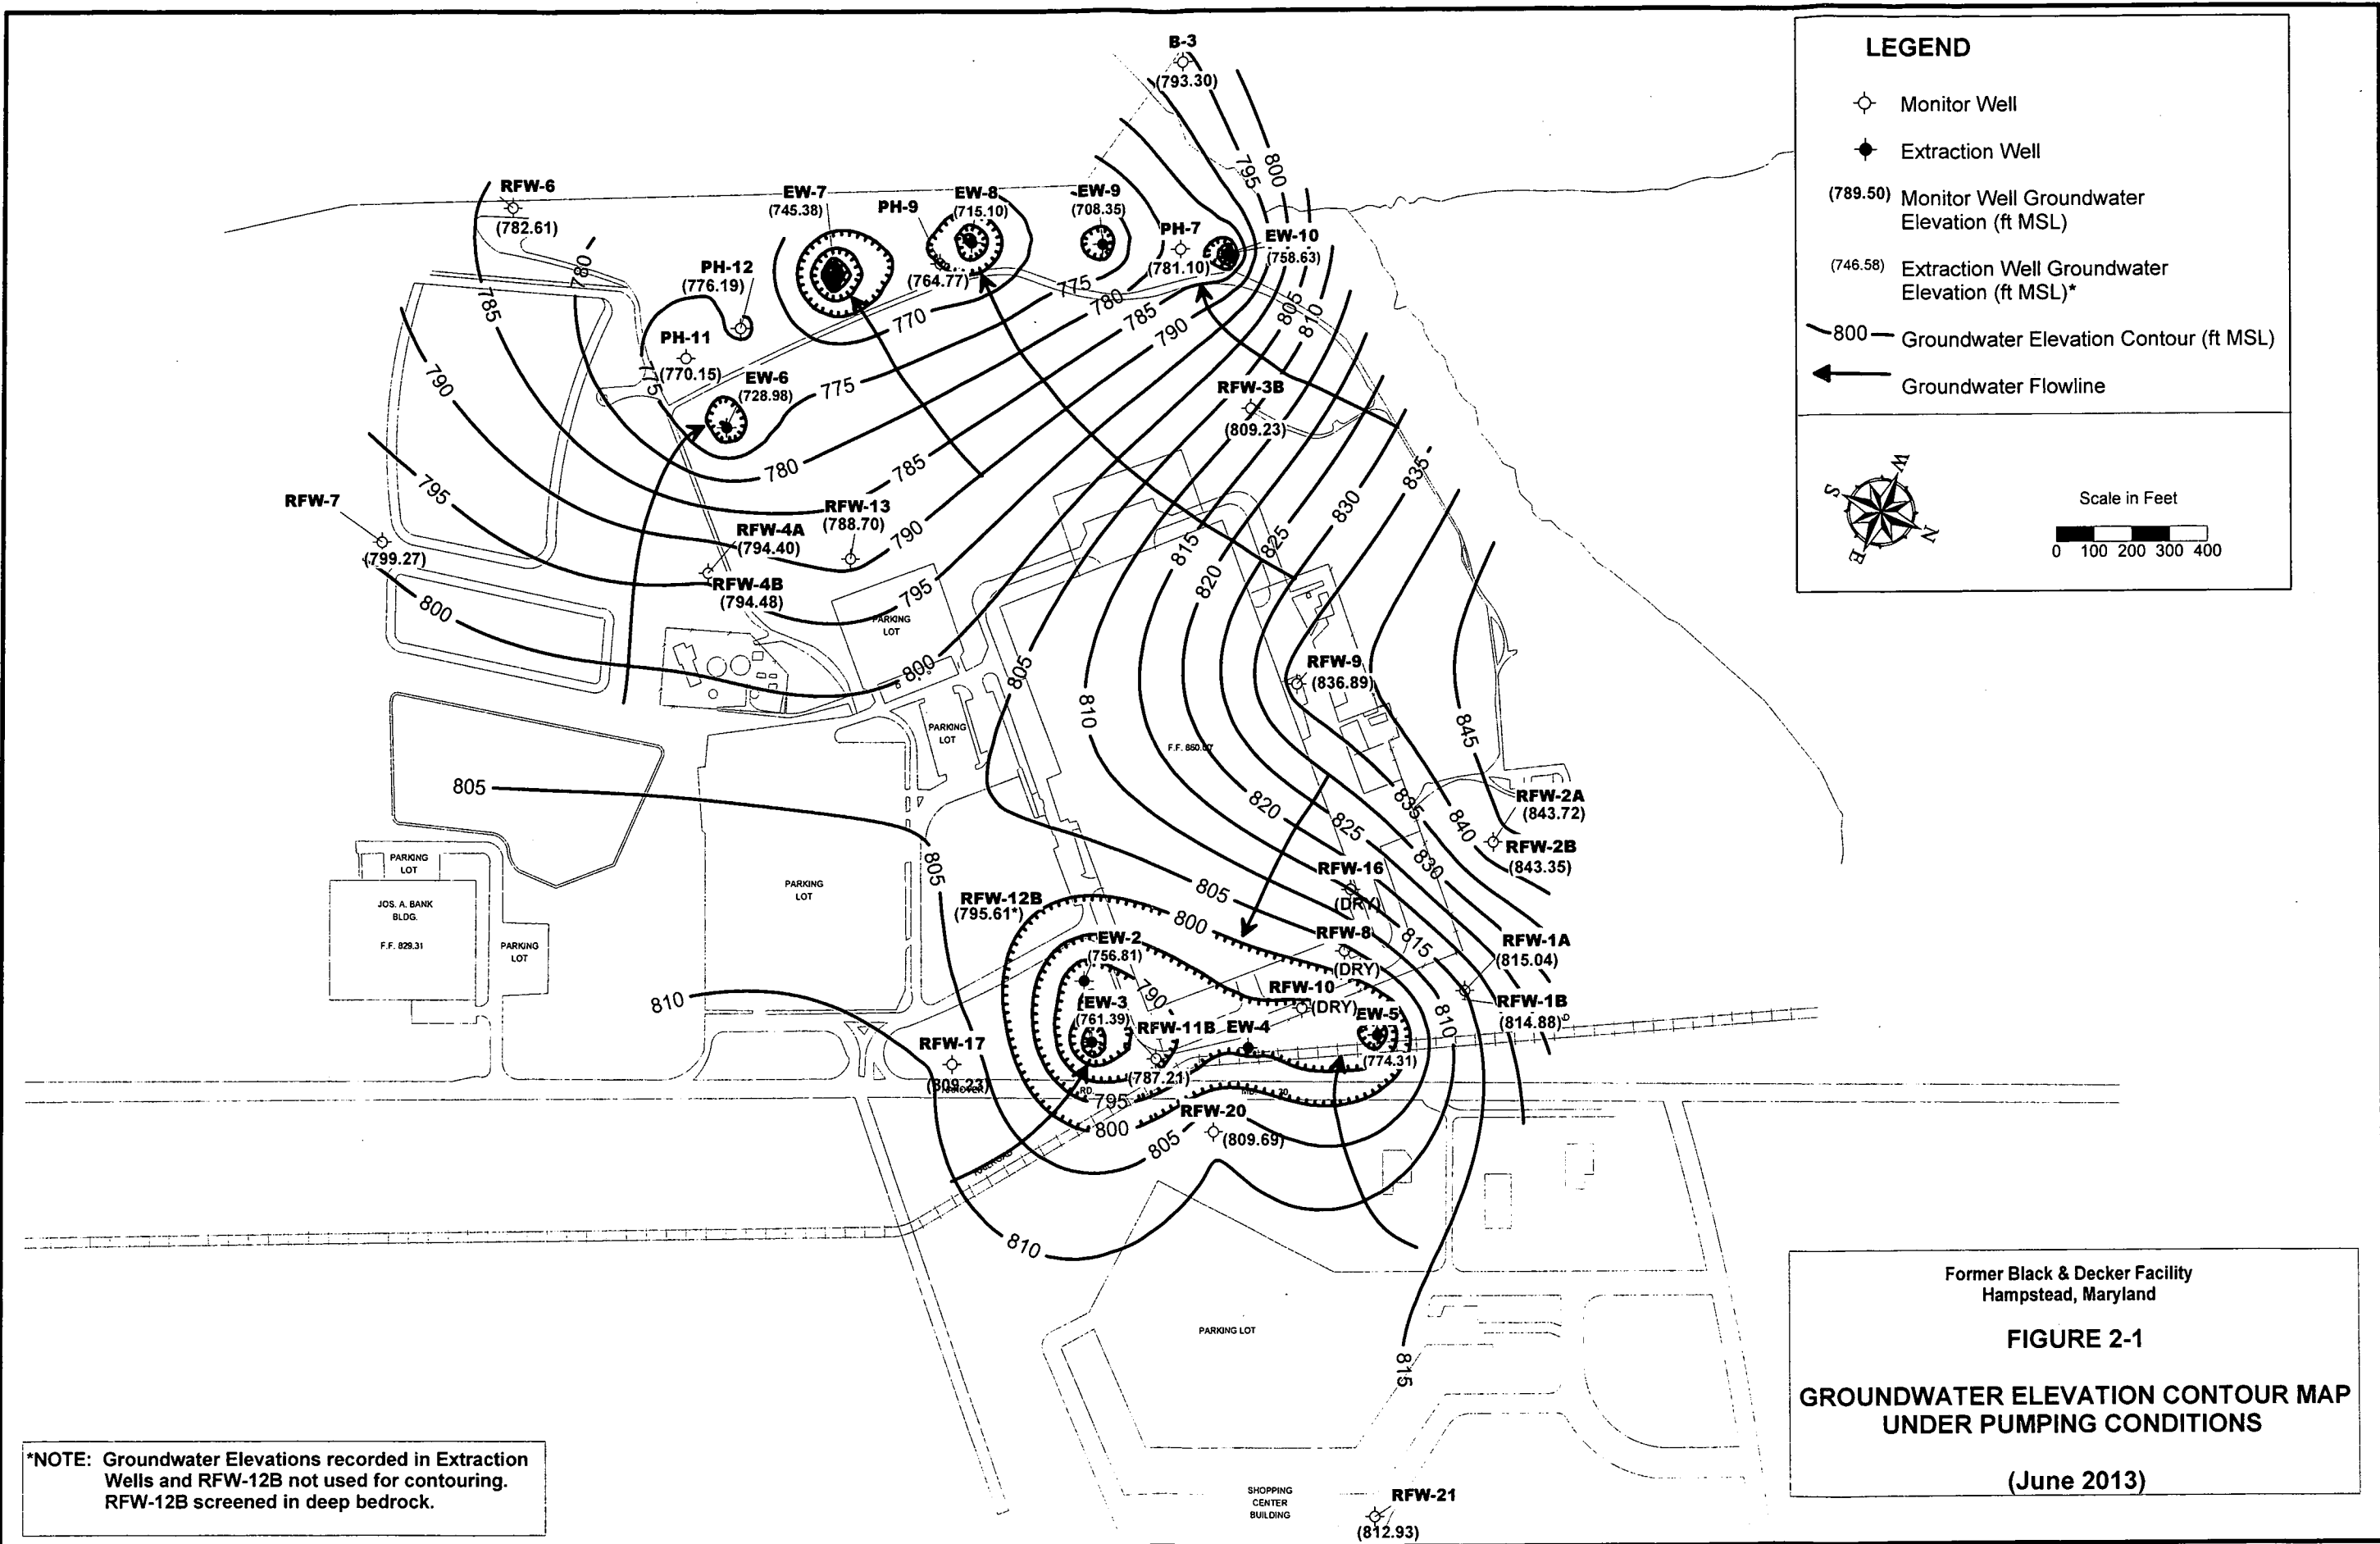


Table 2-3
Effluent Characteristics Summary (July 2012 through June 2013)
Black & Decker
Hampstead, Maryland

Discharge Number	Parameter	Units	Permit Limits	DMR DATE							
				July 2012	August 2012	September 2012	October 2012	November 2012	December 2012		
001	FLOW	average	MGD	NA	0.196	0.184	0.154	0.265	0.243	0.222	
		maximum	MGD	NA	0.804	0.739	0.356	1.155	0.980	1.128	
	1,1,1-Trichloroethane	ug/l	5	<1	<1	<1	<1	<1	<1	<1	
	Tetrachloroethylene	ug/l	5	<1	<1	<1	<1	<1	<1	<1	
	Trichloroethylene	ug/l	5	<1	<1	<1	<1	<1	<1	<1	
	Total Residual Chlorine	mg/l	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	
	Oil & Grease	maximum	mg/l	15	<5	<5	<5	<5	<5	<5	<5
		monthly average	mg/l	10	<5	<5	<5	<5	<5	<5	<5
	pH	minimum	STD	6.0	7.0	7.0	7.0	6.7	7.0	6.7	6.7
		maximum	STD	8.5	7.4	7.8	8.1	7.5	7.8	7.9	7.9
BOD		mg/l	15	7.0	5.0	2.0	5.0	0.0	5.0	5.0	
TSS	maximum	mg/l	30	10.0	19.0	0.0	5.0	4.0	<1	<1	
	monthly average	mg/l	20	10.0	19.0	0.0	5.0	4.0	<1	<1	
101 (Monitoring Point)	FLOW	average	MGD	NA	0.137	0.190	0.205	0.220	0.219	0.199	
		maximum	MGD	NA	0.292	0.236	0.245	0.265	0.271	0.277	
	Fecal Coliform	MPN/100ml	200	7.8	49.0	1.0	5.0	5.0	1.0	1.0	
201 (Monitoring Point)	FLOW	average	MGD	NA	NR	NR	0.242	NR	NR	0.235	
		maximum	MGD	NA	NR	NR	0.268	NR	NR	0.284	
	1,1,1-Trichloroethane	ug/l	NA	NR	NR	<1	NR	NR	<1		
	Tetrachloroethylene	ug/l	NA	NR	NR	<1	NR	NR	<1		
Trichloroethylene	ug/l	NA	NR	NR	<1	NR	NR	<1	<1		

DMR - Discharge Monitoring Report

NA - Not Applicable

NR - Not Reported

**Table 2-3
Effluent Characteristics Summary (July 2012 through June 2013)
Black & Decker
Hampstead, Maryland**

Discharge Number	Parameter	Units	Permit Limits	DMR DATE						
				January 2013	February 2013	March 2013	April 2013	May 2013	June 2013	
001	FLOW	average	MGD	NA	0.188	0.277	0.257	0.205	0.266	0.332
		maximum	MGD	NA	1.106	0.632	0.800	0.777	0.910	0.972
	1,1,1-Trichloroethane	ug/l	5	<1	<1	<1	<1	<1	<1	<1
	Tetrachloroethylene	ug/l	5	<1	<1	<1	<1	<1	<1	<1
	Trichloroethylene	ug/l	5	<1	<1	<1	<1	<1	<1	<1
	Total Residual Chlorine	mg/l	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
	Oil & Grease	maximum	mg/l	15	<5	<5	<5	<5	<5	<5
		monthly average	mg/l	10	<5	<5	<5	<5	<5	<5
	pH	minimum	STD	6.0	6.70	7.20	6.90	6.9	7.2	7.4
		maximum	STD	8.5	8.10	8.20	7.90	8.0	8.1	8.2
	BOD	mg/l	15	<2	7.0	5.0	4.0	3.0	9.0	
TSS	maximum	mg/l	30	<4	13.0	4.0	5.0	8.0	14.0	
	monthly average	mg/l	20	<4	13.0	4.0	5.0	8.0	14.0	
101 (Monitoring Point)	FLOW	average	MGD	NA	0.168	0.202	0.195	0.208	0.161	0.155
		maximum	MGD	NA	0.271	0.240	0.285	0.250	0.231	0.176
	Fecal Coliform	MPN/100ml	200	1.0	5.0	1.0	5.0	8.0	70.0	
201 (Monitoring Point)	FLOW	average	MGD	NA	NR	NR	0.229	NR	NR	0.246
		maximum	MGD	NA	NR	NR	0.337	NR	NR	0.286
	1,1,1-Trichloroethane	ug/l	NA	NR	NR	<1	NR	NR	<1	
	Tetrachloroethylene	ug/l	NA	NR	NR	<1	NR	NR	<1	
	Trichloroethylene	ug/l	NA	NR	NR	<1	NR	NR	<1	

DMR - Discharge Monitoring Report

NA - Not Applicable

NR - Not Reported

A summary of the analytical results of the groundwater samples collected from the monitor and extraction wells during the third and fourth quarters of 2012 and the first and second quarters of 2013 are included in Tables 2-4, 2-5, 2-6, and 2-7, respectively. As found in earlier sampling events at the Black & Decker facility, TCE and PCE were the primary VOCs detected at the highest concentrations in the groundwater samples. The highest concentrations of TCE were detected in the groundwater samples collected from wells EW-2 and EW-4 and the highest concentrations of PCE were detected in the groundwater samples collected from well EW-9. The remainder of the detected VOCs, were detected at levels well below the Federal Maximum Concentration Levels (MCLs). The second quarter 2013 (May 2013) analytical data package is included in Appendix D. Analytical data packages for the remaining quarters are included in the respective Quarterly Groundwater Monitoring Reports.

Table 2-4
 Summary of Groundwater Analytical Results - August 2012
 Black & Decker
 Hampstead, Maryland

PARAMETER	Units	EW-1	EW-2	EW-3	EW-4	EW-5	EW-6	EW-7	EW-8	EW-9	EW-9 (DUP)	EW-10
Chloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U
Acetone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	0.7 J	1 U	1 U	1 U
1,2-Dichloroethene (total)	ug/L	NS	3.7	1.7	1 U	1 U	1 U	3.9	24	1 U	1 U	1 U
Chloroform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trichloroethene	ug/L	NS	220	44	790	100	6.3	3.2	8.5	0.7	0.7	1 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Benzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromoform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Tetrachloroethene	ug/L	NS	51	1.4	16	3.2	12	7.1	71	85	88	0.8 J
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Toluene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Styrene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U

Notes: U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.

J = Indicates an estimated value.

NS = Not Sampled

Table 2-4
 Summary of Groundwater Analytical Results - August 2012
 Black & Decker
 Hampstead, Maryland

PARAMETER	Units	RFW-1A	RFW-1B	RFW-2A	RFW-2B	RFW-3B	RFW-4A	RFW-4A (DUP)	RFW-4B	RFW-5A	RFW-6	RFW-7	RFW-8	RFW-9	RFW-10
Chloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromomethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Vinyl Chloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Methylene Chloride	ug/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	NS	2 U	2 U	NS	2 U	NS
Acetone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Carbon Disulfide	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1-Dichloroethene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	0.8 J	NS
1,1-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	0.8 J	NS
1,2-Dichloroethene (total)	ug/L	1 U	1 U	1 U	1 U	1.5	0.7 J	0.7 J	3.1	NS	1 U	1 U	NS	16	NS
Chloroform	ug/L	1 U	1 U	1 U	1 U	1 U	0.6 J	0.6 J	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
2-Butanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1,1-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	0.9 J	NS
Carbon Tetrachloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromodichloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloropropane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
cis-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trichloroethene	ug/L	0.5 J	0.5	1	1	0.7	28	28	11	NS	0.7	2.2	NS	11	NS
Dibromochloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,1,2-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Benzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	0.2 J	NS	1 U	NS
Trans-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromoform	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
4-Methyl-2-pentanone	ug/L	5 U	5 U	5 U	1 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
2-Hexanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Tetrachloroethene	ug/L	1 U	1 U	1 U	1 U	0.6 J	20	20	28	NS	0.6 J	1 U	NS	6	NS
1,1,2,2-Tetrachloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Toluene	ug/L	1 U	1 U	1 U	1 U	0.2 J	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chlorobenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Ethylbenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Styrene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Xylene (total)	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS

Notes: DUP = Duplicate sample
 NS = Not sampled

U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.
 J = Indicates an estimated value.

Table 2-4
Summary of Groundwater Analytical Results - August 2012
Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-11A	RFW-11B	RFW-12B	RFW-13	RFW-16	RFW-17	Leister Dairy	Leister Res. #1	Leister Res. #2	Trip Blank	RFW-20	RFW-21	Town #22	Town #23	Trip Blank
		USEPA drinking water method 524.2														
Chloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	2 U	2 U	2 U	NS	2 U	ABD	ABD	ABD	2 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Acetone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	NS	10 U	10 U	10 U	14
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	NS	NA	NA	NA	NA
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloroethene (total)	ug/L	NS	1 U	1.8	0.7 J	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Chloroform	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.4 J	0.5 U	0.5 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	NS	10 U	10 U	10 U	10 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Trichloroethene	ug/L	NS	3	73	2.3	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Benzene	ug/L	NS	1 U	1 U	1 U	NS	0.9	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Bromoform	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	NS	10 U	10 U	10 U	10 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	NS	10 U	10 U	10 U	10 U
Tetrachloroethene	ug/L	NS	1 U	4.7	13	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Toluene	ug/L	NS	0.1 J	0.1 J	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Styrene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	NS	0.5 U	0.5 U	0.5 U	0.5 U

Notes: Samples from wells RFW-20 & 21, Town-22&23 are analyzed with the USEPA drinking water method 524.2 at the request of the MDE Source Protection and Appropriation Division. Samples from all of the other wells are analyzed with USEPA Method 8260.
NS = Not sampled
U = Compound was analyzed but not detected.
ABD = Well has been abandoned
RFW -20 was not sampled because it was damaged. The well is now repaired and will be sampled during the 4th quarter.

Table 2-5
Summary of Groundwater Analytical Results - November 2012
Stanley Black & Decker
Hampstead, Maryland

PARAMETER	Units	EW-1	EW-2	EW-3	EW-4	EW-5	EW-6	EW-7	EW-8	EW-8 (DUP)	EW-9	EW-10
Chloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U
Acetone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	0.5 J	0.8 J	0.8 J	1 U	1 U
1,2-Dichloroethene (total)	ug/L	NS	3.5	1.7	1 U	1 U	1 U	5.4	24	24	1 U	1 U
Chloroform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trichloroethene	ug/L	NS	200	48	930	110	6.4	3.8	8	8.2	0.6	1 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Benzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromoform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Tetrachloroethene	ug/L	NS	45	1.5	19	3.4	12	8.8	66	67	110	0.6 J
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Toluene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Styrene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U

Notes: U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.
J = Indicates an estimated value.
NS = Not Sampled

Table 2-5
Summary of Groundwater Analytical Results - November 2012
Stanley Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-1A	RFW-1B	RFW-2A	RFW-2B	RFW-3B	RFW-4A	RFW-4A (DUP)	RFW-4B	RFW-5A	RFW-6	RFW-7	RFW-8	RFW-9	RFW-10
Chloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromomethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Vinyl Chloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Methylene Chloride	ug/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	NS	2 U	2 U	NS	2 U	NS
Acetone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Carbon Disulfide	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1-Dichloroethene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,1-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloroethene (total)	ug/L	1 U	1 U	1 U	1 U	0.7 J	0.8 J	0.8 J	4.1	NS	0.8 J	1 U	NS	7.1	NS
Chloroform	ug/L	1 U	1 U	1 U	1 U	1 U	0.7 J	0.8 J	1.1	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
2-Butanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1,1-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Carbon Tetrachloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromodichloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloropropane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
cis-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trichloroethene	ug/L	1 U	1 U	0.7	0.6	1 U	29	29	34	NS	2	0.5	NS	5.5	NS
Dibromochloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,1,2-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Benzene	ug/L	1 U	1 U	1 U	0.2 J	1 U	1 U	1 U	1 U	NS	1 U	0.2 J	NS	1 U	NS
Trans-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromoform	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
4-Methyl-2-pentanone	ug/L	5 U	5 U	5 U	1 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
2-Hexanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Tetrachloroethene	ug/L	1 U	1 U	1 U	1 U	0.5 J	20	20	64	NS	2.3	1 U	NS	2.7	NS
1,1,2,2-Tetrachloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Toluene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chlorobenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Ethylbenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Styrene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Xylene (total)	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS

Notes: DUP = Duplicate sample
NS = Not sampled

U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.
J = Indicates an estimated value.

Table 2-5
Summary of Groundwater Analytical Results - November 2012
Stanley Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-11A	RFW-11B	RFW-12B	RFW-13	RFW-16	RFW-17	Leister Dairy	Leister Res. #1	Leister Res. #2	Trip Blank	RFW-20	RFW-21	Town #22	Town #23	Trip Blank
		USEPA drinking water method 524.2														
Chloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	2 U	2 U	2 U	NS	2 U	ABD	ABD	ABD	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Acetone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	NA	NA	NA	NA	NA
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloroethene (total)	ug/L	NS	1 U	1.8	1 J	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroform	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.51	0.5 U	0.5 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trichloroethene	ug/L	NS	2.8	73	2.7	NS	1 U	ABD	ABD	ABD	1 U	0.5	0.5 U	0.5 U	0.5 U	0.5 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Benzene	ug/L	NS	1 U	1 U	1 U	NS	1.1	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromoform	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
Tetrachloroethene	ug/L	NS	1 U	5	17	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.34 J	0.5 U	0.5 U
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Toluene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Styrene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	NS	0.1 J	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U

Notes: Samples from wells RFW-20 & 21, Town-22&23 are analyzed with the USEPA drinking water method 524.2 at the request of the MDE Source Protection and Appropriation Division. Samples from all of the other wells are analyzed with USEPA Method 8260.
 NS = Not sampled
 U = Compound was analyzed but not detected.
 ABD = Well has been abandoned

Table 2-6
Summary of Groundwater Analytical Results - February 2013
Stanley Black & Decker
Hampstead, Maryland

PARAMETER	Units	EW-1	EW-2	EW-3	EW-4	EW-5	EW-6	EW-7	EW-8	EW-9	EW-9 (DUP)	EW-10
Chloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U
Acetone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	0.9 J	1 U	1 U	1 U
1,2-Dichloroethene (total)	ug/L	NS	4.5	1.9	1 U	1 U	1 U	6	25	1 U	1 U	1 U
Chloroform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trichloroethene	ug/L	NS	200	44	890	110	6	4.4	8.3	0.6	0.7	1 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Benzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromoform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Tetrachloroethene	ug/L	NS	51	1.5	17	3.3	11	10	71	88	95	0.6 J
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Toluene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Styrene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U

Notes: U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.
J = Indicates an estimated value.
NS = Not Sampled

Table 2-6
Summary of Groundwater Analytical Results - February 2013
Stanley Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-1A	RFW-1B	RFW-2A	RFW-2B	RFW-3B	RFW-4A	RFW-4A (DUP)	RFW-4B	RFW-5A	RFW-6	RFW-7	RFW-8	RFW-9	RFW-10
Chloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromomethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Vinyl Chloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Methylene Chloride	ug/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	NS	2 U	2 U	NS	2 U	NS
Acetone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Carbon Disulfide	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1-Dichloroethene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	0.8 J	NS
1,1-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	0.6 J	NS
1,2-Dichloroethene (total)	ug/L	1 U	1 U	1 U	1 U	1.9	0.8 J	0.8 J	4.1	NS	1 U	1 U	NS	11	NS
Chloroform	ug/L	1 U	1 U	1 U	1 U	1 U	0.6 J	0.6 J	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
2-Butanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1,1-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Carbon Tetrachloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromodichloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloropropane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
cis-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trichloroethene	ug/L	1 U	1 U	0.4 J	0.7	1 U	26	26	12	NS	0.7	1.9	NS	8.3	NS
Dibromochloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,1,2-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Benzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trans-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromoform	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
4-Methyl-2-pentanone	ug/L	5 U	5 U	5 U	1 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
2-Hexanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Tetrachloroethene	ug/L	1 U	1 U	1 U	1 U	0.3 J	19	18	32	NS	1.1	1 U	NS	4.2	NS
1,1,2,2-Tetrachloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Toluene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chlorobenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Ethylbenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Styrene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Xylene (total)	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS

Notes: DUP = Duplicate sample
NS = Not sampled

U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.
J = Indicates an estimated value.

Table 2-6
Summary of Groundwater Analytical Results - February 2013
Stanley Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-11A	RFW-11B	RFW-12B	RFW-13	RFW-16	RFW-17	Leister Dairy	Leister Res. #1	Leister Res. #2	Trip Blank	RFW-20	RFW-21	Town #22	Town #23	Trip Blank
		USEPA drinking water method 524.2														
Chloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	2 U	2 U	2 U	NS	2 U	ABD	ABD	ABD	2 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Acetone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	NA	NA	NA	NA	NA
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloroethene (total)	ug/L	NS	1 U	1.8	0.8 J	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroform	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.32 J	0.5 U	0.5 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trichloroethene	ug/L	NS	2.4	76	2.6	NS	1 U	ABD	ABD	ABD	1 U	0.4	0.5 U	0.5 U	0.5 U	0.5 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Benzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromoform	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
Tetrachloroethene	ug/L	NS	1 U	5.3	15	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.43 J	0.5 U	0.5 U
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Toluene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Styrene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U

Notes: Samples from wells RFW-20 & 21, Town-22&23 are analyzed with the USEPA drinking water method 524.2 at the request of the MDE Source Protection and Appropriation Division.
Samples from all of the other wells are analyzed with USEPA Method 8260.
NS = Not sampled
U = Compound was analyzed but not detected.
ABD = Well has been abandoned

Table 2-7
Summary of Groundwater Analytical Results - May 2013
Black & Decker
Hampstead, Maryland

PARAMETER	Units	EW-1	EW-2	EW-3	EW-4	EW-5	EW-6	EW-7	EW-8	EW-9	EW-9 (DUP)	EW-10
Chloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U
Acetone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	0.6 J	1 U	1 U	1 U
1,2-Dichloroethene (total)	ug/L	NS	3.5	1.8	1 U	1 U	1 U	3	21	1 U	1 U	1 U
Chloroform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trichloroethene	ug/L	NS	200	40	430	77	5.7	2.4	7.1	0.5	0.4 J	1 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Benzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromoform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Tetrachloroethene	ug/L	NS	48	1.3	8.7	2.4	10	5.5	65	88	87	1 U
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Toluene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Styrene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U

Notes: U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.
J = Indicates an estimated value.
NS = Not Sampled

Table 2-7
Summary of Groundwater Analytical Results - May 2013
Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-1A	RFW-1B	RFW-2A	RFW-2B	RFW-3B	RFW-4A	RFW-4A (DUP)	RFW-4B	RFW-5A	RFW-6	RFW-7	RFW-8	RFW-9	RFW-10
Chloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromomethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Vinyl Chloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Methylene Chloride	ug/L	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	NS	2 U	2 U	NS	2 U	NS
Acetone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Carbon Disulfide	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1-Dichloroethene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	0.5 J	NS
1,1-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloroethene (total)	ug/L	1 U	1 U	1 U	1 U	1.5	1 U	0.5 J	2.7	NS	1 U	1 U	NS	11	NS
Chloroform	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1.1	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
2-Butanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1,1-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	0.6 J	NS
Carbon Tetrachloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromodichloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloropropane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
cis-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trichloroethene	ug/L	1 U	1 U	0.37 J	0.3 J	0.3 J	23	23	43	NS	1.7	1.1	NS	7.6	NS
Dibromochloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,1,2-Trichloroethane	ug/L	1 U	1 U	U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Benzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trans-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromoform	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
4-Methyl-2-pentanone	ug/L	5 U	5 U	5 U	1 U	1 U	5 U	5 U	5 U	NS	5 U	1 U	NS	1 U	NS
2-Hexanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Tetrachloroethene	ug/L	1 U	1 U	1 U	1 U	0.6 J	17	16	67	NS	2	1 U	NS	4	NS
1,1,2,2-Tetrachloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Toluene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chlorobenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Ethylbenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Styrene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Xylene (total)	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS

Notes: DUP = Duplicate sample
NS = Not sampled

U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.
J = Indicates an estimated value.

Table 2-7
 Summary of Groundwater Analytical Results - May 2013
 Black & Decker
 Hampstead, Maryland

PARAMETER	Units	RFW-11A	RFW-11B	RFW-12B	RFW-13	RFW-16	RFW-17	Leister Dairy	Leister Res. #1	Leister Res. #2	Trip Blank	RFW-20	RFW-21	Town #22	Town #23	Trip Blank
		USEPA drinking water method 524.2														
Chloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	2 U	2 U	2 U	NS	2 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Acetone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	NA	NA	NA	NA	NA
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloroethene (total)	ug/L	NS	1 U	1.6	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroform	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trichloroethene	ug/L	NS	2.4	71	2	NS	1 U	ABD	ABD	ABD	1 U	0.4 J	0.5 U	0.5 U	0.5 U	0.5 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Benzene	ug/L	NS	1 U	1 U	1 U	NS	0.8	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromoform	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	1 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	ABD	ABD	ABD	5 U	10 U	10 U	10 U	10 U	10 U
Tetrachloroethene	ug/L	NS	1 U	5.9	12	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Toluene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Styrene	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	NS	1 U	ABD	ABD	ABD	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U

Notes: Samples from wells RFW-20 & 21, Town-22&23 are analyzed with the USEPA drinking water method 524.2 at the request of the MDE Source Protection and Appropriation Division.
 Samples from all of the other wells are analyzed with USEPA Method 8260.
 NS = Not sampled
 U = Compound was analyzed but not detected.
 ABD = Well has been abandoned

3. OPERATION AND MAINTENANCE OF THE TREATMENT SYSTEM

A summary of the maintenance activities that were performed on the extraction and treatment system during the reporting period (July 2012 through June 2013) is provided in Table 3-1. This table is comprehensive in summarizing significant maintenance events or activities, while not including those activities considered unworthy of note (such as replacement of light bulbs, lubrication of moving parts, as appropriate, or other routine activities).

Table 3-1
Treatment System Maintenance Activities (July 2012 through June 2013)
Black Decker
Hampstead, Maryland

Date	Event/Corrective Action
Jul-12	Alarm at the air stripper due to a power outage caused by a thunderstorm. The system is back online.
Jul-12	Air stripper calibrations done by Micro-Tech.
Jul-12	Alarm at the air stripper due to a power outage. The system is back online.
Aug-12	Alarm at the air stripper due to a series of power outages caused by severe weather. The system is back online.
Nov-12	Alarm at EW-7. Found that the heating elements were bad. Replaced heating elements, the well is back online.
Dec-12	New wet well probes were installed, system back online.
Dec-12	EW-6 tripped off. It was found that the pump motor was locked up.
Dec-12	EW-6 pump motor was replaced the pump is back online. The pump was off for less than 24 hours.
Jan-13	Alarm at air stripper, EW-10 was found to have a bad relay in the Warwick control, the relay was replaced. The well is back online.
Jan-13	The pitless adapter in EW-7 is leaking. The pitless adapter was replaced the well is back online.
Jan-13	EW-10 tripped off due to control wires that shorted out. These wires were replaced and the well is back online.

Table 3-1
Treatment System Maintenance Activities (July 2012 through June 2013)
Black Decker
Hampstead, Maryland

Jan-13	Alarm at stripper, due to a low hydro tank, it was found that the pressure switch on the hydro tank was frozen. The switch was thawed and the hydro tank was back online.
Feb-13	Alarm at stripper, due to a low hydro tank, it was found that the pressure switch on the hydro tank was frozen. The hydro tank was filled by hand using the transfer pumps. The switch was thawed and the hydro tank was back online.
Apr-13	Low hydro alarm. Found a domestic water pipe leaking due to excessive rust. Ran a temporary water line from the stripper to the domestic water supply. The pipe was then replaced and the system is back online.
May-13	Wet well supply flow failure. Reset everything, system back online.

4. TREATMENT SYSTEM PERFORMANCE EVALUATION

During the reporting period of July 2012 to June 2013, depth-to-water measurements were collected in all site monitor wells on a monthly basis. A groundwater elevation contour map was constructed each month to verify that the groundwater extraction system was providing a hydraulic barrier to prevent any groundwater contamination from migrating off-site. Pumping rates were adjusted as necessary to ensure that hydraulic control was being maintained across the site. Significant drawdown has been observed in both shallow and deeper monitor wells throughout the long-term pumping of the extraction well system, indicating that considerable interconnection exists between the shallow and deeper groundwater.

The groundwater elevation data collected in June 2013 were contoured using KT3D (Tonkin and Larson, 2002), a software program designed to contour groundwater elevation data while taking into account one or more pumping centers. As discussed in *A Systematic Approach for Evaluation of Capture Zones at Pump and Treat System* (USEPA, 2009), KT3D uses a linear-log kriging method that accounts for more tightly spaced groundwater elevation contours around pumping centers. Traditional computer-contouring packages utilize linear kriging methods that can overestimate predicted capture zones around pumping centers.

As shown in Figure 2-1, the groundwater elevation contour map generated by KT3D using groundwater elevation and pumping rate data for June 2013 shows a large depression in the groundwater surface in the vicinity of the pumping well networks at the site. The groundwater pathlines show that the direction of groundwater flow is toward the extraction wells and the pumping well network is establishing an effective hydraulic barrier along the site property boundaries. The predicted groundwater capture zones for the pumping wells extend across the site property.

The system as presently configured is successful in meeting the objective of capturing on-site groundwater, thereby reducing the potential off-site migration of contaminated groundwater. The system is also successful in treating the collected groundwater to remove the VOCs from the water. The laboratory analytical results of the treated discharge water indicate that no VOCs are present.

5. RECOMMENDATIONS

As discussed in Section 4, the treatment system has created a hydraulic boundary that prevents the off-site migration of groundwater. The extraction system will continue to operate as currently configured to pump and treat contaminated groundwater. Depth-to-water measurements will continue to be collected on a monthly basis in all site monitor wells to construct a groundwater elevation contour map for the site. The groundwater elevation contour map will be used to verify that the required area of groundwater capture is being maintained. If necessary, pumping rates will be adjusted to maintain groundwater capture due to seasonal fluctuations in groundwater elevations. The treatment system will also continue to operate as currently configured, as data collected have proven that the treatment system is fully effective in removing VOCs from the extracted groundwater.

APPENDIX A
WITHDRAWAL REPORTS

MARYLAND DEPARTMENT of the ENVIRONMENT, WATER MANAGEMENT ADMINISTRATION, 1800 WASHINGTON BLVD, BALTIMORE, MD 21230

Operated By:
Maryland Environmental Service
259 Najoles Road, Millersville MD

Facility: BTR Capital Group
Address: 626 Hanover Pike, Hampstead Maryland
Additional Op's & cert # - Dorrance Jones 0763, Gary Dickerson 0782, James Elliott 3738, Martin Whitt 0666, Anthony Phillips 3001

Permit Number: 02-DP-0022
Superintendent: Earle Villarreal

Month: April
Year: 2013
Certification # 1017

Final Effluent outfall 001												Outfall 101					Outfall 201			Operator	
Date	Appearance	Discharge MGD	pH su	Cl2 mg/l	Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l	Trichloroethane ug/l	BOD ₅ mg/l	TSS mg/l	O&G mg/l	Flow MGD	Fecal mpn	Basin inches	Alum Gpd	Hypochlorite Gpd	Post Cl2 mg/l	Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l	Trichloroethane ug/l		Discharge mgd
1	Clear	0.21700									0.191000		0.0	1.0	1.0	5.0				0.286020	Djones
2	Clear	0.14400	6.85	0.00	< 0.31	< 0.26	< 0.34	4.0	4.8	< 5.0	0.250000	< 1.8	0.0	1.0	1.0	5.0				0.228561	Djones
3	Clear	0.12200									0.200000		0.0	1.0	1.0	5.0				0.265450	Djones
4	Clear	0.19000	7.20	0.00							0.234000		0.0	1.0	1.0	5.0				0.240742	Djones
5	Clear	0.14000									0.236000		0.0	1.0	1.0	5.0				0.245442	Djones
6	Clear	0.13100									0.212000		0.0	1.0	1.0	5.0				0.244305	Djones
7	Clear	0.11300									0.206000		0.0	1.0	1.0	5.0				0.237162	Djones
8	Clear	0.10700									0.225000		0.0	1.0	1.0	5.0				0.233406	Jelliott
9	Clear	0.10800	7.13	0.00							0.189000	< 1.8	0.0	1.0	1.0	5.0				0.259990	Jelliott
10	Clear	0.09800									0.209000		0.0	1.0	1.0	5.0				0.231767	Djones
11	Clear	0.16400	7.90	0.00							0.240000		0.0	1.0	1.0	5.0				0.268197	Djones
12	Clear	0.19700									0.170000		0.0	1.0	1.0	5.0				0.241968	Djones
13	Clear	0.50300									0.214000		0.0	1.0	1.0	5.0				0.238208	Jelliott
14	Clear	0.19200									0.195000		0.0	1.0	1.0	5.0				0.242537	Jelliott
15	Clear	0.14800	7.45	0.00							0.200000		0.0	1.0	1.0	5.0				0.236659	Djones
16	Clear	0.12500									0.237000	4.5	0.0	1.0	1.0	5.0				0.266183	Djones
17	Clear	0.14000									0.228000		0.0	1.0	1.0	5.0				0.250065	Djones
18	Clear	0.16000	7.98	0.00							0.225000		0.0	1.0	1.0	5.0				0.238148	Djones
19	Clear	0.20100									0.143000		0.0	1.0	1.0	5.0				0.248602	Jelliott
20	Clear	0.77700									0.235000		0.0	1.0	1.0	5.0				0.209372	Jelliott
21	Clear	0.35900									0.196000		0.0	1.0	1.0	5.0				0.270790	Jelliott
22	Clear	0.23400									0.193000		0.0	1.0	1.0	5.0				0.239680	Djones
23	Clear	0.16300	8.01	0.00							0.231000	< 1.8	0.0	1.0	1.0	5.0				0.250837	Gdickerson
24	Clear	0.18500									0.151000		0.0	1.0	1.0	5.0				0.260352	Djones
25	Clear	0.22300									0.187000		0.0	2.0	1.0	5.0				0.254473	Mwhitt
26	Clear	0.14700	7.32	0.00							0.226000		0.0	2.0	1.0	5.0				0.235006	Djones
27	Clear	0.16000									0.204000		0.0	2.0	1.0	5.0				0.240781	APhillips
28	Clear	0.14100									0.200000		0.0	2.0	1.0	5.0				0.239170	APhillips
29	Clear	0.19600									0.208000		0.0	2.0	1.0	5.0				0.264710	Djones
30	Clear	0.36200	7.70	0.00							0.208000		0.0	2.0	1.0	5.0				0.226584	Djones
31																					
Total		6.14700									6.243000									7.395167	
Average		0.20490	7.5	<0.10	0	0	0	4	5	0	0.208100	2	0.0	1.2	1.0	5.0	#DIV/0!	#DIV/0!	#####	0.246506	
Minimum		0.09800	6.9	0.00	0	0	0	4	5	0	0.143000	1	0.0	1.0	1.0	5.0	0	0	0	0.209372	
Maximum		0.77700	8.0	<0.10	0	0	0	4	5	0	0.250000	5	0.0	2.0	1.0	5.0	0	0	0	0.286020	MOR 5-11-09

COMMENTS:

MARYLAND DEPARTMENT of the ENVIRONMENT, WATER MANAGEMENT ADMINISTRATION, 1800 WASHINGTON BLVD, BALTIMORE, MD 21230

Operated By
Maryland Environmental Service
259 Naples Road, Millersville MD

Facility: BTR Capital Group
Address: 626 Hanover Pike, Hampstead Maryland
Additional Op's & cert # - Doracne Jones 0763, Gary Dickerson 0782, Martin Whitt 0666, Anthony Phillips 3001, James Elliott 3738

Permit Number: 02-DP-0022
Superintendent: Earle Villarreal

Certification # 1017

Month: May
Year: 2013

Final Effluent outfall 001											Outfall 101					Outfall 201			Operator		
Date	Appearance	Discharge MGD	pH su	Cl2 mg/l	Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l	Trichloroethene ug/l	BOD ₅ mg/l	TSS mg/l	O&G mg/l	Flow MGD	Fecal mpn	Basin Inches	Alum Gpd	Hypochlorite Gpd	Post Cl2 mg/l	Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l		Trichloroethene ug/l	Discharge mgd
1	Clear	0.22400	7.15	0.00							0.186000		0.0	2.0	1.0	5.0				0.271337	Djones
2	Clear	0.14700			< 1.00	< 1.00	< 1.00	3.0	7.6	< 5.0	0.231000	4.5	0.0	2.0	1.0	5.0				0.246920	Djones
3	Clear	0.14200	7.47	0.00							0.222000		0.0	2.0	1.0	5.0				0.244544	Djones
4	Clear	0.08000									0.185000		0.0	2.0	1.0	5.0				0.239032	Mwhitt
5	Clear	0.10500									0.141000		0.0	2.0	1.0	5.0				0.246157	Mwhitt
6	Clear	0.12000	7.30	0.00							0.173000		0.0	2.0	1.0	5.0				0.256020	Djones
7	Clear	0.14100									0.197000	7.8	0.0	2.0	1.0	5.0				0.248513	Djones
8	Clear	0.43700	7.45								0.170000		0.0	2.0	1.0	5.0				0.246121	Djones
9	Clear	0.20700									0.160000		0.0	2.0	1.0	5.0				0.252149	Djones
10	Clear	0.17200									0.167000		0.0	2.0	1.0	5.0				0.237490	Djones
11	Clear	0.71800									0.152000		0.0	2.0	1.0	5.0				0.245550	Jelliott
12	Clear	0.50400									0.141000		0.0	2.0	1.0	5.0				0.241211	Jelliott
13	Clear	0.01980									0.160000		0.0	2.0	1.0	5.0				0.241505	Gdickerson
14	Clear	0.16800	7.84	0.00							0.160000	< 1.8	0.0	2.0	1.0	5.0				0.261279	Gdickerson
15	Clear	0.17500									0.149000		0.0	2.0	1.0	5.0				0.242200	Jelliott
16	Clear	0.17900	7.71	0.00							0.163000		0.0	2.0	1.0	5.0				0.239901	Jelliott
17	Clear	0.18000									0.153000		0.0	2.0	1.0	5.0				0.262743	Jelliott
18	Clear	0.13500									0.148000		0.0	2.0	1.0	5.0				0.238652	APhillips
19	Clear	0.14000									0.160000		0.0	2.0	1.0	5.0				0.239234	APhillips
20	Clear	0.14900									0.122000		0.0	2.0	1.0	5.0				0.265480	Jelliott
21	Clear	0.08600	7.82	0.00							0.146000	< 1.8	0.0	2.0	1.0	5.0				0.219600	Jelliott
22	Clear	0.11400									0.155000		0.0	2.0	1.0	5.0				0.248130	Gdickerson
23	Clear	0.13000									0.142000		0.0	2.0	1.0	5.0				0.281818	Djones
24	Clear	0.18400	8.13	0.00							0.163000		0.0	2.0	1.0	5.0				0.226623	Djones
25	Clear	0.12200									0.147000		0.0	2.0	1.0	5.0				0.259613	Mwhitt
26	Clear	0.72000									0.152000		0.0	2.0	1.0	5.0				0.239285	Mwhitt
27	Clear	0.86000									0.137000		0.0	2.0	1.0	5.0				0.255766	Mwhitt
28	Clear	0.91000	8.05	0.00							0.168000		0.0	2.0	1.0	5.0				0.254504	Djones
29	Clear	0.11700									0.131000	< 1.8	0.0	2.0	1.0	5.0				0.244920	Jelliott
30	Clear	0.06700	7.20	0.00							0.160000		0.0	2.0	1.0	5.0				0.225421	Djones
31	Clear	0.78000									0.165000		0.0	2.0	1.0	5.0				0.265187	Djones
Total		8.23280									5.006000									7.686905	
Average		0.26557	7.6	<0.10	0	0	0	3	8	0	0.161484	3	0.0	2.0	1.0	5.0	#DIV/0!	#DIV/0!	#####	0.247965	
Minimum		0.01980	7.2	0.00	0	0	0	3	8	0	0.122000	1	0.0	2.0	1.0	5.0	0	0	0	0.219600	
Maximum		0.91000	8.1	<0.10	0	0	0	3	8	0	0.231000	8	0.0	2.0	1.0	5.0	0	0	0	0.281818	MOR 5-11-09

COMMENTS:

MARYLAND DEPARTMENT of the ENVIRONMENT, WATER MANAGEMENT ADMINISTRATION, 1800 WASHINGTON BLVD, BALTIMORE, MD 21230

Operated By:

Facility: BTR Capital Group

Permit Number: 02-DP-0022

Month: June

Maryland Environmental Service
259 Najoles Road, Millersville MD

Address: 626 Hanover Pike, Hampstead Maryland

Superintendent: Earle Villarreal

Certification # 1017

Year: 2013

Additional Op's & cert # - Dorrance Jones 0763, Gary Dickerson 0782

Date	Appearance	Discharge MGD	pH su	Cl2 mg/l	Final Effluent outfall 001						Outfall 101						Outfall 201				Operator		
					Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l	Trichloroethene ug/l	BOD ₅ mg/l	TSS mg/l	O&G mg/l	Flow MGD	Fecal mpn	Basin Inches	Alum Gpd	Hypochlorite Gpd	Post Cl2 mg/l	Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l	Trichloroethene ug/l	Discharge mgd			
1	Clear	0.08700										0.145000		0.0	2.0	1.0	5.0				0.242264	Djones	
2	Clear	0.08500										0.155000		0.0	2.0	1.0	5.0				0.236528	Djones	
3	Clear	0.17800	7.92	0.00								0.141000		0.0	1.0	1.0	5.0				0.245802	Mwhitt	
4	Clear	0.19300										0.157000	< 1.8	0.0	1.0	1.0	5.0				0.253493	Gdickerson	
5	Clear	0.15700	7.40	0.00								0.135000		0.0	1.0	1.0	5.0				0.255372	Djones	
6	Clear	0.07000										0.170000		0.0	1.0	1.0	5.0				0.243689	Djones	
7	Clear	0.64000										0.166000		0.0	1.0	1.0	5.0				0.246806	Djones	
8	Clear	0.91100										0.151000		0.0	1.0	1.0	5.0				0.235026	Aphillips	
9	Clear	0.29900										0.157000		0.0	1.0	1.0	5.0				0.234026	Aphillips	
10	Clear	0.73900										0.137000		0.0	1.0	1.0	5.0				0.272158	Djones	
11	Clear	0.97200	8.17	0.00								0.175000	70.0	0.0	1.0	1.0	5.0				0.245899	Djones	
12	Clear	0.31100										0.144000		0.0	1.0	1.0	5.0				0.245389	Djones	
13	Clear	0.31600	7.45	0.00								0.172000		0.0	1.0	1.0	5.0				0.205066	Djones	
14	Clear	0.74100										0.173000		0.0	1.0	1.0	5.0				0.272905	Gdickerson	
15	Clear	0.30600										0.146000		0.0	1.0	1.0	5.0				0.248750	Gdickerson	
16	Clear	0.22900										0.152000		0.0	1.0	1.0	5.0				0.234790	Gdickerson	
17	Clear	0.31000										0.141000		0.0	1.0	1.0	5.0				0.250726	Djones	
18	Clear	0.27900	7.65	0.00	< 0.31	< 0.26	< 0.34	9.0	14.0	< 5.0		0.176000	7.8	0.0	1.0	1.0	5.0				0.262668	Djones	
19	Clear	0.38400										0.150000		0.0	1.0	1.0	5.0				0.247075	Djones	
20	Clear	0.24300	7.97	0.00								0.153000		0.0	1.0	1.0	5.0				0.225965	Djones	
21	Clear	0.21800										0.172000		0.0	1.0	1.0	5.0				0.246465	Djones	
22	Clear	0.17300										0.153000		0.0	1.0	1.0	5.0				0.254751	Djones	
23	Clear	0.14500										0.155000		0.0	1.0	1.0	5.0				0.238366	Djones	
24	Clear	0.20500										0.165000		0.0	1.0	1.0	5.0				0.246344	Jelliott	
25	Clear	0.14700	7.86	0.00								0.135000		0.0	1.0	1.0	5.0				0.256648	Jelliott	
26	Clear	0.20700										0.159000	< 1.8	0.0	1.0	1.0	5.0				0.216392	Djones	
27	Clear	0.18200	8.20	0.00								0.153000		0.0	1.0	1.0	5.0				0.226851	Djones	
28	Clear	0.63700										0.158000		0.0	1.0	1.0	5.0				0.240283	Jelliott	
29	Clear	0.38700										0.151000		0.0	1.0	1.0	5.0				0.256640	Jelliott	
30	Clear	0.21000										0.159000		0.0	1.0	1.0	5.0				0.239032	Jelliott	
31																							
Total		9.96100										4.656000										7.326169	
Average		0.33203	7.8	<0.10	0	0	0	9	14	0		0.155200	20	0.0	1.1	1.0	5.0	#DIV/0!	#DIV/0!	#####	0.244206		
Minimum		0.07000	7.4	0.00	0	0	0	9	14	0		0.135000	1	0.0	1.0	1.0	5.0	0	0	0	0.205066		
Maximum		0.97200	8.2	<0.10	0	0	0	9	14	0		0.176000	70	0.0	2.0	1.0	5.0	0	0	0	0.272905	MOR 5-11-09	

COMMENTS:

APPENDIX B
DISCHARGE MONITORING REPORTS

PERMITTEE NAME/ADDRESS (Include Facility Name/Location if different)

Name AG/GFI Hampstead, Inc
 Address 626 Hanover Pike
Hampstead, MD 21074

Facility Black and Decker WWTP
 Location 626 Hanover Pike
 Attn: _____

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)

(2-16)	(17-19)
MD0001881	001
PERMIT NUMBER	DISCHARGE NUMBER

Form Approved.
 OMB No.
 Approval expires

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form

State Discharge Permit
 02-DP-0022

MONITORING PERIOD					
YEAR	MO	DAY	YEAR	MO	DAY
13	04	01	13	04	30
(20-21)	(22-23)	(24-25)	(26-27)	(28-29)	(30-31)

PARAMETER (32-37)		(3 Card Only) QUANTITY OR LOADING			(4 Card Only) QUALITY OR CONCENTRATION				NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		(46-53) AVERAGE	(54-61) MAXIMUM	UNITS	(38-45) MINIMUM	(46-53) AVERAGE	(54-61) MAXIMUM	UNITS			
BOD, 5-DAY (20 DEG. C) 00310 1 0 0	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	4	(19)	0	ONCE/MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	*****	*****					
pH	SAMPLE MEASUREMENT	*****	*****	****	6.9	*****	8.0	(12)	0	TWICE/WEEK	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	6.0 DAILY MIN	*****	8.6 DAILY MAX				
SOLIDS, TOTAL SUSPENDED 00530 1 0 0	SAMPLE MEASUREMENT	*****	*****	****	*****	5	5	(19)	0	ONCE/MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	*****	5	5				
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0	SAMPLE MEASUREMENT	204,900	777,000	(07)	*****	*****	*****	****	0	Measured	RECORD
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	REPORT	REPORT	GPD	*****	*****	*****	****			
CHLORINE, TOTAL RESIDUAL 50060 1 0 0	SAMPLE MEASUREMENT	*****	*****	****	*****	<0.1	<0.1	(19)	0	ONCE/MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	*****						
TETRACHLOROETHYLENE 34475 1 0 0	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	(28)	0	ONCE/MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	*****	*****					
1,1,1-TRICHLOROETHANE 34506 1 0 0	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	(28)	0	ONCE/MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	*****	*****					

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER	I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED HEREIN. AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT. SEE 18 U.S.C. 551001 AND 33 U.S.C. 55 1319. (PENALTIES UNDER THESE STATUTES MAY INCLUDE FINES UP TO \$10,000 AND OR MAXIMUM IMPRISONMENT OF BETWEEN 6 MONTHS AND 5 YEARS.)	TF/PHONE		DATE		
James M. Harkins MES Director		410	729-8350	13	05	21
TYPED OR PRINTED						

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

Facility Name/Location if different)

DISCHARGE MONITORING REPORT (DMR)

Form Approved.

Name AG/GFI Hampstead, Inc

(2-16)

(17-19)

OMB No.

Address 626 Hanover Pike

MD0001881

001

Approval expires

Hampstead, MD 21074

PERMIT NUMBER

DISCHARGE NUMBER

*** NO DISCHARGE ***

Facility Black and Decker WWTP

MONITORING PERIOD

NOTE: Read instructions before completing this form


Location 626 Hanover Pike

YEAR	MO	DAY	TO	YEAR	MO	DAY
13	04	01		13	04	30
(20-21) (22-23) (24-25)				(26-27) (28-29) (30-31)		

State Discharge Permit

Attn:

02-DP-0022

PARAMETER (32-37)		(3 Card Only) (46-53)			QUANTITY OR LOADING (54-61)			(4 Card Only) (38-45)			QUALITY OR CONCENTRATION (46-53)			UNITS	NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	MINIMUM	AVERAGE	MAXIMUM							
TRICHLOROETHENE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****				0			(28)	0	ONCE/MONTH	GRAB	
79141 1 0 0	PERMIT REQUIREMENT			****									UG/L				
EFFLUENT GROSS VALUE																	
OIL AND GREASE	SAMPLE MEASUREMENT	*****	*****	****	*****	0				0			(19)	0	ONCE/MONTH	GRAB	
TOTAL RECOVERABLE				****									MG/L				
70030 1 0 0	PERMIT REQUIREMENT			****													
EFFLUENT GROSS VALUE																	
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER	CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED HEREIN; AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT. SEE 18 U.S.C. SS1001 AND 33 U.S.C. SS 1319. (PENALTIES UNDER THESE STATUTES MAY INCLUDE FINES UP TO \$10,000 AND OR MAXIMUM IMPRISONMENT OF BETWEEN 6 MONTHS AND 5 YEARS.)										TTE PHONE		DATE				
James M. Harkins MES Director											410	729-8350	13	05	21		
TYPED OR PRINTED	SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT										AREA CODE	NUMBER	YEAR	MONTH	DAY		

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include

Facility Name/Location if different)

Name AG/GFI Hampstead, Inc.

Address 626 Hanover Pike

Hampstead, MD 21074

Facility Black and Decker WWTP

Location 626 Hanover Pike

Attn:

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)

(2-16)

(17-19)

MD0001881

101

PERMIT NUMBER

DISCHARGE NUMBER

Form Approved.

OMB No.

Approval expires

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form

MONITORING PERIOD

FROM	YEAR	MO	DAY	TO	YEAR	MO	DAY
	13	04	01		13	04	30
	(20-21)	(22-23)	(24-25)		(26-27)	(28-29)	(30-31)

State Discharge Permit

02-DP-0022

PARAMETER (32-37)	SAMPLE MEASUREMENT	(3 Card Only) (46-53) QUANTITY OR LOADING			(4 Card Only) (38-45) QUALITY OR CONCENTRATION				NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS			
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0		208,100	250,000	(07)	*****	*****	*****	****	0	ONCE/ MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT			GPD				****			
COLIFORM, FECAL GENERAL 74055 1 0 0		*****	*****	****	*****	*****	5	(30)	0	ONCE/ WEEK	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT			****				MPN			
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER	I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED HEREIN AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT. SEE 18 U.S.C. 881001 AND 33 U.S.C. 88 1319. (PENALTIES UNDER THESE STATUTES MAY INCLUDE FINES UP TO \$10,000 AND OR MAXIMUM IMPRISONMENT OF BETWEEN 8 MONTHS AND 5 YEARS.				TFI PHONE			DATE			
James M. Harkins MES Director					410	729-8350	13	05	21		
TYPED OR PRINTED					AREA CODE	NUMBER	YFAR	MONTH	DAY		

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include

Facility Name/Location if different)

Name AG/GFI Hampstead, Inc

Address 626 Hanover Pike

Hampstead, MD 21074

Facility Black and Decker WWTP

Location 626 Hanover Pike

Attn:

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)

(2-16)

(17-19)

MD0001881

001

PERMIT NUMBER

DISCHARGE NUMBER

Form Approved.

OMB No.

Approval expires

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form

State Discharge Permit

02-DP-0022

MONITORING PERIOD

YEAR	MO	DAY	YEAR	MO	DAY
FROM 13	05	01	TO 13	05	31
(20-21)	(22-23)	(24-25)	(26-27)	(28-29)	(30-31)

PARAMETER (32-37)		(3 Card Only) QUANTITY OR LOADING			(4 Card Only) QUALITY OR CONCENTRATION			NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)	
		(46-53)		(54-61)	(38-45)		(46-53)				(54-61)
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM				UNITS
BOD, 5-DAY (20 DEG. C) 00310 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	3	(19)	0	ONCE/ MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****	****	*****	*****	15 DAILY MX	MG/L		ONCE/ MONTH	GRAB
pH 00400 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	7.2	*****	8.1	(12)	0	TWICE/ WEEK	GRAB
	PERMIT REQUIREMENT	*****	*****	****	6.0 DAILY MN	*****	8.5 DAILY MX	SU		TWICE/ WEEK	GRAB
SOLIDS, TOTAL SUSPENDED 00530 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	8	8	(19)	0	ONCE/ MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****	****	*****	20 30DA AVG	30 DAILY MX	MG/L		ONCE/ MONTH	GRAB
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	265,574	910,000	(07)	*****	*****	*****	****	0	Measured	RECORD
	PERMIT REQUIREMENT	REPORT	REPORT	GPD	*****	*****	*****	****		Measured	RECORD
CHLORINE, TOTAL RESIDUAL 50060 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	<0.1	<0.1	(19)	0	ONCE/ MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****	****	*****	0.011 30DA AVG	0.019 DAILY MX	MG/L		ONCE/ MONTH	GRAB
TETRACHLOROETHYLENE 34475 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	(28)	0	ONCE/ MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****	****	*****	*****	5 DAILY MX	UG/L		ONCE/ MONTH	GRAB
1,1,1-TRICHLOROETHANE 34506 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	(28)	0	ONCE/ MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****	****	*****	*****	5 DAILY MX	UG/L		ONCE/ MONTH	GRAB
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER	I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED HEREIN; AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT. SEE 18 U.S.C. SS1001 AND 33 U.S.C. SS 1319. (PENALTIES UNDER THESE STATUTES MAY INCLUDE FINES UP TO \$10,000 AND OR MAXIMUM IMPRISONMENT OF BETWEEN 6 MONTHS AND 5 YEARS.)				TFI PHONE		DATE				
James M. Harkins MES Director					410	729-8350	13	06	25		
TYPED OR PRINTED										AREA CODE	NUMBER

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include

Facility Name/Location if different)
 Name AG/GFI Hampstead, Inc
 Address 626 Hanover Pike
Hampstead, MD 21074
 Facility Black and Decker WWTP
 Location 626 Hanover Pike
 Attn: _____

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)

(2-16) (17-19)
 MD0001881 001
PERMIT NUMBER **DISCHARGE NUMBER**

Form Approved.
 OMB No.
 Approval expires

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form

MONITORING PERIOD						
YEAR	MO	DAY	TO	YEAR	MO	DAY
13	05	01	TO	13	05	31
(20-21) (22-23) (24-25)				(26-27) (28-29) (30-31)		

State Discharge Permit
 02-DP-0022

PARAMETER (32-37)		QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)	
		(3 Card Only) (46-53) AVERAGE	(54-61) MAXIMUM	UNITS	(4 Card Only) (38-45) MINIMUM	(46-53) AVERAGE	(54-61) MAXIMUM				UNITS
TRICHLOROETHENE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	(28)	0	ONCE/MONTH	GRAB
79141 1 0 0	PERMIT REQUIREMENT	*****	*****	****	*****	*****	5	UG/L		ONCE/MONTH	GRAB
EFFLUENT GROSS VALUE							DAILY MX				
OIL AND GREASE	SAMPLE MEASUREMENT	*****	*****	****	*****	0	0	(19)	0	ONCE/MONTH	GRAB
TOTAL RECOVERABLE	PERMIT REQUIREMENT	*****	*****	****	*****	10	15	MG/L		ONCE/MONTH	GRAB
70030 1 0 0						30DA AVG	DAILY MX				
EFFLUENT GROSS VALUE											
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER	I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED HEREIN, AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT. SEE 18 U.S.C. SS1001 AND 33 U.S.C. SS 1319. (PENALTIES UNDER THESE STATUTES MAY INCLUDE FINES UP TO \$10,000 AND OR MAXIMUM IMPRISONMENT OF BETWEEN 6 MONTHS AND 5 YEARS.						TELEPHONE		DATE		
James M. Harkins MES Director TYPED OR PRINTED							SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT		410	729-8350	13
COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)			AREA CODE	NUMBER	YEAR	MONTH	DAY				

PERMITTEE NAME/ADDRESS (Include

Facility Name/Location if different)

Name AG/GFI Hampstead, Inc.
 Address 626 Hanover Pike
Hampstead, MD 21074

Facility Black and Decker WWTP

Location 626 Hanover Pike

Attn: _____

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)

(2-16) (17-19)
 MD0001881 101
PERMIT NUMBER **DISCHARGE NUMBER**

Form Approved.
 OMB No.
 Approval expires


*** NO DISCHARGE ***

NOTE: Read instructions before completing this form

State Discharge Permit
 02-DP-0022

MONITORING PERIOD					
YEAR	MO	DAY	YEAR	MO	DAY
13	05	01	13	05	31
FROM		TO			
(20-21)		(22-23)		(24-25)	
		(26-27)		(28-29)	
				(30-31)	

PARAMETER (32-37)		QUANTITY OR LOADING			QUALITY OR CONCENTRATION			NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		(3 Card Only) (46-53) AVERAGE	(54-61) MAXIMUM	UNITS	(4 Card Only) (38-45) MINIMUM	(46-53) AVERAGE	(54-61) MAXIMUM			
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	161,484	231,000	(07)	*****	*****	*****	0	ONCE/MONTH	GRAB
	PERMIT REQUIREMENT	REPORT	REPORT	GPD	*****	*****	*****			
COLIFORM, FECAL GENERAL 74055 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	8	0	ONCE/WEEK	GRAB
	PERMIT REQUIREMENT	*****	*****	****	*****	*****	200 DAILY MX			
	SAMPLE MEASUREMENT									
	PERMIT REQUIREMENT									
	SAMPLE MEASUREMENT									
	PERMIT REQUIREMENT									
	SAMPLE MEASUREMENT									
	PERMIT REQUIREMENT									
	SAMPLE MEASUREMENT									
	PERMIT REQUIREMENT									
	SAMPLE MEASUREMENT									
	PERMIT REQUIREMENT									

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER James M. Harkins MES Director TYPED OR PRINTED	I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED HEREIN, AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT. SEE 18 U.S.C. 851001 AND 33 U.S.C. 851319. (PENALTIES UNDER THESE STATUTES MAY INCLUDE FINES UP TO \$10,000 AND OR MAXIMUM IMPRISONMENT OF BETWEEN 6 MONTHS AND 5 YEARS.	SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT		TELEPHONE		DATE		
				410	729-8350	13	06	25
		AREA CODE	NUMBER	YEAR	MONTH	DAY		

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include Facility Name/Location if different)

Name AG/GFI Hampstead, Inc
 Address 626 Hanover Pike
Hampstead, MD 21074

Facility Black and Decker WWTP
 Location 626 Hanover Pike
 Attn: _____

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)

(2-16)	(17-19)
MD0001881	001
PERMIT NUMBER	DISCHARGE NUMBER

Form Approved.
 OMB No.
 Approval expires

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form

State Discharge Permit
 02-DP-0022

MONITORING PERIOD							
YEAR	MO	DAY	TO	YEAR	MO	DAY	
FROM	13	06	01	TO	13	06	30
	(20-21)	(22-23)	(24-25)		(26-27)	(28-29)	(30-31)

PARAMETER (32-37)		(3 Card Only) QUANTITY OR LOADING			(4 Card Only) QUALITY OR CONCENTRATION				NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		(46-53) AVERAGE	(54-61) MAXIMUM	UNITS	(38-45) MINIMUM	(46-53) AVERAGE	(54-61) MAXIMUM	UNITS			
BOD, 5-DAY (20 DEG. C) 00310 1 0 0	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	9	(19)	0	ONCE/ MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	*****	*****	15 DAILY MX	MG/L		ONCE/ MONTH	GRAB
pH	SAMPLE MEASUREMENT	*****	*****	****	7.4	*****	8.2	(12)	0	TWICE/ WEEK	GRAB
00400 1 0 0 EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	6.0 DAILY MN	*****	8.5 DAILY MX	SU		TWICE/ WEEK	GRAB
SOLIDS, TOTAL SUSPENDED 00530 1 0 0	SAMPLE MEASUREMENT	*****	*****	****	*****	14	14	(19)	0	ONCE/ MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	*****	20 30DA AVG	30 DAILY MX	MG/L		ONCE/ MONTH	GRAB
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0	SAMPLE MEASUREMENT	332,033	972,000	(07)	*****	*****	*****	****	0	Measured	RECORD
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	REPORT	REPORT	GPD	*****	*****	*****	****		Measured	RECORD
CHLORINE, TOTAL RESIDUAL 50060 1 0 0	SAMPLE MEASUREMENT	*****	*****	****	*****	<0.1	<0.1	(19)	0	ONCE/ MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	*****	0.011 30DA AVG	0.019 DAILY MX	MG/L		ONCE/ MONTH	GRAB
TETRACHLOROETHYLENE 34475 1 0 0	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	(28)	0	ONCE/ MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	*****	*****	5 DAILY MX	UG/L		ONCE/ MONTH	GRAB
1,1,1-TRICHLOROETHANE 34506 1 0 0	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	(28)	0	ONCE/ MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****	****	*****	*****	5 DAILY MX	UG/L		ONCE/ MONTH	GRAB

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER James M. Harkins MES Director TYPED OR PRINTED	I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED HEREIN; AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT, SEE 18 U.S.C. SS1001 AND 33 U.S.C. SS 1319. (PENALTIES UNDER THESE STATUTES MAY INCLUDE FINES UP TO \$10,000 AND OR MAXIMUM IMPRISONMENT OF BETWEEN 6 MONTHS AND 5 YEARS.)	TFI PHONE		DATE		
		410	729-8350	13	07	22
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT		AREA CODE	NUMBER	YEAR	MONTH	DAY

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

Facility Name/Location if different)

DISCHARGE MONITORING REPORT (DMR)

Form Approved.

Name AG/GFI Hampstead, Inc

(2-16)

(17-19)

OMB No.

Address 626 Hanover Pike

MD0001881

001

Approval expires

Hampstead, MD 21074

PERMIT NUMBER

DISCHARGE NUMBER

*** NO DISCHARGE ***

Facility Black and Decker WWTP

NOTE: Read instructions before completing this form

Location 626 Hanover Pike

Attn:


MONITORING PERIOD

FROM	YEAR	MO	DAY	TO	YEAR	MO	DAY
	13	06	01		13	06	30
	(20-21)	(22-23)	(24-25)		(26-27)	(28-29)	(30-31)

State Discharge Permit

02-DP-0022

PARAMETER (32-37)		(3 Card Only) (46-53) QUANTITY OR LOADING (54-61)			(4 Card Only) (38-45) QUALITY OR CONCENTRATION (46-53) (54-61)			NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)	
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM				UNITS
TRICHLOROETHENE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	(28)	0	ONCE/ MONTH	GRAB
79141 1 0 0	PERMIT REQUIREMENT	*****	*****	****	*****	*****	5	UG/L		ONCE/ MONTH	GRAB
EFFLUENT GROSS VALUE						DAILY MX					
OIL AND GREASE TOTAL RECOVERABLE	SAMPLE MEASUREMENT	*****	*****	****	*****	0	0	(19)	0	ONCE/ MONTH	GRAB
70030 1 0 0	PERMIT REQUIREMENT	*****	*****	****	*****	10	15	MG/L		ONCE/ MONTH	GRAB
EFFLUENT GROSS VALUE						30DA AVG	DAILY MX				
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER	I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED HEREIN; AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT. SEE 18 U.S.C. SS1001 AND 33 U.S.C. SS 1319. (PENALTIES UNDER THESE STATUTES MAY INCLUDE FINES UP TO \$10,000 AND OR MAXIMUM IMPRISONMENT OF BETWEEN 6 MONTHS AND 5 YEARS.	TFI PHONE		DATE		
		James M. Harkins MES Director TYPED OR PRINTED		410	729-8350	13
	SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT	AREA CODE	NUMBER	YEAR	MONTH	DAY

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include Facility Name/Location if different)

Name AG/GFI Hampstead, Inc.
 Address 626 Hanover Pike
Hampstead, MD 21074

Facility Black and Decker WWTP
 Location 626 Hanover Pike
 Attn: _____

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)

(2-16)	(17-19)
MD0001881	101
PERMIT NUMBER	DISCHARGE NUMBER

Form Approved.

OMB No.

Approval expires

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form

MONITORING PERIOD					
YEAR	MO	DAY	YEAR	MO	DAY
FROM 13	06	01	TO 13	06	30
(20-21)	(22-23)	(24-25)	(26-27)	(28-29)	(30-31)

State Discharge Permit
02-DP-0022

PARAMETER (32-37)		QUANTITY OR LOADING			QUALITY OR CONCENTRATION				NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		(3 Card Only) (46-53) AVERAGE	(54-61) MAXIMUM	UNITS	(4 Card Only) (38-45) MINIMUM	(46-53) AVERAGE	(54-61) MAXIMUM	UNITS			
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	155,200	176,000	(07)	*****	*****	*****	****	0	ONCE/MONTH	GRAB
	PERMIT REQUIREMENT	REPORT	REPORT	GPD	*****	*****	*****	****		ONCE/MONTH	GRAB
COLIFORM, FECAL GENERAL 74055 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	70	(30)	0	ONCE/WEEK	GRAB
	PERMIT REQUIREMENT	*****	*****	****	*****	*****	200 DAILY MX	MPN		ONCE/WEEK	GRAB
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER	I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED HEREIN; AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT. SEE 18 U.S.C. SS1001 AND 33 U.S.C. SS 1319. (PENALTIES UNDER THESE STATUTES MAY INCLUDE FINES UP TO \$10,000 AND OR MAXIMUM IMPRISONMENT OF BETWEEN 6 MONTHS AND 5 YEARS.)				TFI PHONE			DATE			
James M. Harkins MES Director TYPED OR PRINTED					SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT			410	729-8350	13	07
COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)	AREA CODE	NUMBER	YEAR	MONTH	DAY						

PERMITTEE NAME/ADDRESS (Include

Facility Name/Location if different)

Name AG/GFI Hampstead, Inc.

Address 626 Hanover Pike

Hampstead, MD 21074

Facility Black and Decker WWTP

Location 626 Hanover Pike

Attn:

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)

DISCHARGE MONITORING REPORT (DMR)

(2-16)

(17-19)

MD0001881

201

PERMIT NUMBER

DISCHARGE NUMBER

Form Approved.

OMB No.

Approval expires

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form

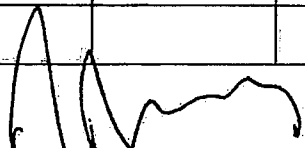
MONITORING PERIOD

FROM	YEAR	MO	DAY	TO	YEAR	MO	DAY
	13	04	01		13	06	30
	(20-21)	(22-23)	(24-25)		(26-27)	(28-29)	(30-31)

State Discharge Permit

02-DP-0022

PARAMETER (32-37)		(3 Card Only) (46-53)			(4 Card Only) (38-45)				NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS			
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	246,244	286,020	(07)	*****	*****	*****	*****	0	Measured	Record
	PERMIT REQUIREMENT	REPORT	REPORT	GPD	*****	*****	*****	*****		Measured	Record
TETRACHLOROETHYLENE 34475 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	0	0	(28)	0	One/ Quarter	Grab
	PERMIT REQUIREMENT	*****	*****	****	*****	REPORT	REPORT	UG/L		One/ Quarter	Grab
1,1,1-TRICHLOROETHANE 34506 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	0	0	(28)	0	One/ Quarter	Grab
	PERMIT REQUIREMENT	*****	*****	****	*****	REPORT	REPORT	UG/L		One/ Quarter	Grab
TRICHLOROETHENE 79141 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	0	0	(28)	0	One/ Quarter	Grab
	PERMIT REQUIREMENT	*****	*****	****	*****	REPORT	REPORT	UG/L		One/ Quarter	Grab
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER James M. Harkins MES Director	I CERTIFY UNDER PENALTY OF LAW THAT I HAVE PERSONALLY EXAMINED AND AM FAMILIAR WITH THE INFORMATION SUBMITTED HEREIN, AND BASED ON MY INQUIRY OF THOSE INDIVIDUALS IMMEDIATELY RESPONSIBLE FOR OBTAINING THE INFORMATION, I BELIEVE THE SUBMITTED INFORMATION IS TRUE, ACCURATE AND COMPLETE. I AM AWARE THAT THERE ARE SIGNIFICANT PENALTIES FOR SUBMITTING FALSE INFORMATION, INCLUDING THE POSSIBILITY OF FINE AND IMPRISONMENT. SEE 18 U.S.C. SS1001 AND 33 U.S.C. SS 1319. (PENALTIES UNDER THESE STATUTES MAY INCLUDE FINES UP TO \$10,000 AND OR MAXIMUM IMPRISONMENT OF BETWEEN 6 MONTHS AND 5 YEARS.)	 SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT	TPI PHONE		DATE		
			410	729-8350	13	07	24
TYPED OR PRINTED			AREA CODE	NUMBER	YEAR	MONTH	DAY

COMMENT AND EXPANATION OF ANY VIOLATIONS (Reference all attachments here)

APPENDIX C
GROUNDWATER TREATMENT SYSTEM ANALYTICAL RESULTS

Account No:AL0341, MARYLAND ENVIRONMENTAL SERVICE A
Project No: AL0341 BLK DECK WWTP, BLACK & DECKER WWTP

P.O. No:

Inv. No: MES_AL0341
PWSID No:

Sample ID Sample Description Samp. Date/Time/Temp Sampled by
L4524415-1 FINAL 001 GRAB 04/02/13 09:40am NA C Customer
Received Date/Time/Temp 04/02/13 04:30pm 4.5 C Iced (Y/N): Y

Parameter	Method	Result	RLs	Test Date, Time, Analyst
-----------	--------	--------	-----	--------------------------

GENERAL CHEMISTRY

BIOCHEMICAL OXYGEN DEMAND (DELAWARE)	SM 5210B	4.00 mg/l	2.00 mg/l	04/03/13 11:20AM SKJ
TOTAL SUSPENDED SOLIDS (DELAWARE)	SM 2540D	4.80 mg/l	4.00 mg/l	04/05/13 12:00AM MS3
HEXANE EXTR.-HEM (OIL+GREASE)	1664A HEM	ND mg/l	5.00 mg/l	04/04/13 06:20PM JAZ

GAS CHROMATOGRAPHY MASS SPECTROMETRY; VOLATILES

1,1,1-TRICHLOROETHANE	EPA 624	ND ug/l	0.260 ug/l*	04/10/13 09:47PM JAD
TRICHLOROETHENE	EPA 624	ND ug/l	0.340 ug/l*	04/10/13 09:47PM JAD
TETRACHLOROETHENE	EPA 624	ND ug/l	0.310 ug/l*	04/10/13 09:47PM JAD
DIBROMOFLUOROMETHANE	EPA 624	103 %		04/10/13 09:47PM JAD
TOLUENE-D8 (SURR)	EPA 624	103 %		04/10/13 09:47PM JAD
4-BROMOFLUOROBENZENE	EPA 624	96 %		04/10/13 09:47PM JAD

Sample ID Sample Description Samp. Date/Time/Temp Sampled by
L4524415-2 FINAL 001 GRAB MATRIX SPIKE 04/02/13 09:45am NA C Customer
Received Date/Time/Temp 04/02/13 :00pm 4.5 C Iced (Y/N): Y

Parameter	Method	Result	RLs	Test Date, Time, Analyst
-----------	--------	--------	-----	--------------------------

GENERAL CHEMISTRY

HEXANE EXTR.-HEM (OIL+GREASE)	1664A HEM	ND mg/l	5.00 mg/l	04/08/13 06:15PM JAZ
-------------------------------	-----------	---------	-----------	----------------------

Notes:

A result of "ND" indicates that the analyte tested was either not detected or the concentration was below the RLs.
Definitions: NEG=negative; POS=positive; COL=colonies; RLs=laboratory reporting limits; L/A=laboratory accident; TNTC= Too numerous to count; pres=presumptive
MCL= EPA recommended "maximum contaminant level", PLs = Customer-specific permit limits.
The test results meet all requirements of NELAC unless otherwise specified.
The report shall not be reproduced except in full without the written consent of the laboratory.
Unless otherwise specified, the Environmental and Food Chemistry Testing except field parameters were performed by QC Inc. located at 1205 Industrial Blvd., Southampton, PA 18966; Pharmaceutical, Dairy and Food Microbiological tests were performed by QC Inc. located at 702 Electronic Drive, Horsham, PA 19044.
The reported results relate only to the samples.
All samples are collected as "grab" samples unless otherwise identified.
A result marked with "DRY" indicates that the result was calculated and reported on a dry weight basis.
The following personnel or their deputies have approved the results of the tests performed by QC Inc.: Nicki Smith (Environmental & Food Chemistry), Amanda Lukaszewski (Pharmaceutical), John Pcsolar (Dairy & Food Microbiology),
QCL Accreditations: Southampton Div: EPA ID PA00018; NELAP ID's: PA 09-00131, NJ PA166, NY 11223
State ID's: CT PH-0768, DE PA-018, MD 206, SC 89021001; FDA Reg. # : 2515238
E. Rutherford Div: State ID: NJ 02015; Vineland Div: State ID: NJ 06005; Reading Div: State ID: PA 06-03543

Regulatory authorities are assessing substantial fines for testing omissions. Please track your sample collections and results on a weekly, monthly, or quarterly basis to ensure compliance. QC's internet program 'LIVE ACCESS' will provide you with

Account No:AL0341, MARYLAND ENVIRONMENTAL SERVICE A
Project No: AL0341 BLK DECK WWTP, BLACK & DECKER WWTP

P.O. No:

Inv. No: MES_AL0341
PWSID No:

Sample ID Sample Description Samp. Date/Time/Temp Sampled by
L4570729-1 BLACK & DECKER FINAL 101 04/16/13 09:05am NA C Customer
Received Date/Time 04/26/13 00:00pm

Parameter	Method	Result	RLs	Test Date, Time, Analyst
-----------	--------	--------	-----	--------------------------

ENVIRONMENTAL MICROBIOLOGY

FECAL COLIFORM-MPN CEL(DELAWARE)	SM 9221E	4.5 MPN/100ml	MPN/100ml	04/16/13 01:46PM SUB
-------------------------------------	----------	---------------	-----------	----------------------

L4570729-1 :

Fecal coliform was analyzed by Chesapeake Environmental Lab, Inc. in Stevensville, MD.

Notes:

A result of "ND" indicates that the analyte tested was either not detected or the concentration was below the RLs.

Definitions: NEG=negative; POS=positive; COL=colonies; RLs=laboratory reporting limits; L/A=laboratory accident; TNTC= Too numerous to count; pres=presumptive

MCL= EPA recommended "maximum contaminant level", PLs = Customer-specific permit limits.

The test results meet all requirements of NELAC unless otherwise specified.

The report shall not be reproduced except in full without the written consent of the laboratory.

Unless otherwise specified, the Environmental and Food Chemistry Testing except field parameters were performed by QC Inc. located at 1205 Industrial Blvd., Southampton, PA 18966; Pharmaceutical, Dairy and Food Microbiological tests were performed by QC Inc. located at 702 Electronic Drive, Horsham, PA 19044.

The reported results relate only to the samples.

All samples are collected as "grab" samples unless otherwise identified.

A result marked with "DRY" indicates that the result was calculated and reported on a dry weight basis.

The following personnel or their deputies have approved the results of the tests performed by QC Inc.: Nicki

Smith (Environmental & Food Chemistry), Amanda Lukaszewski (Pharmaceutical), John Pcsolar (Dairy & Food Microbiology),

QCL Accreditations: Southampton Div: EPA ID PA00018; NELAP ID's: PA 09-00131, NJ PA166, NY 11223

State ID's: CT PH-0768, DE PA-018, MD 206, SC 89021001; FDA Reg. # : 2515238

E. Rutherford Div: State ID: NJ 02015; Vineland Div: State ID: NJ 06005; Reading Div: State ID: PA 06-03543

Regulatory authorities are assessing substantial fines for testing omissions. Please track your sample collections and results on a weekly, monthly, or quarterly basis to ensure compliance. QC's internet program 'LIVE ACCESS' will provide you with real-time access to collection dates and results. Please contact Customer Service for further information on acquiring LIVE ACCESS.



CHERYL GRIFFIN
 MARYLAND ENVIRONMENTAL SERVICE A
 259 NAJILES ROAD
 RE: BLACK & DECKER WWTP
 MILLERSVILLE, MD 21108

Order Number: L4576196
 Project Name: BLACK & DECKER WWTP
 Receive Date: 05-02-2013
 Client Code: MES_A
 Project Location: BLACK & DECKER WWTP

Sample ID Sample Description Samp. Date/Time/Temp Sampled by
 L4576196-1 BLACK & DECKER 001 05/02/13 09:09am NA C Customer
 Received Date/Time/Temp 05/02/13 05:00pm 4.0 C Iced (Y/N): Y

Parameter	Method	Result	RLs	Test Date, Time, Analyst
GENERAL CHEMISTRY				
BIOCHEMICAL OXYGEN DEMAND (DELAWARE)	SM 5210B	3.00 mg/l	2.00 mg/l	05/03/13 11:20AM SKJ
TOTAL SUSPENDED SOLIDS (DELAWARE)	SM 2540D	7.60 mg/l	4.00 mg/l	05/04/13 12:00AM MS3
HEXANE EXTR.-HEM (OIL+GREASE)	1664A HEM	ND mg/l	5.00 mg/l	05/07/13 05:30PM JAZ
GAS CHROMATOGRAPHY MASS SPECTROMETRY; VOLATILES				
1,1,1-TRICHLOROETHANE	EPA 8260B	ND ug/l	1.00 ug/l	05/08/13 12:38PM JFM
TRICHLOROETHENE	EPA 8260B	ND ug/l	1.00 ug/l	05/08/13 12:38PM JFM
TETRACHLOROETHENE	EPA 8260B	ND ug/l	1.00 ug/l	05/08/13 12:38PM JFM
DIBROMOFLUOROMETHANE	EPA 8260B	102 %		05/08/13 12:38PM JFM
TOLUENE-D8 (SURR)	EPA 8260B	100 %		05/08/13 12:38PM JFM
4-BROMOFLUOROBENZENE	EPA 8260B	109 %		05/08/13 12:38PM JFM

Notes:

A result of "ND" indicates that the analyte tested was either not detected or the concentration was below the RLs.
 Definitions: NEG=negative; POS=positive; COL=colonies; RLs=laboratory reporting limits; L/A=laboratory accident; TNTC= Too numerous to count; pres=presumptive
 MCL= EPA recommended "maximum contaminant level", PLs = Customer-specific permit limits.
 The test results meet all requirements of NELAC unless otherwise specified.
 The report shall not be reproduced except in full without the written consent of the laboratory.
 Unless otherwise specified, the Environmental and Food Chemistry Testing except field parameters were performed by QC Inc. located at 1205 Industrial Blvd., Southampton, PA 18966; Pharmaceutical, Dairy and Food Microbiological tests were performed by QC Inc. located at 702 Electronic Drive, Horsham, PA 19044.
 The reported results relate only to the samples.
 All samples are collected as "grab" samples unless otherwise identified.
 A result marked with "DRY" indicates that the result was calculated and reported on a dry weight basis.
 The following personnel or their deputies have approved the results of the tests performed by QC Inc.: Nicki Smith (Environmental & Food Chemistry), Amanda Lukaszewski (Pharmaceutical), John Pcsolar (Dairy & Food Microbiology),
 QCL Accreditations: Southampton Div: EPA ID PA00018; NELAP ID's: PA 09-00131, NJ PA166, NY 11223
 State ID's: CT PH-0768, DE PA-018, MD 206, SC 89021001; FDA Reg. # : 2515238
 E. Rutherford Div: State ID: NJ 02015; Vineland Div: State ID: NJ 06005; Reading Div: State ID: PA 06-03543

Regulatory authorities are assessing substantial fines for testing omissions. Please track your sample collections and results on a weekly, monthly, or quarterly basis to ensure compliance. QC's internet program 'LIVE ACCESS' will provide you with real-time access to collection dates and results. Please contact Customer Service for further information on acquiring LIVE ACCESS.

Serial Number: 2708832

QC Laboratories

Analytical Report

Printed 05/17/13 12:34

CHERYL GRIFFIN
MARYLAND ENVIRONMENTAL SERVICE A
259 NAJOLAS ROAD
RE: BLACK & DECKER WWTP
MILLERSVILLE, MD 21108

Order Number: L4601226
Project Name: BLACK & DECKER WWTP
Receive Date: 05-16-2013
Client Code: MES_A
Project Location: BLACK & DECKER WWTP

Sample ID	Sample Description	Samp. Date/Time/Temp		Sampled by
L4601226-1	BLACK & DECKER 101 Received Date/Time 05/16/13 01:00pm	05/07/13	00:00am	NA C Customer
Parameter	Method	Result	RLs	Test Date, Time, Analyst
ENVIRONMENTAL MICROBIOLOGY				
FECAL COLIFORM-MPN CEL(DELAWARE)	SM 9221E	7.8 MPN/100ml	MPN/100ml	05/07/13 01:35PM SUB

L4601226-1 :

Fecal coliform was analyzed by Chesapeake Environmental Lab, Inc. in Stevensville, MD.

Notes:

A result of "ND" indicates that the analyte tested was either not detected or the concentration was below the RLs.
Definitions: NEG=negative; POS=positive; COL=colonies; RLs=laboratory reporting limits; L/A=laboratory accident; TNTC= Too numerous to count; pres=presumptive
MCL= EPA recommended "maximum contaminant level", PLs = Customer-specific permit limits.
The test results meet all requirements of NELAC unless otherwise specified.
The report shall not be reproduced except in full without the written consent of the laboratory.
Unless otherwise specified, the Environmental and Food Chemistry Testing except field parameters were performed by QC Inc. located at 1205 Industrial Blvd., Southampton, PA 18966; Pharmaceutical, Dairy and Food Microbiological tests were performed by QC Inc. located at 702 Electronic Drive, Horsham, PA 19044.
The reported results relate only to the samples.
All samples are collected as "grab" samples unless otherwise identified.
A result marked with "DRY" indicates that the result was calculated and reported on a dry weight basis.
The following personnel or their deputies have approved the results of the tests performed by QC Inc.: Nicki Smith (Environmental & Food Chemistry), Amanda Lukaszewski (Pharmaceutical), John Pcsolar (Dairy & Food Microbiology),
QCL Accreditations: Southampton Div: EPA ID PA00018; NELAP ID's: PA 09-00131, NJ PA166, NY 11223
State ID's: CT PH-0768, DE PA-018, MD 206, SC 89021001; FDA Reg. # : 2515238
E. Rutherford Div: State ID: NJ 02015; Vineland Div: State ID: NJ 06005; Reading Div: State ID: PA 06-03543

Regulatory authorities are assessing substantial fines for testing omissions. Please track your sample collections and results on a weekly, monthly, or quarterly basis to ensure compliance. QC's internet program 'LIVE ACCESS' will provide you with real-time access to collection dates and results. Please contact Customer Service for further information on acquiring LIVE ACCESS.



Serial Number: 2725207

QC Laboratories

Analytical Report

CHERYL GRIFFIN
 MARYLAND ENVIRONMENTAL SERVICE A
 259 NAJOLAS ROAD
 RE: BLACK & DECKER WWTP
 MILLERSVILLE, MD 21108

Order Number: L4596569
 Project Name: BLACK & DECKER WWTP
 Receive Date: 06-18-2013
 Client Code: MES_A
 Project Location: BLACK & DECKER WWTP

Sample ID: L4596569-1 Sample Description: FINAL 001 GRAB Samp. Date/Time/Temp: 06/18/13 09:23am NA C Sampled by: Customer
 Received Date/Time/Temp: 06/18/13 05:00pm 2.9 C Iced (Y/N): Y

Parameter	Method	Result	RLs	Test Date, Time, Analyst
GENERAL CHEMISTRY				
BIOCHEMICAL OXYGEN DEMAND (DELAWARE)	SM 5210B	9.00 mg/l	2.00 mg/l	06/19/13 11:15AM SKJ
TOTAL SUSPENDED SOLIDS (DELAWARE)	SM 2540D	14.0 mg/l	5.00 mg/l	06/19/13 12:00AM MS3
HEXANE EXTR.-HEM (OIL+GREASE)	1664A HEM	ND mg/l	5.00 mg/l	06/19/13 04:45PM JAZ
GAS CHROMATOGRAPHY MASS SPECTROMETRY; VOLATILES				
1,1,1-TRICHLOROETHANE	EPA 624	ND ug/l	0.260 ug/l*	06/19/13 10:59PM JAD
TRICHLOROETHENE	EPA 624	ND ug/l	0.340 ug/l*	06/19/13 10:59PM JAD
TETRACHLOROETHENE	EPA 624	ND ug/l	0.310 ug/l*	06/19/13 10:59PM JAD
DIBROMOFLUOROMETHANE	EPA 624	122 %		06/19/13 10:59PM JAD
TOLUENE-D8 (SURR)	EPA 624	106 %		06/19/13 10:59PM JAD
4-BROMOFLUOROBENZENE	EPA 624	94 %		06/19/13 10:59PM JAD

Sample Comments:

L4596569-1 :
 For the BOD 5 test on this day, the nutrient blank was 0.70 mg/l, above the acceptance limit of 0.40 mg/l DO depletion. Batch control sample (GGA) recovery met the criteria of 168 to 228 mg/l.

General Notes:

A result of "ND" indicates that the analyte tested was either not detected or the concentration was below the RLs.
 Definitions: NEG=negative; POS=positive; COL=colonies; RLs=laboratory reporting limits; L/A=laboratory accident; TNTC= Too numerous to count; pres=presumptive
 MCL= EPA recommended "maximum contaminant level", PLs = Customer-specific permit limits.
 The test results meet all requirements of NELAC unless otherwise specified.
 The report shall not be reproduced except in full without the written consent of the laboratory.
 Unless otherwise specified, the Environmental and Food Chemistry Testing except field parameters were performed by QC Inc. located at 1205 Industrial Blvd., Southampton, PA 18966; Pharmaceutical, Dairy and Food Microbiological tests were performed by QC Inc. located at 702 Electronic Drive, Horsham, PA 19044.
 The reported results relate only to the samples.
 All samples are collected as "grab" samples unless otherwise identified.
 A result marked with "DRY" indicates that the result was calculated and reported on a dry weight basis.
 The following personnel or their deputies have approved the results of the tests performed by QC Inc.: Nicki Smith (Environmental & Food Chemistry), Amanda Lukaszewski (Pharmaceutical), John Pcsolar (Dairy & Food Microbiology).

Serial Number: 2859225

QC Laboratories

Analytical Report

Printed 06/24/13 13:44

CHERYL GRIFFIN
MARYLAND ENVIRONMENTAL SERVICE A
259 NAJOLAS ROAD
RE: BLACK & DECKER WWTP
MILLERSVILLE, MD 21108

Order Number: L4653722
Project Name: BLACK & DECKER WWTP
Receive Date: 06-21-2013
Client Code: MES_A
Project Location: BLACK & DECKER WWTP

Sample ID	Sample Description	Samp. Date/Time/Temp			Sampled by
L4653722-1	BLACK & DECKER 101 Received Date/Time 06/21/13 03:15pm	06/11/13 09:10am NA C			Customer
Parameter	Method	Result	RLs	Test Date, Time, Analyst	
ENVIRONMENTAL MICROBIOLOGY					
FECAL COLIFORM-MPN CEL(DELAWARE)	SM 9221E	70.0 MPN/100ml	MPN/100ml	06/11/13 01:40PM SUB	

Sample Comments:

L4653722-1 :

Fecal coliform was analyzed by Chesapeake Environmental Lab, Inc. in Stevensville, MD.

General Notes:

A result of "ND" indicates that the analyte tested was either not detected or the concentration was below the RLs.
Definitions: NEG=negative; POS=positive; COL=colonies; RLs=laboratory reporting limits; LJA=laboratory accident; TNTC= Too numerous to count; pres=presumptive
MCL= EPA recommended "maximum contaminant level", PLs = Customer-specific permit limits.
The test results meet all requirements of NELAC unless otherwise specified.
The report shall not be reproduced except in full without the written consent of the laboratory.
Unless otherwise specified, the Environmental and Food Chemistry Testing except field parameters were performed by QC Inc. located at 1205 Industrial Blvd., Southampton, PA 18966; Pharmaceutical, Dairy and Food Microbiological tests were performed by QC Inc. located at 702 Electronic Drive, Horsham, PA 19044.
The reported results relate only to the samples.
All samples are collected as "grab" samples unless otherwise identified.
A result marked with "DRY" indicates that the result was calculated and reported on a dry weight basis.
The following personnel or their deputies have approved the results of the tests performed by QC Inc.: Nicki Smith (Environmental & Food Chemistry), Amanda Lukaszewski (Pharmaceutical), John Pcsolar (Dairy & Food Microbiology),
QCL Accreditations: Southampton Div: EPA ID PA00018; NELAP ID's: PA 09-00131, NJ PA166, NY 11223
State ID's: CT PH-0768, DE PA-018, MD 206, SC 89021001; FDA Reg. # : 2515238
E. Rutherford Div: State ID: NJ 02015; Vineland Div: State ID: NJ 06005; Reading Div: State ID: PA 06-03543

Regulatory authorities are assessing substantial fines for testing omissions. Please track your sample collections and results on a weekly, monthly, or quarterly basis to ensure compliance. QC's internet program 'LIVE ACCESS' will provide you with real-time access to collection dates and results. Please contact Customer Service for further information on acquiring LIVE ACCESS.



Serial Number: 2833227

QC Laboratories

Analytical Report

Printed 05/09/13 12:48

CHERYL GRIFFIN
MARYLAND ENVIRONMENTAL SERVICE A
259 NAJOLE'S ROAD
RE: BLACK & DECKER WWTP
MILLERSVILLE, MD 21108

Order Number: L4576195
Project Name: BLACK & DECKER WWTP
Receive Date: 05-02-2013
Client Code: MES_A
Project Location: BLACK & DECKER WWTP

Sample ID: L4576195-1 Sample Description: BTR FINAL 201 VOC Samp. Date/Time/Temp: 05/02/13 09:29am NA C Sampled by: Customer
Received Date/Time/Temp: 05/02/13 05:00pm 4.0 C Iced (Y/N): Y

Parameter	Method	Result	RLs	Test Date, Time, Analyst
GAS CHROMATOGRAPHY MASS SPECTROMETRY; VOLATILES				
1,1,1-TRICHLOROETHANE	EPA 8260B	ND ug/l	1.00 ug/l	05/07/13 07:34PM JSH
TRICHLOROETHENE	EPA 8260B	ND ug/l	1.00 ug/l	05/07/13 07:34PM JSH
TETRACHLOROETHENE	EPA 8260B	ND ug/l	1.00 ug/l	05/07/13 07:34PM JSH
DIBROMOFLUOROMETHANE	EPA 8260B	100 %		05/07/13 07:34PM JSH
TOLUENE-D8 (SURR)	EPA 8260B	106 %		05/07/13 07:34PM JSH
4-BROMOFLUOROBENZENE	EPA 8260B	102 %		05/07/13 07:34PM JSH

Notes:

A result of "ND" indicates that the analyte tested was either not detected or the concentration was below the RLs.
Definitions: NEG=negative; POS=positive; COL=colonies; RLs=laboratory reporting limits; L/A=laboratory accident; TNTC= Too numerous to count; pres=presumptive
MCL= EPA recommended "maximum contaminant level", PLs = Customer-specific permit limits.
The test results meet all requirements of NELAC unless otherwise specified.
The report shall not be reproduced except in full without the written consent of the laboratory.
Unless otherwise specified, the Environmental and Food Chemistry Testing except field parameters were performed by QC Inc. located at 1205 Industrial Blvd., Southampton, PA 18966; Pharmaceutical, Dairy and Food Microbiological tests were performed by QC Inc. located at 702 Electronic Drive, Horsham, PA 19044.
The reported results relate only to the samples.
All samples are collected as "grab" samples unless otherwise identified.
A result marked with "DRY" indicates that the result was calculated and reported on a dry weight basis.
The following personnel or their deputies have approved the results of the tests performed by QC Inc.: Nicki Smith (Environmental & Food Chemistry), Amanda Lukaszewski (Pharmaceutical), John Pcsolar (Dairy & Food Microbiology),
QCL Accreditations: Southampton Div: EPA ID PA00018; NELAP ID's: PA 09-00131, NJ PA166, NY 11223
State ID's: CT PH-0768, DE PA-018, MD 206, SC 89021001; FDA Reg. # : 2515238
E. Rutherford Div: State ID: NJ 02015; Vineland Div: State ID: NJ 06005; Reading Div: State ID: PA 06-03543

Regulatory authorities are assessing substantial fines for testing omissions. Please track your sample collections and results on a weekly, monthly, or quarterly basis to ensure compliance. QC's internet program 'LIVE ACCESS' will provide you with real-time access to collection dates and results. Please contact Customer Service for further information on acquiring LIVE ACCESS.



Serial Number: 2705747

APPENDIX D
GROUNDWATER ANALYTICAL DATA PACKAGE (MAY 2013)

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

ANALYTICAL REPORT

TestAmerica Laboratories, Inc.
TestAmerica Chicago
2417 Bond Street
University Park, IL 60484
Tel: (708)534-5200

TestAmerica Job ID: 500-57291-1
Client Project/Site: Black and Decker

For:
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, Pennsylvania 19380

Attn: Mr. Tom Cornuet



Authorized for release by:
5/30/2013 12:02:16 PM

Richard Wright, Project Manager II
richard.wright@testamericainc.com

LINKS

Review your project
results through

Total Access

Have a Question?

**Ask
The
Expert**

Visit us at:

www.testamericainc.com

The test results in this report meet all 2003 NELAC and 2009 TNI requirements for accredited parameters, exceptions are noted in this report. This report may not be reproduced except in full, and with written approval from the laboratory. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

Table of Contents

Cover Page	1
Table of Contents	2
Case Narrative	3
Detection Summary	4
Method Summary	7
Sample Summary	8
Client Sample Results	9
Definitions	61
QC Association	62
Surrogate Summary	63
QC Sample Results	64
Chronicle	74
Certification Summary	79
Chain of Custody	80
Receipt Checklists	83



Case Narrative

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Job ID: 500-57291-1

Laboratory: TestAmerica Chicago

Narrative

Job Narrative
500-57291-1

Comments

No additional comments.

Receipt

The samples were received on 5/22/2013 10:10 AM; the samples arrived in good condition, properly preserved and, where required, on ice. The temperature of the cooler at receipt was 2.2° C.

Except:

Received 1 vial for sample 10 & 17 broken.

GC/MS VOA

No analytical or quality issues were noted.



Detection Summary

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-1A

Lab Sample ID: 500-57291-1

No Detections.

Client Sample ID: RFW-1B

Lab Sample ID: 500-57291-2

No Detections.

Client Sample ID: RFW-2A

Lab Sample ID: 500-57291-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	0.37	J	0.50	0.19	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-2B

Lab Sample ID: 500-57291-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	0.34	J	0.50	0.19	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-3B

Lab Sample ID: 500-57291-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
cis-1,2-Dichloroethene	1.5		1.0	0.12	ug/L	1		8260B	Total/NA
Trichloroethene	0.28	J	0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	0.62	J	1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-4A

Lab Sample ID: 500-57291-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	23		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	17		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-4A DUP

Lab Sample ID: 500-57291-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
cis-1,2-Dichloroethene	0.53	J	1.0	0.12	ug/L	1		8260B	Total/NA
Trichloroethene	23		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	16		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-4B

Lab Sample ID: 500-57291-8

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
cis-1,2-Dichloroethene	2.7		1.0	0.12	ug/L	1		8260B	Total/NA
Chloroform	1.1		1.0	0.20	ug/L	1		8260B	Total/NA
Trichloroethene	43		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	67		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-6

Lab Sample ID: 500-57291-9

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	1.7		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	2.0		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-7

Lab Sample ID: 500-57291-10

This Detection Summary does not include radiochemical test results.

TestAmerica Chicago

Detection Summary

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-7 (Continued)

Lab Sample ID: 500-57291-10

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	1.1		0.50	0.19	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-9

Lab Sample ID: 500-57291-11

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1-Dichloroethene	0.51	J	1.0	0.31	ug/L			8260B	Total/NA
cis-1,2-Dichloroethene	11		1.0	0.12	ug/L	1		8260B	Total/NA
1,1,1-Trichloroethane	0.58	J	1.0	0.20	ug/L	1		8260B	Total/NA
Trichloroethene	7.6		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	4.0		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-11B

Lab Sample ID: 500-57291-12

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	2.4		0.50	0.19	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-12B

Lab Sample ID: 500-57291-13

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
cis-1,2-Dichloroethene	1.6		1.0	0.12	ug/L	1		8260B	Total/NA
Trichloroethene	71		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	5.9		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-13

Lab Sample ID: 500-57291-14

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	2.0		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	12		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: RFW-17

Lab Sample ID: 500-57291-15

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Benzene	0.81		0.50	0.074	ug/L	1		8260B	Total/NA

Client Sample ID: Trip Blank

Lab Sample ID: 500-57291-16

No Detections.

Client Sample ID: EW-2

Lab Sample ID: 500-57291-17

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
cis-1,2-Dichloroethene	3.5		1.0	0.12	ug/L	1		8260B	Total/NA
Trichloroethene	200		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	48		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: EW-3

Lab Sample ID: 500-57291-18

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
cis-1,2-Dichloroethene	1.8		1.0	0.12	ug/L	1		8260B	Total/NA
Trichloroethene	40		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	1.3		1.0	0.17	ug/L	1		8260B	Total/NA

This Detection Summary does not include radiochemical test results.

TestAmerica Chicago

Detection Summary

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-4

Lab Sample ID: 500-57291-19

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Tetrachloroethene	8.7		1.0	0.17	ug/L	1		8260B	Total/NA
Trichloroethene - DL	430		5.0	1.9	ug/L	10		8260B	Total/NA

Client Sample ID: EW-5

Lab Sample ID: 500-57291-20

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	77		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	2.4		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: EW-6

Lab Sample ID: 500-57291-21

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	5.7		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	10		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: EW-7

Lab Sample ID: 500-57291-22

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
cis-1,2-Dichloroethene	3.0		1.0	0.12	ug/L	1		8260B	Total/NA
Trichloroethene	2.4		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	5.5		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: EW-8

Lab Sample ID: 500-57291-23

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
1,1-Dichloroethane	0.57	J	1.0	0.19	ug/L	1		8260B	Total/NA
cis-1,2-Dichloroethene	21		1.0	0.12	ug/L	1		8260B	Total/NA
Trichloroethene	7.1		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	65		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: EW-9

Lab Sample ID: 500-57291-24

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	0.52		0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	88		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: EW-9 DUP

Lab Sample ID: 500-57291-25

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Trichloroethene	0.44	J	0.50	0.19	ug/L	1		8260B	Total/NA
Tetrachloroethene	87		1.0	0.17	ug/L	1		8260B	Total/NA

Client Sample ID: EW-10

Lab Sample ID: 500-57291-26

No Detections.

This Detection Summary does not include radiochemical test results.

TestAmerica Chicago

Method Summary

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Method	Method Description	Protocol	Laboratory
8260B	VOC	SW846	TAL CHI

Protocol References:

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

Laboratory References:

TAL CHI = TestAmerica Chicago, 2417 Bond Street, University Park, IL 60484, TEL (708)534-5200



Sample Summary

Client: Weston Solutions, Inc.
 Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
500-57291-1	RFW-1A	Water	05/20/13 09:10	05/22/13 10:10
500-57291-2	RFW-1B	Water	05/20/13 18:00	05/22/13 10:10
500-57291-3	RFW-2A	Water	05/20/13 08:00	05/22/13 10:10
500-57291-4	RFW-2B	Water	05/20/13 08:20	05/22/13 10:10
500-57291-5	RFW-3B	Water	05/20/13 14:45	05/22/13 10:10
500-57291-6	RFW-4A	Water	05/21/13 09:15	05/22/13 10:10
500-57291-7	RFW-4A DUP	Water	05/21/13 09:15	05/22/13 10:10
500-57291-8	RFW-4B	Water	05/21/13 08:45	05/22/13 10:10
500-57291-9	RFW-6	Water	05/20/13 17:40	05/22/13 10:10
500-57291-10	RFW-7	Water	05/20/13 11:05	05/22/13 10:10
500-57291-11	RFW-9	Water	05/20/13 16:45	05/22/13 10:10
500-57291-12	RFW-11B	Water	05/20/13 17:35	05/22/13 10:10
500-57291-13	RFW-12B	Water	05/21/13 11:10	05/22/13 10:10
500-57291-14	RFW-13	Water	05/20/13 16:05	05/22/13 10:10
500-57291-15	RFW-17	Water	05/20/13 12:00	05/22/13 10:10
500-57291-16	Trip Blank	Water	05/20/13 06:00	05/22/13 10:10
500-57291-17	EW-2	Water	05/21/13 12:00	05/22/13 10:10
500-57291-18	EW-3	Water	05/21/13 11:15	05/22/13 10:10
500-57291-19	EW-4	Water	05/21/13 11:50	05/22/13 10:10
500-57291-20	EW-5	Water	05/21/13 11:00	05/22/13 10:10
500-57291-21	EW-6	Water	05/21/13 09:15	05/22/13 10:10
500-57291-22	EW-7	Water	05/21/13 09:05	05/22/13 10:10
500-57291-23	EW-8	Water	05/21/13 09:00	05/22/13 10:10
500-57291-24	EW-9	Water	05/21/13 08:50	05/22/13 10:10
500-57291-25	EW-9 DUP	Water	05/21/13 08:50	05/22/13 10:10
500-57291-26	EW-10	Water	05/21/13 08:40	05/22/13 10:10



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-1A

Lab Sample ID: 500-57291-1

Date Collected: 05/20/13 09:10

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 10:40	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 10:40	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 10:40	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 10:40	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 10:40	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 10:40	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 10:40	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 10:40	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 10:40	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 10:40	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 10:40	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 10:40	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 10:40	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 10:40	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 10:40	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 10:40	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 10:40	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 10:40	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 10:40	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 10:40	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 10:40	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 10:40	1
Trichloroethene	<0.50		0.50	0.19	ug/L			05/24/13 10:40	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 10:40	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 10:40	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 10:40	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 10:40	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 10:40	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 10:40	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 10:40	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 10:40	1
Tetrachloroethene	<1.0		1.0	0.17	ug/L			05/24/13 10:40	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 10:40	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 10:40	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 10:40	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 10:40	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 10:40	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 10:40	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 10:40	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 10:40	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 10:40	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 10:40	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 10:40	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 10:40	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 10:40	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 10:40	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 10:40	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 10:40	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 10:40	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-1A

Lab Sample ID: 500-57291-1

Date Collected: 05/20/13 09:10

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 10:40	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 10:40	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 10:40	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 10:40	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 10:40	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 10:40	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 10:40	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 10:40	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 10:40	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 10:40	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 10:40	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 10:40	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 10:40	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 10:40	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 10:40	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	83		75 - 125					05/24/13 10:40	1
Toluene-d8 (Surr)	98		75 - 120					05/24/13 10:40	1
4-Bromofluorobenzene (Surr)	102		75 - 120					05/24/13 10:40	1
Dibromofluoromethane	87		75 - 120					05/24/13 10:40	1

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-1B

Lab Sample ID: 500-57291-2

Date Collected: 05/20/13 18:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 11:05	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 11:05	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 11:05	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 11:05	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 11:05	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 11:05	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 11:05	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 11:05	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 11:05	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 11:05	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 11:05	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 11:05	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 11:05	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 11:05	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 11:05	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 11:05	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 11:05	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 11:05	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 11:05	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 11:05	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 11:05	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 11:05	1
Trichloroethene	<0.50		0.50	0.19	ug/L			05/24/13 11:05	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 11:05	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 11:05	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 11:05	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 11:05	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 11:05	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 11:05	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 11:05	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 11:05	1
Tetrachloroethene	<1.0		1.0	0.17	ug/L			05/24/13 11:05	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 11:05	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 11:05	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 11:05	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 11:05	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:05	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 11:05	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 11:05	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 11:05	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 11:05	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 11:05	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 11:05	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:05	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 11:05	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 11:05	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 11:05	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 11:05	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 11:05	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-1B

Lab Sample ID: 500-57291-2

Date Collected: 05/20/13 18:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 11:05	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 11:05	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:05	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:05	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 11:05	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 11:05	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 11:05	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 11:05	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 11:05	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 11:05	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 11:05	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 11:05	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 11:05	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 11:05	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 11:05	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	82		75 - 125		05/24/13 11:05	1
Toluene-d8 (Surr)	100		75 - 120		05/24/13 11:05	1
4-Bromofluorobenzene (Surr)	104		75 - 120		05/24/13 11:05	1
Dibromofluoromethane	87		75 - 120		05/24/13 11:05	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-2A

Lab Sample ID: 500-57291-3

Date Collected: 05/20/13 08:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 11:29	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 11:29	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 11:29	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 11:29	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 11:29	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 11:29	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 11:29	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 11:29	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 11:29	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 11:29	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 11:29	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 11:29	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 11:29	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 11:29	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 11:29	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 11:29	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 11:29	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 11:29	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 11:29	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 11:29	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 11:29	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 11:29	1
Trichloroethene	0.37	J	0.50	0.19	ug/L			05/24/13 11:29	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 11:29	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 11:29	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 11:29	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 11:29	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 11:29	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 11:29	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 11:29	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 11:29	1
Tetrachloroethene	<1.0		1.0	0.17	ug/L			05/24/13 11:29	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 11:29	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 11:29	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 11:29	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 11:29	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:29	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 11:29	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 11:29	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 11:29	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 11:29	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 11:29	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 11:29	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:29	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 11:29	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 11:29	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 11:29	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 11:29	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 11:29	1

TestAmerica Chicago



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-2A

Lab Sample ID: 500-57291-3

Date Collected: 05/20/13 08:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 11:29	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 11:29	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:29	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:29	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 11:29	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 11:29	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 11:29	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 11:29	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 11:29	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 11:29	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 11:29	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 11:29	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 11:29	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 11:29	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 11:29	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	83		75 - 125		05/24/13 11:29	1
Toluene-d8 (Surr)	98		75 - 120		05/24/13 11:29	1
4-Bromofluorobenzene (Surr)	103		75 - 120		05/24/13 11:29	1
Dibromofluoromethane	86		75 - 120		05/24/13 11:29	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-2B

Lab Sample ID: 500-57291-4

Date Collected: 05/20/13 08:20

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 11:54	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 11:54	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 11:54	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 11:54	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 11:54	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 11:54	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 11:54	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 11:54	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 11:54	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 11:54	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 11:54	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 11:54	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 11:54	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 11:54	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 11:54	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 11:54	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 11:54	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 11:54	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 11:54	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 11:54	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 11:54	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 11:54	1
Trichloroethene	0.34	J	0.50	0.19	ug/L			05/24/13 11:54	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 11:54	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 11:54	1
Dibromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 11:54	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 11:54	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 11:54	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 11:54	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 11:54	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 11:54	1
Tetrachloroethene	<1.0		1.0	0.17	ug/L			05/24/13 11:54	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 11:54	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 11:54	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 11:54	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 11:54	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:54	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 11:54	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 11:54	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 11:54	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 11:54	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 11:54	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 11:54	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:54	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 11:54	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 11:54	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 11:54	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 11:54	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 11:54	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-2B

Lab Sample ID: 500-57291-4

Date Collected: 05/20/13 08:20

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 11:54	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 11:54	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:54	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 11:54	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 11:54	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 11:54	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 11:54	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 11:54	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 11:54	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 11:54	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 11:54	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 11:54	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 11:54	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 11:54	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 11:54	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	84		75 - 125		05/24/13 11:54	1
Toluene-d8 (Surr)	101		75 - 120		05/24/13 11:54	1
4-Bromofluorobenzene (Surr)	104		75 - 120		05/24/13 11:54	1
Dibromofluoromethane	85		75 - 120		05/24/13 11:54	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-3B

Lab Sample ID: 500-57291-5

Date Collected: 05/20/13 14:45

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 12:18	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 12:18	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 12:18	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 12:18	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 12:18	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 12:18	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 12:18	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 12:18	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 12:18	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 12:18	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 12:18	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 12:18	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 12:18	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 12:18	1
cis-1,2-Dichloroethene	1.5		1.0	0.12	ug/L			05/24/13 12:18	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 12:18	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 12:18	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 12:18	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 12:18	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 12:18	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 12:18	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 12:18	1
Trichloroethene	0.28	J	0.50	0.19	ug/L			05/24/13 12:18	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 12:18	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 12:18	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 12:18	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 12:18	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 12:18	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 12:18	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 12:18	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 12:18	1
Tetrachloroethene	0.62	J	1.0	0.17	ug/L			05/24/13 12:18	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 12:18	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 12:18	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 12:18	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 12:18	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 12:18	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 12:18	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 12:18	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 12:18	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 12:18	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 12:18	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 12:18	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 12:18	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 12:18	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 12:18	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 12:18	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 12:18	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 12:18	1

TestAmerica Chicago



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-3B

Lab Sample ID: 500-57291-5

Date Collected: 05/20/13 14:45

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 12:18	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 12:18	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 12:18	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 12:18	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 12:18	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 12:18	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 12:18	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 12:18	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 12:18	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 12:18	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 12:18	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 12:18	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 12:18	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 12:18	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 12:18	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	84		75 - 125					05/24/13 12:18	1
Toluene-d8 (Surr)	96		75 - 120					05/24/13 12:18	1
4-Bromofluorobenzene (Surr)	105		75 - 120					05/24/13 12:18	1
Dibromofluoromethane	87		75 - 120					05/24/13 12:18	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-4A

Lab Sample ID: 500-57291-6

Date Collected: 05/21/13 09:15

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC									
Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 12:43	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 12:43	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 12:43	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 12:43	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 12:43	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 12:43	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 12:43	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 12:43	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 12:43	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 12:43	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 12:43	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 12:43	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 12:43	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 12:43	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 12:43	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 12:43	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 12:43	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 12:43	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 12:43	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 12:43	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 12:43	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 12:43	1
Trichloroethene	23		0.50	0.19	ug/L			05/24/13 12:43	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 12:43	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 12:43	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 12:43	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 12:43	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 12:43	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 12:43	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 12:43	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 12:43	1
Tetrachloroethene	17		1.0	0.17	ug/L			05/24/13 12:43	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 12:43	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 12:43	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 12:43	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 12:43	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 12:43	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 12:43	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 12:43	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 12:43	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 12:43	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 12:43	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 12:43	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 12:43	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 12:43	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 12:43	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 12:43	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 12:43	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 12:43	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-4A

Lab Sample ID: 500-57291-6

Date Collected: 05/21/13 09:15

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 12:43	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 12:43	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 12:43	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 12:43	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 12:43	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 12:43	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 12:43	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 12:43	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 12:43	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 12:43	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 12:43	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 12:43	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 12:43	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 12:43	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 12:43	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	85		75 - 125		05/24/13 12:43	1
Toluene-d8 (Surr)	97		75 - 120		05/24/13 12:43	1
4-Bromofluorobenzene (Surr)	102		75 - 120		05/24/13 12:43	1
Dibromofluoromethane	90		75 - 120		05/24/13 12:43	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-4A DUP

Lab Sample ID: 500-57291-7

Date Collected: 05/21/13 09:15

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 13:07	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 13:07	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 13:07	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 13:07	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 13:07	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 13:07	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 13:07	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 13:07	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 13:07	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 13:07	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 13:07	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 13:07	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 13:07	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 13:07	1
cis-1,2-Dichloroethene	0.53	J	1.0	0.12	ug/L			05/24/13 13:07	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 13:07	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 13:07	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 13:07	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 13:07	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 13:07	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 13:07	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 13:07	1
Trichloroethene	23		0.50	0.19	ug/L			05/24/13 13:07	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 13:07	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 13:07	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 13:07	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 13:07	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 13:07	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 13:07	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 13:07	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 13:07	1
Tetrachloroethene	16		1.0	0.17	ug/L			05/24/13 13:07	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 13:07	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 13:07	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 13:07	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 13:07	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:07	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 13:07	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 13:07	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 13:07	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 13:07	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 13:07	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 13:07	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:07	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 13:07	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 13:07	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 13:07	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 13:07	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 13:07	1

TestAmerica Chicago



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-4A DUP

Lab Sample ID: 500-57291-7

Date Collected: 05/21/13 09:15

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 13:07	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 13:07	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:07	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:07	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 13:07	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 13:07	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 13:07	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 13:07	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 13:07	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 13:07	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 13:07	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 13:07	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 13:07	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 13:07	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 13:07	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	84		75 - 125					05/24/13 13:07	1
Toluene-d8 (Surr)	98		75 - 120					05/24/13 13:07	1
4-Bromofluorobenzene (Surr)	105		75 - 120					05/24/13 13:07	1
Dibromofluoromethane	83		75 - 120					05/24/13 13:07	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-4B

Lab Sample ID: 500-57291-8

Date Collected: 05/21/13 08:45

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 13:32	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 13:32	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 13:32	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 13:32	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 13:32	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 13:32	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 13:32	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 13:32	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 13:32	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 13:32	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 13:32	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 13:32	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 13:32	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 13:32	1
cis-1,2-Dichloroethene	2.7		1.0	0.12	ug/L			05/24/13 13:32	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 13:32	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 13:32	1
Chloroform	1.1		1.0	0.20	ug/L			05/24/13 13:32	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 13:32	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 13:32	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 13:32	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 13:32	1
Trichloroethene	43		0.50	0.19	ug/L			05/24/13 13:32	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 13:32	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 13:32	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 13:32	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 13:32	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 13:32	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 13:32	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 13:32	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 13:32	1
Tetrachloroethene	67		1.0	0.17	ug/L			05/24/13 13:32	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 13:32	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 13:32	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 13:32	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 13:32	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:32	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 13:32	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 13:32	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 13:32	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 13:32	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 13:32	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 13:32	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:32	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 13:32	1
1,1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 13:32	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 13:32	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 13:32	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 13:32	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-4B

Lab Sample ID: 500-57291-8

Date Collected: 05/21/13 08:45

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 13:32	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 13:32	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:32	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:32	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 13:32	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 13:32	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 13:32	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 13:32	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 13:32	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 13:32	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 13:32	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 13:32	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 13:32	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 13:32	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 13:32	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	85		75 - 125		05/24/13 13:32	1
Toluene-d8 (Surr)	95		75 - 120		05/24/13 13:32	1
4-Bromofluorobenzene (Surr)	107		75 - 120		05/24/13 13:32	1
Dibromofluoromethane	86		75 - 120		05/24/13 13:32	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-6

Lab Sample ID: 500-57291-9

Date Collected: 05/20/13 17:40

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 13:56	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 13:56	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 13:56	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 13:56	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 13:56	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 13:56	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 13:56	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 13:56	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 13:56	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 13:56	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 13:56	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 13:56	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 13:56	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 13:56	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 13:56	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 13:56	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 13:56	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 13:56	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 13:56	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 13:56	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 13:56	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 13:56	1
Trichloroethene	1.7		0.50	0.19	ug/L			05/24/13 13:56	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 13:56	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 13:56	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 13:56	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 13:56	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 13:56	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 13:56	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 13:56	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 13:56	1
Tetrachloroethene	2.0		1.0	0.17	ug/L			05/24/13 13:56	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 13:56	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 13:56	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 13:56	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 13:56	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:56	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 13:56	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 13:56	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 13:56	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 13:56	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 13:56	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 13:56	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:56	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 13:56	1
1,1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 13:56	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 13:56	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 13:56	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 13:56	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-6

Lab Sample ID: 500-57291-9

Date Collected: 05/20/13 17:40

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 13:56	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 13:56	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:56	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 13:56	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 13:56	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 13:56	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 13:56	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 13:56	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 13:56	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 13:56	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 13:56	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 13:56	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 13:56	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 13:56	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 13:56	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	87		75 - 125		05/24/13 13:56	1
Toluene-d8 (Surr)	95		75 - 120		05/24/13 13:56	1
4-Bromofluorobenzene (Surr)	103		75 - 120		05/24/13 13:56	1
Dibromofluoromethane	86		75 - 120		05/24/13 13:56	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-7

Lab Sample ID: 500-57291-10

Date Collected: 05/20/13 11:05

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 14:21	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 14:21	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 14:21	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 14:21	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 14:21	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 14:21	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 14:21	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 14:21	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 14:21	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 14:21	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 14:21	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 14:21	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 14:21	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 14:21	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 14:21	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 14:21	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 14:21	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 14:21	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 14:21	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 14:21	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 14:21	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 14:21	1
Trichloroethene	1.1		0.50	0.19	ug/L			05/24/13 14:21	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 14:21	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 14:21	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 14:21	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 14:21	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 14:21	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 14:21	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 14:21	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 14:21	1
Tetrachloroethene	<1.0		1.0	0.17	ug/L			05/24/13 14:21	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 14:21	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 14:21	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 14:21	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 14:21	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 14:21	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 14:21	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 14:21	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 14:21	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 14:21	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 14:21	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 14:21	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 14:21	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 14:21	1
1,1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 14:21	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 14:21	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 14:21	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 14:21	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-7
Date Collected: 05/20/13 11:05
Date Received: 05/22/13 10:10

Lab Sample ID: 500-57291-10
Matrix: Water

Method: 8260B - VOC (Continued)										
Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac	
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 14:21	1	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 14:21	1	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 14:21	1	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 14:21	1	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 14:21	1	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 14:21	1	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 14:21	1	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 14:21	1	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 14:21	1	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 14:21	1	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 14:21	1	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 14:21	1	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 14:21	1	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 14:21	1	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 14:21	1	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac	
1,2-Dichloroethane-d4 (Surr)	88		75 - 125					05/24/13 14:21	1	1
Toluene-d8 (Surr)	97		75 - 120					05/24/13 14:21	1	1
4-Bromofluorobenzene (Surr)	103		75 - 120					05/24/13 14:21	1	1
Dibromofluoromethane	85		75 - 120					05/24/13 14:21	1	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-9

Lab Sample ID: 500-57291-11

Date Collected: 05/20/13 16:45

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 14:45	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 14:45	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 14:45	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 14:45	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 14:45	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 14:45	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 14:45	1
1,1-Dichloroethene	0.51	J	1.0	0.31	ug/L			05/24/13 14:45	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 14:45	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 14:45	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 14:45	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 14:45	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 14:45	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 14:45	1
cis-1,2-Dichloroethene	11		1.0	0.12	ug/L			05/24/13 14:45	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 14:45	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 14:45	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 14:45	1
1,1,1-Trichloroethane	0.58	J	1.0	0.20	ug/L			05/24/13 14:45	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 14:45	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 14:45	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 14:45	1
Trichloroethene	7.6		0.50	0.19	ug/L			05/24/13 14:45	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 14:45	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 14:45	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 14:45	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 14:45	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 14:45	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 14:45	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 14:45	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 14:45	1
Tetrachloroethene	4.0		1.0	0.17	ug/L			05/24/13 14:45	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 14:45	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 14:45	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 14:45	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 14:45	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 14:45	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 14:45	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 14:45	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 14:45	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 14:45	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 14:45	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 14:45	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 14:45	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 14:45	1
1,1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 14:45	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 14:45	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 14:45	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 14:45	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-9

Lab Sample ID: 500-57291-11

Date Collected: 05/20/13 16:45

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 14:45	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 14:45	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 14:45	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 14:45	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 14:45	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 14:45	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 14:45	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 14:45	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 14:45	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 14:45	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 14:45	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 14:45	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 14:45	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 14:45	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 14:45	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	86		75 - 125					05/24/13 14:45	1
Toluene-d8 (Surr)	99		75 - 120					05/24/13 14:45	1
4-Bromofluorobenzene (Surr)	100		75 - 120					05/24/13 14:45	1
Dibromofluoromethane	87		75 - 120					05/24/13 14:45	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-11B

Lab Sample ID: 500-57291-12

Date Collected: 05/20/13 17:35

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 15:10	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 15:10	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 15:10	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 15:10	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 15:10	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 15:10	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 15:10	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 15:10	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 15:10	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 15:10	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 15:10	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 15:10	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 15:10	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 15:10	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 15:10	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 15:10	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 15:10	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 15:10	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 15:10	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 15:10	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 15:10	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 15:10	1
Trichloroethene	2.4		0.50	0.19	ug/L			05/24/13 15:10	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 15:10	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 15:10	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 15:10	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 15:10	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 15:10	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 15:10	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 15:10	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 15:10	1
Tetrachloroethene	<1.0		1.0	0.17	ug/L			05/24/13 15:10	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 15:10	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 15:10	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 15:10	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 15:10	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:10	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 15:10	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 15:10	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 15:10	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 15:10	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 15:10	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 15:10	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:10	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 15:10	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 15:10	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 15:10	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 15:10	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 15:10	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-11B

Lab Sample ID: 500-57291-12

Date Collected: 05/20/13 17:35

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 15:10	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 15:10	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:10	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:10	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 15:10	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 15:10	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 15:10	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 15:10	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 15:10	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 15:10	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 15:10	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 15:10	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 15:10	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 15:10	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 15:10	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	83		75 - 125		05/24/13 15:10	1
Toluene-d8 (Surr)	98		75 - 120		05/24/13 15:10	1
4-Bromofluorobenzene (Surr)	102		75 - 120		05/24/13 15:10	1
Dibromofluoromethane	89		75 - 120		05/24/13 15:10	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-12B

Lab Sample ID: 500-57291-13

Date Collected: 05/21/13 11:10

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 15:34	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 15:34	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 15:34	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 15:34	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 15:34	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 15:34	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 15:34	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 15:34	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 15:34	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 15:34	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 15:34	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 15:34	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 15:34	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 15:34	1
cis-1,2-Dichloroethene	1.6		1.0	0.12	ug/L			05/24/13 15:34	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 15:34	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 15:34	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 15:34	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 15:34	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 15:34	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 15:34	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 15:34	1
Trichloroethene	71		0.50	0.19	ug/L			05/24/13 15:34	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 15:34	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 15:34	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 15:34	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 15:34	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 15:34	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 15:34	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 15:34	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 15:34	1
Tetrachloroethene	5.9		1.0	0.17	ug/L			05/24/13 15:34	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 15:34	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 15:34	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 15:34	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 15:34	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:34	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 15:34	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 15:34	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 15:34	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 15:34	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 15:34	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 15:34	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:34	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 15:34	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 15:34	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 15:34	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 15:34	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 15:34	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-12B

Lab Sample ID: 500-57291-13

Date Collected: 05/21/13 11:10

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 15:34	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 15:34	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:34	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:34	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 15:34	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 15:34	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 15:34	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 15:34	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 15:34	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 15:34	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 15:34	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 15:34	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 15:34	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 15:34	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 15:34	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	84		75 - 125					05/24/13 15:34	1
Toluene-d8 (Surr)	97		75 - 120					05/24/13 15:34	1
4-Bromofluorobenzene (Surr)	98		75 - 120					05/24/13 15:34	1
Dibromofluoromethane	90		75 - 120					05/24/13 15:34	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-13

Lab Sample ID: 500-57291-14

Date Collected: 05/20/13 16:05

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 15:59	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 15:59	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 15:59	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 15:59	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 15:59	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 15:59	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 15:59	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 15:59	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 15:59	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 15:59	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 15:59	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 15:59	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 15:59	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 15:59	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 15:59	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 15:59	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 15:59	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 15:59	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 15:59	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 15:59	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 15:59	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 15:59	1
Trichloroethene	2.0		0.50	0.19	ug/L			05/24/13 15:59	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 15:59	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 15:59	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 15:59	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 15:59	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 15:59	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 15:59	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 15:59	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 15:59	1
Tetrachloroethene	12		1.0	0.17	ug/L			05/24/13 15:59	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 15:59	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 15:59	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 15:59	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 15:59	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:59	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 15:59	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 15:59	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 15:59	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 15:59	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 15:59	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 15:59	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:59	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 15:59	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 15:59	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 15:59	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 15:59	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 15:59	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-13

Lab Sample ID: 500-57291-14

Date Collected: 05/20/13 16:05

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)										
Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac	
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 15:59	1	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 15:59	1	2
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:59	1	3
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 15:59	1	4
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 15:59	1	5
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 15:59	1	6
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 15:59	1	7
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 15:59	1	8
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 15:59	1	9
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 15:59	1	10
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 15:59	1	11
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 15:59	1	12
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 15:59	1	13
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 15:59	1	14
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 15:59	1	15
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac	
1,2-Dichloroethane-d4 (Surr)	84		75 - 125					05/24/13 15:59	1	13
Toluene-d8 (Surr)	98		75 - 120					05/24/13 15:59	1	14
4-Bromofluorobenzene (Surr)	98		75 - 120					05/24/13 15:59	1	14
Dibromofluoromethane	91		75 - 120					05/24/13 15:59	1	15

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-17

Lab Sample ID: 500-57291-15

Date Collected: 05/20/13 12:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	0.81		0.50	0.074	ug/L			05/24/13 16:24	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 16:24	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 16:24	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 16:24	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 16:24	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 16:24	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 16:24	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 16:24	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 16:24	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 16:24	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 16:24	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 16:24	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 16:24	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 16:24	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 16:24	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 16:24	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 16:24	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 16:24	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 16:24	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 16:24	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 16:24	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 16:24	1
Trichloroethene	<0.50		0.50	0.19	ug/L			05/24/13 16:24	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 16:24	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 16:24	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 16:24	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 16:24	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 16:24	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 16:24	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 16:24	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 16:24	1
Tetrachloroethene	<1.0		1.0	0.17	ug/L			05/24/13 16:24	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 16:24	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 16:24	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 16:24	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 16:24	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 16:24	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 16:24	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 16:24	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 16:24	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 16:24	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 16:24	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 16:24	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 16:24	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 16:24	1
1,1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 16:24	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 16:24	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 16:24	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 16:24	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-17

Lab Sample ID: 500-57291-15

Date Collected: 05/20/13 12:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 16:24	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 16:24	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 16:24	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 16:24	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 16:24	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 16:24	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 16:24	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 16:24	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 16:24	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 16:24	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 16:24	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 16:24	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 16:24	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 16:24	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 16:24	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	85		75 - 125					05/24/13 16:24	1
Toluene-d8 (Surr)	99		75 - 120					05/24/13 16:24	1
4-Bromofluorobenzene (Surr)	102		75 - 120					05/24/13 16:24	1
Dibromofluoromethane	89		75 - 120					05/24/13 16:24	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: Trip Blank

Lab Sample ID: 500-57291-16

Date Collected: 05/20/13 06:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 16:48	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 16:48	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 16:48	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 16:48	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 16:48	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 16:48	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 16:48	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 16:48	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 16:48	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 16:48	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 16:48	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 16:48	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 16:48	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 16:48	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 16:48	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 16:48	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 16:48	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 16:48	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 16:48	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 16:48	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 16:48	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 16:48	1
Trichloroethene	<0.50		0.50	0.19	ug/L			05/24/13 16:48	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 16:48	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 16:48	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 16:48	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 16:48	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 16:48	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 16:48	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 16:48	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 16:48	1
Tetrachloroethene	<1.0		1.0	0.17	ug/L			05/24/13 16:48	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 16:48	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 16:48	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 16:48	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 16:48	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 16:48	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 16:48	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 16:48	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 16:48	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 16:48	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 16:48	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 16:48	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 16:48	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 16:48	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 16:48	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 16:48	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 16:48	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 16:48	1

TestAmerica Chicago



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: Trip Blank

Lab Sample ID: 500-57291-16

Date Collected: 05/20/13 06:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 16:48	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 16:48	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 16:48	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 16:48	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 16:48	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 16:48	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 16:48	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 16:48	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 16:48	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 16:48	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 16:48	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 16:48	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 16:48	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 16:48	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 16:48	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	87		75 - 125		05/24/13 16:48	1
Toluene-d8 (Surr)	100		75 - 120		05/24/13 16:48	1
4-Bromofluorobenzene (Surr)	103		75 - 120		05/24/13 16:48	1
Dibromofluoromethane	88		75 - 120		05/24/13 16:48	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-2
Date Collected: 05/21/13 12:00
Date Received: 05/22/13 10:10

Lab Sample ID: 500-57291-17
Matrix: Water

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 17:13	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 17:13	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 17:13	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 17:13	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 17:13	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 17:13	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 17:13	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 17:13	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 17:13	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 17:13	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 17:13	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 17:13	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 17:13	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 17:13	1
cis-1,2-Dichloroethene	3.5		1.0	0.12	ug/L			05/24/13 17:13	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 17:13	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 17:13	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 17:13	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 17:13	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 17:13	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 17:13	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 17:13	1
Trichloroethene	200		0.50	0.19	ug/L			05/24/13 17:13	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 17:13	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 17:13	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 17:13	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 17:13	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 17:13	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 17:13	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 17:13	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 17:13	1
Tetrachloroethene	48		1.0	0.17	ug/L			05/24/13 17:13	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 17:13	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 17:13	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 17:13	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 17:13	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 17:13	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 17:13	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 17:13	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 17:13	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 17:13	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 17:13	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 17:13	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 17:13	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 17:13	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 17:13	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 17:13	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 17:13	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 17:13	1

TestAmerica Chicago



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-2

Lab Sample ID: 500-57291-17

Date Collected: 05/21/13 12:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 17:13	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 17:13	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 17:13	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 17:13	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 17:13	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 17:13	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 17:13	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 17:13	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 17:13	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 17:13	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 17:13	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 17:13	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 17:13	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 17:13	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 17:13	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	87		75 - 125		05/24/13 17:13	1
Toluene-d8 (Surr)	97		75 - 120		05/24/13 17:13	1
4-Bromofluorobenzene (Surr)	100		75 - 120		05/24/13 17:13	1
Dibromofluoromethane	88		75 - 120		05/24/13 17:13	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-3
Date Collected: 05/21/13 11:15
Date Received: 05/22/13 10:10

Lab Sample ID: 500-57291-18
Matrix: Water

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 18:02	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 18:02	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 18:02	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 18:02	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 18:02	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 18:02	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 18:02	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 18:02	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 18:02	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 18:02	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 18:02	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 18:02	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 18:02	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 18:02	1
cis-1,2-Dichloroethene	1.8		1.0	0.12	ug/L			05/24/13 18:02	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 18:02	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 18:02	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 18:02	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 18:02	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 18:02	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 18:02	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 18:02	1
Trichloroethene	40		0.50	0.19	ug/L			05/24/13 18:02	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 18:02	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 18:02	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 18:02	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 18:02	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 18:02	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 18:02	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 18:02	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 18:02	1
Tetrachloroethene	1.3		1.0	0.17	ug/L			05/24/13 18:02	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 18:02	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 18:02	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 18:02	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 18:02	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 18:02	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 18:02	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 18:02	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 18:02	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 18:02	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 18:02	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 18:02	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 18:02	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 18:02	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 18:02	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 18:02	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 18:02	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 18:02	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-3

Lab Sample ID: 500-57291-18

Date Collected: 05/21/13 11:15

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 18:02	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 18:02	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 18:02	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 18:02	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 18:02	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 18:02	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 18:02	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 18:02	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 18:02	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 18:02	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 18:02	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 18:02	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 18:02	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 18:02	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 18:02	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	86		75 - 125					05/24/13 18:02	1
Toluene-d8 (Surr)	97		75 - 120					05/24/13 18:02	1
4-Bromofluorobenzene (Surr)	101		75 - 120					05/24/13 18:02	1
Dibromofluoromethane	87		75 - 120					05/24/13 18:02	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-4

Lab Sample ID: 500-57291-19

Date Collected: 05/21/13 11:50

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 18:27	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 18:27	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 18:27	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 18:27	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 18:27	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 18:27	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 18:27	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 18:27	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 18:27	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 18:27	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 18:27	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 18:27	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 18:27	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 18:27	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 18:27	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 18:27	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 18:27	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 18:27	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 18:27	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 18:27	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 18:27	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 18:27	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 18:27	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 18:27	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 18:27	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 18:27	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 18:27	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 18:27	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 18:27	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 18:27	1
Tetrachloroethene	8.7		1.0	0.17	ug/L			05/24/13 18:27	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 18:27	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 18:27	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 18:27	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 18:27	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 18:27	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 18:27	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 18:27	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 18:27	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 18:27	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 18:27	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 18:27	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 18:27	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 18:27	1
1,1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 18:27	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 18:27	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 18:27	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 18:27	1
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 18:27	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-4

Lab Sample ID: 500-57291-19

Date Collected: 05/21/13 11:50

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 18:27	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 18:27	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 18:27	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 18:27	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 18:27	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 18:27	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 18:27	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 18:27	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 18:27	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 18:27	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 18:27	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 18:27	1
Naphthalene	<1.0		1.0	0.18	ug/L			05/24/13 18:27	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 18:27	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	84		75 - 125		05/24/13 18:27	1
Toluene-d8 (Surr)	98		75 - 120		05/24/13 18:27	1
4-Bromofluorobenzene (Surr)	102		75 - 120		05/24/13 18:27	1
Dibromofluoromethane	88		75 - 120		05/24/13 18:27	1

Method: 8260B - VOC - DL

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Trichloroethene	430		5.0	1.9	ug/L			05/24/13 18:52	10

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	85		75 - 125		05/24/13 18:52	10
Toluene-d8 (Surr)	97		75 - 120		05/24/13 18:52	10
4-Bromofluorobenzene (Surr)	100		75 - 120		05/24/13 18:52	10
Dibromofluoromethane	89		75 - 120		05/24/13 18:52	10



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-5
Date Collected: 05/21/13 11:00
Date Received: 05/22/13 10:10

Lab Sample ID: 500-57291-20
Matrix: Water

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/28/13 15:07	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/28/13 15:07	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/28/13 15:07	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/28/13 15:07	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/28/13 15:07	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/28/13 15:07	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/28/13 15:07	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/28/13 15:07	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/28/13 15:07	1
Acetone	<5.0		5.0	1.3	ug/L			05/28/13 15:07	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/28/13 15:07	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/28/13 15:07	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/28/13 15:07	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/28/13 15:07	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/28/13 15:07	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/28/13 15:07	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/28/13 15:07	1
Chloroform	<1.0		1.0	0.20	ug/L			05/28/13 15:07	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/28/13 15:07	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/28/13 15:07	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/28/13 15:07	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 15:07	1
Trichloroethene	77		0.50	0.19	ug/L			05/28/13 15:07	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/28/13 15:07	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/28/13 15:07	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/28/13 15:07	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/28/13 15:07	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/28/13 15:07	1
Toluene	<0.50		0.50	0.11	ug/L			05/28/13 15:07	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/28/13 15:07	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 15:07	1
Tetrachloroethene	2.4		1.0	0.17	ug/L			05/28/13 15:07	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/28/13 15:07	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/28/13 15:07	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/28/13 15:07	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/28/13 15:07	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:07	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/28/13 15:07	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/28/13 15:07	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/28/13 15:07	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/28/13 15:07	1
Styrene	<1.0		1.0	0.10	ug/L			05/28/13 15:07	1
Bromoform	<1.0		1.0	0.28	ug/L			05/28/13 15:07	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:07	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/28/13 15:07	1
1,1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/28/13 15:07	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/28/13 15:07	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 15:07	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/28/13 15:07	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-5

Lab Sample ID: 500-57291-20

Date Collected: 05/21/13 11:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/28/13 15:07	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/28/13 15:07	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:07	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:07	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/28/13 15:07	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 15:07	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/28/13 15:07	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 15:07	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 15:07	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/28/13 15:07	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/28/13 15:07	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/28/13 15:07	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/28/13 15:07	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/28/13 15:07	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/28/13 15:07	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	86		75 - 125		05/28/13 15:07	1
Toluene-d8 (Surr)	97		75 - 120		05/28/13 15:07	1
4-Bromofluorobenzene (Surr)	102		75 - 120		05/28/13 15:07	1
Dibromofluoromethane	89		75 - 120		05/28/13 15:07	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-6
Date Collected: 05/21/13 09:15
Date Received: 05/22/13 10:10

Lab Sample ID: 500-57291-21
Matrix: Water

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/28/13 15:31	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/28/13 15:31	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/28/13 15:31	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/28/13 15:31	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/28/13 15:31	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/28/13 15:31	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/28/13 15:31	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/28/13 15:31	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/28/13 15:31	1
Acetone	<5.0		5.0	1.3	ug/L			05/28/13 15:31	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/28/13 15:31	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/28/13 15:31	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/28/13 15:31	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/28/13 15:31	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/28/13 15:31	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/28/13 15:31	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/28/13 15:31	1
Chloroform	<1.0		1.0	0.20	ug/L			05/28/13 15:31	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/28/13 15:31	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/28/13 15:31	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/28/13 15:31	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 15:31	1
Trichloroethene	5.7		0.50	0.19	ug/L			05/28/13 15:31	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/28/13 15:31	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/28/13 15:31	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/28/13 15:31	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/28/13 15:31	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/28/13 15:31	1
Toluene	<0.50		0.50	0.11	ug/L			05/28/13 15:31	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/28/13 15:31	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 15:31	1
Tetrachloroethene	10		1.0	0.17	ug/L			05/28/13 15:31	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/28/13 15:31	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/28/13 15:31	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/28/13 15:31	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/28/13 15:31	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:31	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/28/13 15:31	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/28/13 15:31	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/28/13 15:31	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/28/13 15:31	1
Styrene	<1.0		1.0	0.10	ug/L			05/28/13 15:31	1
Bromoform	<1.0		1.0	0.28	ug/L			05/28/13 15:31	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:31	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/28/13 15:31	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/28/13 15:31	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/28/13 15:31	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 15:31	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/28/13 15:31	1

TestAmerica Chicago



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-6

Lab Sample ID: 500-57291-21

Date Collected: 05/21/13 09:15

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/28/13 15:31	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/28/13 15:31	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:31	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:31	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/28/13 15:31	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 15:31	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/28/13 15:31	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 15:31	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 15:31	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/28/13 15:31	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/28/13 15:31	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/28/13 15:31	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/28/13 15:31	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/28/13 15:31	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/28/13 15:31	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	90		75 - 125		05/28/13 15:31	1
Toluene-d8 (Surr)	99		75 - 120		05/28/13 15:31	1
4-Bromofluorobenzene (Surr)	101		75 - 120		05/28/13 15:31	1
Dibromofluoromethane	90		75 - 120		05/28/13 15:31	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-7
Date Collected: 05/21/13 09:05
Date Received: 05/22/13 10:10

Lab Sample ID: 500-57291-22
Matrix: Water

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/28/13 15:56	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/28/13 15:56	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/28/13 15:56	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/28/13 15:56	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/28/13 15:56	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/28/13 15:56	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/28/13 15:56	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/28/13 15:56	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/28/13 15:56	1
Acetone	<5.0		5.0	1.3	ug/L			05/28/13 15:56	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/28/13 15:56	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/28/13 15:56	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/28/13 15:56	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/28/13 15:56	1
cis-1,2-Dichloroethene	3.0		1.0	0.12	ug/L			05/28/13 15:56	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/28/13 15:56	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/28/13 15:56	1
Chloroform	<1.0		1.0	0.20	ug/L			05/28/13 15:56	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/28/13 15:56	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/28/13 15:56	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/28/13 15:56	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 15:56	1
Trichloroethene	2.4		0.50	0.19	ug/L			05/28/13 15:56	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/28/13 15:56	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/28/13 15:56	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/28/13 15:56	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/28/13 15:56	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/28/13 15:56	1
Toluene	<0.50		0.50	0.11	ug/L			05/28/13 15:56	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/28/13 15:56	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 15:56	1
Tetrachloroethene	5.5		1.0	0.17	ug/L			05/28/13 15:56	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/28/13 15:56	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/28/13 15:56	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/28/13 15:56	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/28/13 15:56	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:56	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/28/13 15:56	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/28/13 15:56	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/28/13 15:56	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/28/13 15:56	1
Styrene	<1.0		1.0	0.10	ug/L			05/28/13 15:56	1
Bromoform	<1.0		1.0	0.28	ug/L			05/28/13 15:56	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:56	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/28/13 15:56	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/28/13 15:56	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/28/13 15:56	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 15:56	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/28/13 15:56	1

TestAmerica Chicago



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-7

Lab Sample ID: 500-57291-22

Date Collected: 05/21/13 09:05

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/28/13 15:56	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/28/13 15:56	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:56	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 15:56	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/28/13 15:56	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 15:56	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/28/13 15:56	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 15:56	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 15:56	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/28/13 15:56	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/28/13 15:56	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/28/13 15:56	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/28/13 15:56	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/28/13 15:56	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/28/13 15:56	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	86		75 - 125		05/28/13 15:56	1
Toluene-d8 (Surr)	97		75 - 120		05/28/13 15:56	1
4-Bromofluorobenzene (Surr)	105		75 - 120		05/28/13 15:56	1
Dibromofluoromethane	85		75 - 120		05/28/13 15:56	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-8

Lab Sample ID: 500-57291-23

Date Collected: 05/21/13 09:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/28/13 16:20	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/28/13 16:20	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/28/13 16:20	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/28/13 16:20	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/28/13 16:20	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/28/13 16:20	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/28/13 16:20	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/28/13 16:20	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/28/13 16:20	1
Acetone	<5.0		5.0	1.3	ug/L			05/28/13 16:20	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/28/13 16:20	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/28/13 16:20	1
1,1-Dichloroethane	0.57	J	1.0	0.19	ug/L			05/28/13 16:20	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/28/13 16:20	1
cis-1,2-Dichloroethene	21		1.0	0.12	ug/L			05/28/13 16:20	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/28/13 16:20	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/28/13 16:20	1
Chloroform	<1.0		1.0	0.20	ug/L			05/28/13 16:20	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/28/13 16:20	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/28/13 16:20	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/28/13 16:20	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 16:20	1
Trichloroethene	7.1		0.50	0.19	ug/L			05/28/13 16:20	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/28/13 16:20	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/28/13 16:20	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/28/13 16:20	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/28/13 16:20	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/28/13 16:20	1
Toluene	<0.50		0.50	0.11	ug/L			05/28/13 16:20	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/28/13 16:20	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 16:20	1
Tetrachloroethene	65		1.0	0.17	ug/L			05/28/13 16:20	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/28/13 16:20	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/28/13 16:20	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/28/13 16:20	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/28/13 16:20	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/28/13 16:20	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/28/13 16:20	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/28/13 16:20	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/28/13 16:20	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/28/13 16:20	1
Styrene	<1.0		1.0	0.10	ug/L			05/28/13 16:20	1
Bromoform	<1.0		1.0	0.28	ug/L			05/28/13 16:20	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 16:20	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/28/13 16:20	1
1,1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/28/13 16:20	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/28/13 16:20	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 16:20	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/28/13 16:20	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-8

Lab Sample ID: 500-57291-23

Date Collected: 05/21/13 09:00

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/28/13 16:20	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/28/13 16:20	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 16:20	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 16:20	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/28/13 16:20	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 16:20	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/28/13 16:20	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 16:20	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 16:20	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/28/13 16:20	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/28/13 16:20	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/28/13 16:20	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/28/13 16:20	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/28/13 16:20	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/28/13 16:20	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	84		75 - 125		05/28/13 16:20	1
Toluene-d8 (Surr)	98		75 - 120		05/28/13 16:20	1
4-Bromofluorobenzene (Surr)	105		75 - 120		05/28/13 16:20	1
Dibromofluoromethane	88		75 - 120		05/28/13 16:20	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-9
Date Collected: 05/21/13 08:50
Date Received: 05/22/13 10:10

Lab Sample ID: 500-57291-24
Matrix: Water

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/28/13 16:45	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/28/13 16:45	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/28/13 16:45	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/28/13 16:45	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/28/13 16:45	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/28/13 16:45	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/28/13 16:45	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/28/13 16:45	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/28/13 16:45	1
Acetone	<5.0		5.0	1.3	ug/L			05/28/13 16:45	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/28/13 16:45	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/28/13 16:45	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/28/13 16:45	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/28/13 16:45	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/28/13 16:45	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/28/13 16:45	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/28/13 16:45	1
Chloroform	<1.0		1.0	0.20	ug/L			05/28/13 16:45	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/28/13 16:45	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/28/13 16:45	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/28/13 16:45	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 16:45	1
Trichloroethene	0.52		0.50	0.19	ug/L			05/28/13 16:45	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/28/13 16:45	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/28/13 16:45	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/28/13 16:45	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/28/13 16:45	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/28/13 16:45	1
Toluene	<0.50		0.50	0.11	ug/L			05/28/13 16:45	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/28/13 16:45	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 16:45	1
Tetrachloroethene	88		1.0	0.17	ug/L			05/28/13 16:45	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/28/13 16:45	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/28/13 16:45	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/28/13 16:45	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/28/13 16:45	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/28/13 16:45	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/28/13 16:45	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/28/13 16:45	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/28/13 16:45	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/28/13 16:45	1
Styrene	<1.0		1.0	0.10	ug/L			05/28/13 16:45	1
Bromoform	<1.0		1.0	0.28	ug/L			05/28/13 16:45	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 16:45	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/28/13 16:45	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/28/13 16:45	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/28/13 16:45	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 16:45	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/28/13 16:45	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-9

Lab Sample ID: 500-57291-24

Date Collected: 05/21/13 08:50

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/28/13 16:45	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/28/13 16:45	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 16:45	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 16:45	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/28/13 16:45	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 16:45	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/28/13 16:45	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 16:45	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 16:45	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/28/13 16:45	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/28/13 16:45	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/28/13 16:45	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/28/13 16:45	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/28/13 16:45	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/28/13 16:45	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	86		75 - 125		05/28/13 16:45	1
Toluene-d8 (Surr)	101		75 - 120		05/28/13 16:45	1
4-Bromofluorobenzene (Surr)	103		75 - 120		05/28/13 16:45	1
Dibromofluoromethane	85		75 - 120		05/28/13 16:45	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-9 DUP

Lab Sample ID: 500-57291-25

Date Collected: 05/21/13 08:50

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/28/13 17:09	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/28/13 17:09	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/28/13 17:09	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/28/13 17:09	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/28/13 17:09	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/28/13 17:09	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/28/13 17:09	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/28/13 17:09	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/28/13 17:09	1
Acetone	<5.0		5.0	1.3	ug/L			05/28/13 17:09	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/28/13 17:09	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/28/13 17:09	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/28/13 17:09	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/28/13 17:09	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/28/13 17:09	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/28/13 17:09	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/28/13 17:09	1
Chloroform	<1.0		1.0	0.20	ug/L			05/28/13 17:09	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/28/13 17:09	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/28/13 17:09	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/28/13 17:09	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 17:09	1
Trichloroethene	0.44	J	0.50	0.19	ug/L			05/28/13 17:09	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/28/13 17:09	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/28/13 17:09	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/28/13 17:09	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/28/13 17:09	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/28/13 17:09	1
Toluene	<0.50		0.50	0.11	ug/L			05/28/13 17:09	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/28/13 17:09	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 17:09	1
Tetrachloroethene	87		1.0	0.17	ug/L			05/28/13 17:09	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/28/13 17:09	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/28/13 17:09	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/28/13 17:09	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/28/13 17:09	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/28/13 17:09	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/28/13 17:09	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/28/13 17:09	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/28/13 17:09	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/28/13 17:09	1
Styrene	<1.0		1.0	0.10	ug/L			05/28/13 17:09	1
Bromoform	<1.0		1.0	0.28	ug/L			05/28/13 17:09	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 17:09	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/28/13 17:09	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/28/13 17:09	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/28/13 17:09	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 17:09	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/28/13 17:09	1

TestAmerica Chicago

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-9 DUP

Lab Sample ID: 500-57291-25

Date Collected: 05/21/13 08:50

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/28/13 17:09	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/28/13 17:09	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 17:09	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 17:09	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/28/13 17:09	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 17:09	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/28/13 17:09	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 17:09	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 17:09	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/28/13 17:09	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/28/13 17:09	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/28/13 17:09	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/28/13 17:09	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/28/13 17:09	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/28/13 17:09	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	87		75 - 125		05/28/13 17:09	1
Toluene-d8 (Sum)	98		75 - 120		05/28/13 17:09	1
4-Bromofluorobenzene (Surr)	100		75 - 120		05/28/13 17:09	1
Dibromofluoromethane	88		75 - 120		05/28/13 17:09	1



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-10
Date Collected: 05/21/13 08:40
Date Received: 05/22/13 10:10

Lab Sample ID: 500-57291-26
Matrix: Water

Method: 8260B - VOC

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Benzene	<0.50		0.50	0.074	ug/L			05/28/13 17:34	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/28/13 17:34	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/28/13 17:34	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/28/13 17:34	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/28/13 17:34	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/28/13 17:34	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/28/13 17:34	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/28/13 17:34	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/28/13 17:34	1
Acetone	<5.0		5.0	1.3	ug/L			05/28/13 17:34	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/28/13 17:34	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/28/13 17:34	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/28/13 17:34	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/28/13 17:34	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/28/13 17:34	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/28/13 17:34	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/28/13 17:34	1
Chloroform	<1.0		1.0	0.20	ug/L			05/28/13 17:34	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/28/13 17:34	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/28/13 17:34	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/28/13 17:34	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 17:34	1
Trichloroethene	<0.50		0.50	0.19	ug/L			05/28/13 17:34	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/28/13 17:34	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/28/13 17:34	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/28/13 17:34	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/28/13 17:34	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/28/13 17:34	1
Toluene	<0.50		0.50	0.11	ug/L			05/28/13 17:34	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/28/13 17:34	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 17:34	1
Tetrachloroethene	<1.0		1.0	0.17	ug/L			05/28/13 17:34	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/28/13 17:34	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/28/13 17:34	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/28/13 17:34	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/28/13 17:34	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/28/13 17:34	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/28/13 17:34	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/28/13 17:34	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/28/13 17:34	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/28/13 17:34	1
Styrene	<1.0		1.0	0.10	ug/L			05/28/13 17:34	1
Bromoform	<1.0		1.0	0.28	ug/L			05/28/13 17:34	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 17:34	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/28/13 17:34	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/28/13 17:34	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/28/13 17:34	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 17:34	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/28/13 17:34	1

TestAmerica Chicago



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-10

Lab Sample ID: 500-57291-26

Date Collected: 05/21/13 08:40

Matrix: Water

Date Received: 05/22/13 10:10

Method: 8260B - VOC (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/28/13 17:34	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/28/13 17:34	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 17:34	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 17:34	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/28/13 17:34	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 17:34	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/28/13 17:34	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 17:34	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 17:34	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/28/13 17:34	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/28/13 17:34	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/28/13 17:34	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/28/13 17:34	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/28/13 17:34	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/28/13 17:34	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	87		75 - 125					05/28/13 17:34	1
Toluene-d8 (Surr)	97		75 - 120					05/28/13 17:34	1
4-Bromofluorobenzene (Surr)	102		75 - 120					05/28/13 17:34	1
Dibromofluoromethane	88		75 - 120					05/28/13 17:34	1



Definitions/Glossary

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Qualifiers

GC/MS VOA

Qualifier	Qualifier Description
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
□	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CNF	Contains no Free Liquid
DER	Duplicate error ratio (normalized absolute difference)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision level concentration
MDA	Minimum detectable activity
EDL	Estimated Detection Limit
MDC	Minimum detectable concentration
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
ND	Not detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative error ratio
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

QC Association Summary

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

GC/MS VOA

Analysis Batch: 187369

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
500-57291-1	RFW-1A	Total/NA	Water	8260B	
500-57291-1 MS	RFW-1A	Total/NA	Water	8260B	
500-57291-1 MSD	RFW-1A	Total/NA	Water	8260B	
500-57291-2	RFW-1B	Total/NA	Water	8260B	
500-57291-3	RFW-2A	Total/NA	Water	8260B	
500-57291-4	RFW-2B	Total/NA	Water	8260B	
500-57291-5	RFW-3B	Total/NA	Water	8260B	
500-57291-6	RFW-4A	Total/NA	Water	8260B	
500-57291-7	RFW-4A DUP	Total/NA	Water	8260B	
500-57291-8	RFW-4B	Total/NA	Water	8260B	
500-57291-9	RFW-6	Total/NA	Water	8260B	
500-57291-10	RFW-7	Total/NA	Water	8260B	
500-57291-11	RFW-9	Total/NA	Water	8260B	
500-57291-12	RFW-11B	Total/NA	Water	8260B	
500-57291-13	RFW-12B	Total/NA	Water	8260B	
500-57291-14	RFW-13	Total/NA	Water	8260B	
500-57291-15	RFW-17	Total/NA	Water	8260B	
500-57291-16	Trip Blank	Total/NA	Water	8260B	
500-57291-17	EW-2	Total/NA	Water	8260B	
500-57291-18	EW-3	Total/NA	Water	8260B	
500-57291-19	EW-4	Total/NA	Water	8260B	
500-57291-19 - DL	EW-4	Total/NA	Water	8260B	
LCS 500-187369/4	Lab Control Sample	Total/NA	Water	8260B	
MB 500-187369/6	Method Blank	Total/NA	Water	8260B	

Analysis Batch: 187605

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
500-57291-20	EW-5	Total/NA	Water	8260B	
500-57291-21	EW-6	Total/NA	Water	8260B	
500-57291-22	EW-7	Total/NA	Water	8260B	
500-57291-23	EW-8	Total/NA	Water	8260B	
500-57291-24	EW-9	Total/NA	Water	8260B	
500-57291-25	EW-9 DUP	Total/NA	Water	8260B	
500-57291-26	EW-10	Total/NA	Water	8260B	
LCS 500-187605/4	Lab Control Sample	Total/NA	Water	8260B	
MB 500-187605/6	Method Blank	Total/NA	Water	8260B	



Surrogate Summary

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Method: 8260B - VOC

Matrix: Water

Prep Type: Total/NA

Lab Sample ID	Client Sample ID	Percent Surrogate Recovery (Acceptance Limits)			
		12DCE (75-125)	TOL (75-120)	BFB (75-120)	DBFM (75-120)
500-57291-1	RFW-1A	83	98	102	87
500-57291-1 MS	RFW-1A	83	104	95	95
500-57291-1 MSD	RFW-1A	83	100	99	95
500-57291-2	RFW-1B	82	100	104	87
500-57291-3	RFW-2A	83	98	103	86
500-57291-4	RFW-2B	84	101	104	85
500-57291-5	RFW-3B	84	96	105	87
500-57291-6	RFW-4A	85	97	102	90
500-57291-7	RFW-4A DUP	84	98	105	83
500-57291-8	RFW-4B	85	95	107	86
500-57291-9	RFW-6	87	95	103	86
500-57291-10	RFW-7	88	97	103	85
500-57291-11	RFW-9	86	99	100	87
500-57291-12	RFW-11B	83	98	102	89
500-57291-13	RFW-12B	84	97	98	90
500-57291-14	RFW-13	84	98	98	91
500-57291-15	RFW-17	85	99	102	89
500-57291-16	Trip Blank	87	100	103	88
500-57291-17	EW-2	87	97	100	88
500-57291-18	EW-3	86	97	101	87
500-57291-19	EW-4	84	98	102	88
500-57291-19 - DL	EW-4	85	97	100	89
500-57291-20	EW-5	86	97	102	89
500-57291-21	EW-6	90	99	101	90
500-57291-22	EW-7	86	97	105	85
500-57291-23	EW-8	84	98	105	88
500-57291-24	EW-9	86	101	103	85
500-57291-25	EW-9 DUP	87	98	100	88
500-57291-26	EW-10	87	97	102	88
LCS 500-187369/4	Lab Control Sample	84	98	101	92
LCS 500-187605/4	Lab Control Sample	84	94	101	95
MB 500-187369/6	Method Blank	81	102	106	83
MB 500-187605/6	Method Blank	85	98	103	87

Surrogate Legend

- 12DCE = 1,2-Dichloroethane-d4 (Surr)
- TOL = Toluene-d8 (Surr)
- BFB = 4-Bromofluorobenzene (Surr)
- DBFM = Dibromofluoromethane



QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Method: 8260B - VOC

Lab Sample ID: MB 500-187369/6
Matrix: Water
Analysis Batch: 187369

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB MB		RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Benzene	<0.50		0.50	0.074	ug/L			05/24/13 10:16	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/24/13 10:16	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/24/13 10:16	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/24/13 10:16	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/24/13 10:16	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/24/13 10:16	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/24/13 10:16	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/24/13 10:16	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/24/13 10:16	1
Acetone	<5.0		5.0	1.3	ug/L			05/24/13 10:16	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/24/13 10:16	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/24/13 10:16	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/24/13 10:16	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/24/13 10:16	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/24/13 10:16	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/24/13 10:16	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/24/13 10:16	1
Chloroform	<1.0		1.0	0.20	ug/L			05/24/13 10:16	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/24/13 10:16	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/24/13 10:16	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/24/13 10:16	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 10:16	1
Trichloroethene	<0.50		0.50	0.19	ug/L			05/24/13 10:16	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/24/13 10:16	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/24/13 10:16	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/24/13 10:16	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/24/13 10:16	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/24/13 10:16	1
Toluene	<0.50		0.50	0.11	ug/L			05/24/13 10:16	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/24/13 10:16	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/24/13 10:16	1
Tetrachloroethene	<1.0		1.0	0.17	ug/L			05/24/13 10:16	1
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/24/13 10:16	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/24/13 10:16	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/24/13 10:16	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/24/13 10:16	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/24/13 10:16	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/24/13 10:16	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/24/13 10:16	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/24/13 10:16	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/24/13 10:16	1
Styrene	<1.0		1.0	0.10	ug/L			05/24/13 10:16	1
Bromoform	<1.0		1.0	0.28	ug/L			05/24/13 10:16	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 10:16	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/24/13 10:16	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/24/13 10:16	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/24/13 10:16	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 10:16	1



TestAmerica Chicago

QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Method: 8260B - VOC (Continued)

Lab Sample ID: MB 500-187369/6 Client Sample ID: Method Blank
Matrix: Water Prep Type: Total/NA

Analysis Batch: 187369

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/24/13 10:16	1
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/24/13 10:16	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/24/13 10:16	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 10:16	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/24/13 10:16	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/24/13 10:16	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 10:16	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/24/13 10:16	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/24/13 10:16	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/24/13 10:16	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/24/13 10:16	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/24/13 10:16	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/24/13 10:16	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/24/13 10:16	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/24/13 10:16	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/24/13 10:16	1

Surrogate	MB %Recovery	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
1,2-Dichloroethane-d4 (Surr)	81		75 - 125		05/24/13 10:16	1
Toluene-d8 (Surr)	102		75 - 120		05/24/13 10:16	1
4-Bromofluorobenzene (Surr)	106		75 - 120		05/24/13 10:16	1
Dibromofluoromethane	83		75 - 120		05/24/13 10:16	1

Lab Sample ID: LCS 500-187369/4 Client Sample ID: Lab Control Sample
Matrix: Water Prep Type: Total/NA
Analysis Batch: 187369

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Benzene	50.0	44.1		ug/L		88	70 - 120
Dichlorodifluoromethane	50.0	45.6		ug/L		91	40 - 140
Chloromethane	50.0	40.0		ug/L		80	50 - 134
Vinyl chloride	50.0	39.8		ug/L		80	62 - 138
Bromomethane	50.0	46.8		ug/L		94	50 - 150
Chloroethane	50.0	41.2		ug/L		82	50 - 150
Trichlorofluoromethane	50.0	48.1		ug/L		96	63 - 134
1,1-Dichloroethene	50.0	44.8		ug/L		90	58 - 122
Carbon disulfide	50.0	47.2		ug/L		94	50 - 120
Acetone	50.0	35.6		ug/L		71	46 - 153
Methylene Chloride	50.0	42.7		ug/L		85	65 - 125
trans-1,2-Dichloroethene	50.0	46.5		ug/L		93	70 - 124
1,1-Dichloroethane	50.0	41.6		ug/L		83	68 - 121
2,2-Dichloropropane	50.0	51.7		ug/L		103	67 - 125
cis-1,2-Dichloroethene	50.0	45.2		ug/L		90	70 - 120
Methyl Ethyl Ketone	50.0	31.4		ug/L		63	54 - 138
Bromochloromethane	50.0	42.8		ug/L		86	67 - 122
Chloroform	50.0	43.9		ug/L		88	70 - 120
1,1,1-Trichloroethane	50.0	49.0		ug/L		98	70 - 123
1,1-Dichloropropene	50.0	47.2		ug/L		94	70 - 120

TestAmerica Chicago

QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1



Method: 8260B - VOC (Continued)

Lab Sample ID: LCS 500-187369/4
Matrix: Water
Analysis Batch: 187369

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Carbon tetrachloride	50.0	49.9		ug/L		100	70 - 125
1,2-Dichloroethane	50.0	37.1		ug/L		74	69 - 120
Trichloroethene	50.0	47.9		ug/L		96	70 - 120
1,2-Dichloropropane	50.0	44.0		ug/L		88	70 - 120
Dibromomethane	50.0	42.1		ug/L		84	70 - 120
Bromodichloromethane	50.0	46.7		ug/L		93	70 - 120
cis-1,3-Dichloropropene	50.0	47.9		ug/L		96	70 - 120
methyl isobutyl ketone	50.0	31.8		ug/L		64	59 - 135
Toluene	50.0	48.3		ug/L		97	70 - 120
trans-1,3-Dichloropropene	50.0	51.4		ug/L		103	70 - 120
1,1,2-Trichloroethane	50.0	45.2		ug/L		90	69 - 120
Tetrachloroethene	50.0	48.4		ug/L		97	70 - 123
1,3-Dichloropropane	50.0	42.9		ug/L		86	70 - 120
2-Hexanone	50.0	36.5		ug/L		73	55 - 144
Dibromochloromethane	50.0	45.5		ug/L		91	70 - 120
1,2-Dibromoethane	50.0	43.5		ug/L		87	70 - 120
Chlorobenzene	50.0	46.7		ug/L		93	70 - 120
1,1,1,2-Tetrachloroethane	50.0	43.8		ug/L		88	75 - 120
Ethylbenzene	50.0	48.4		ug/L		97	75 - 120
m&p-Xylene	50.0	47.0		ug/L		94	75 - 120
o-Xylene	50.0	45.0		ug/L		90	70 - 120
Styrene	50.0	45.1		ug/L		90	75 - 120
Bromoform	50.0	40.9		ug/L		82	70 - 125
Isopropylbenzene	50.0	52.1		ug/L		104	70 - 120
Bromobenzene	50.0	49.9		ug/L		100	70 - 120
1,1,2,2-Tetrachloroethane	50.0	43.3		ug/L		87	70 - 128
1,2,3-Trichloropropane	50.0	45.3		ug/L		91	70 - 120
N-Propylbenzene	50.0	53.8		ug/L		108	70 - 120
2-Chlorotoluene	50.0	51.3		ug/L		103	70 - 120
1,3,5-Trimethylbenzene	50.0	50.8		ug/L		102	75 - 123
4-Chlorotoluene	50.0	51.0		ug/L		102	70 - 120
tert-Butylbenzene	50.0	50.9		ug/L		102	70 - 120
1,2,4-Trimethylbenzene	50.0	48.8		ug/L		98	75 - 121
sec-Butylbenzene	50.0	51.1		ug/L		102	70 - 120
1,3-Dichlorobenzene	50.0	47.9		ug/L		96	70 - 120
p-Isopropyltoluene	50.0	50.9		ug/L		102	70 - 120
1,4-Dichlorobenzene	50.0	46.1		ug/L		92	75 - 120
n-Butylbenzene	50.0	50.8		ug/L		102	75 - 120
1,2-Dichlorobenzene	50.0	46.0		ug/L		92	75 - 120
1,2-Dibromo-3-Chloropropane	50.0	40.8		ug/L		82	60 - 121
1,2,4-Trichlorobenzene	50.0	43.5		ug/L		87	65 - 121
Hexachlorobutadiene	50.0	46.1		ug/L		92	65 - 135
Naphthalene	50.0	39.7		ug/L		79	55 - 132
1,2,3-Trichlorobenzene	50.0	39.1		ug/L		78	56 - 137

Surrogate	LCS LCS		Limits
	%Recovery	Qualifier	
1,2-Dichloroethane-d4 (Surr)	84		75 - 125
Toluene-d8 (Surr)	98		75 - 120

TestAmerica Chicago

QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1



Method: 8260B - VOC (Continued)

Lab Sample ID: LCS 500-187369/4
Matrix: Water
Analysis Batch: 187369

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Surrogate	LCS %Recovery	LCS Qualifier	Limits
4-Bromofluorobenzene (Surr)	101		75 - 120
Dibromofluoromethane	92		75 - 120

Lab Sample ID: 500-57291-1 MS
Matrix: Water
Analysis Batch: 187369

Client Sample ID: RFW-1A
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Benzene	<0.50		50.0	46.0		ug/L		92	70 - 120
Dichlorodifluoromethane	<1.0		50.0	44.7		ug/L		89	40 - 140
Chloromethane	<1.0		50.0	40.8		ug/L		82	50 - 134
Vinyl chloride	<0.50		50.0	41.0		ug/L		82	62 - 138
Bromomethane	<1.0		50.0	48.3		ug/L		97	50 - 150
Chloroethane	<1.0		50.0	41.1		ug/L		82	50 - 150
Trichlorofluoromethane	<1.0		50.0	49.0		ug/L		98	63 - 134
1,1-Dichloroethane	<1.0		50.0	45.3		ug/L		91	58 - 122
Carbon disulfide	<5.0		50.0	48.0		ug/L		96	50 - 120
Acetone	<5.0		50.0	29.3		ug/L		59	46 - 153
Methylene Chloride	<5.0		50.0	45.4		ug/L		91	65 - 125
trans-1,2-Dichloroethene	<1.0		50.0	48.0		ug/L		96	70 - 124
1,1-Dichloroethane	<1.0		50.0	43.5		ug/L		87	68 - 121
2,2-Dichloropropane	<1.0		50.0	53.2		ug/L		106	67 - 125
cis-1,2-Dichloroethene	<1.0		50.0	47.3		ug/L		95	70 - 120
Methyl Ethyl Ketone	<5.0		50.0	31.5		ug/L		63	54 - 138
Bromochloromethane	<1.0		50.0	45.6		ug/L		91	67 - 122
Chloroform	<1.0		50.0	45.5		ug/L		91	70 - 120
1,1,1-Trichloroethane	<1.0		50.0	51.1		ug/L		102	70 - 123
1,1-Dichloropropene	<1.0		50.0	49.1		ug/L		98	70 - 120
Carbon tetrachloride	<1.0		50.0	51.3		ug/L		103	70 - 125
1,2-Dichloroethane	<1.0		50.0	40.0		ug/L		80	69 - 120
Trichloroethene	<0.50		50.0	48.6		ug/L		97	70 - 120
1,2-Dichloropropane	<1.0		50.0	44.6		ug/L		89	70 - 120
Dibromomethane	<1.0		50.0	44.5		ug/L		89	70 - 120
Bromodichloromethane	<1.0		50.0	47.1		ug/L		94	70 - 120
cis-1,3-Dichloropropene	<1.0		50.0	50.5		ug/L		101	70 - 120
methyl isobutyl ketone	<5.0		50.0	36.2		ug/L		72	59 - 135
Toluene	<0.50		50.0	52.2		ug/L		104	70 - 120
trans-1,3-Dichloropropene	<1.0		50.0	51.2		ug/L		102	70 - 120
1,1,2-Trichloroethane	<1.0		50.0	46.0		ug/L		92	69 - 120
Tetrachloroethene	<1.0		50.0	50.7		ug/L		101	70 - 123
1,3-Dichloropropane	<1.0		50.0	42.4		ug/L		85	70 - 120
2-Hexanone	<5.0		50.0	36.6		ug/L		73	55 - 144
Dibromochloromethane	<1.0		50.0	46.8		ug/L		94	70 - 120
1,2-Dibromoethane	<1.0		50.0	44.6		ug/L		89	70 - 120
Chlorobenzene	<1.0		50.0	48.3		ug/L		97	70 - 120
1,1,1,2-Tetrachloroethane	<1.0		50.0	52.5		ug/L		105	75 - 120
Ethylbenzene	<0.50		50.0	50.3		ug/L		101	75 - 120
m&p-Xylene	<1.0		50.0	49.5		ug/L		99	75 - 120

TestAmerica Chicago

QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Method: 8260B - VOC (Continued)

Lab Sample ID: 500-57291-1 MS
Matrix: Water
Analysis Batch: 187369

Client Sample ID: RFW-1A
Prep Type: Total/NA

Analyte	Sample	Sample	Spike	MS	MS	Unit	D	%Rec	%Rec.
	Result	Qualifier	Added	Result	Qualifier				
o-Xylene	<0.50		50.0	50.5		ug/L		101	70 - 120
Styrene	<1.0		50.0	46.9		ug/L		94	75 - 120
Bromoform	<1.0		50.0	42.5		ug/L		85	70 - 125
Isopropylbenzene	<1.0		50.0	52.4		ug/L		105	70 - 120
Bromobenzene	<1.0		50.0	48.7		ug/L		97	70 - 120
1,1,2,2-Tetrachloroethane	<1.0		50.0	43.0		ug/L		86	70 - 128
1,2,3-Trichloropropane	<1.0		50.0	44.8		ug/L		90	70 - 120
N-Propylbenzene	<1.0		50.0	51.5		ug/L		103	70 - 120
2-Chlorotoluene	<1.0		50.0	50.3		ug/L		101	70 - 120
1,3,5-Trimethylbenzene	<1.0		50.0	51.8		ug/L		104	75 - 123
4-Chlorotoluene	<1.0		50.0	49.4		ug/L		99	70 - 120
tert-Butylbenzene	<1.0		50.0	53.6		ug/L		107	70 - 120
1,2,4-Trimethylbenzene	<1.0		50.0	49.0		ug/L		98	75 - 121
sec-Butylbenzene	<1.0		50.0	52.2		ug/L		104	70 - 120
1,3-Dichlorobenzene	<1.0		50.0	48.2		ug/L		96	70 - 120
p-Isopropyltoluene	<1.0		50.0	51.5		ug/L		103	70 - 120
1,4-Dichlorobenzene	<1.0		50.0	46.4		ug/L		93	75 - 120
n-Butylbenzene	<1.0		50.0	50.0		ug/L		100	75 - 120
1,2-Dichlorobenzene	<1.0		50.0	47.7		ug/L		95	75 - 120
1,2-Dibromo-3-Chloropropane	<2.0		50.0	42.8		ug/L		86	60 - 121
1,2,4-Trichlorobenzene	<1.0		50.0	41.6		ug/L		83	65 - 121
Hexachlorobutadiene	<1.0		50.0	46.5		ug/L		93	65 - 135
Naphthalene	<1.0		50.0	40.1		ug/L		80	55 - 132
1,2,3-Trichlorobenzene	<1.0		50.0	38.2		ug/L		76	56 - 137

Surrogate	MS %Recovery	MS Qualifier	Limits
1,2-Dichloroethane-d4 (Surr)	83		75 - 125
Toluene-d8 (Surr)	104		75 - 120
4-Bromofluorobenzene (Surr)	95		75 - 120
Dibromofluoromethane	95		75 - 120

Lab Sample ID: 500-57291-1 MSD
Matrix: Water
Analysis Batch: 187369

Client Sample ID: RFW-1A
Prep Type: Total/NA

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec.	RPD	RPD
	Result	Qualifier	Added	Result	Qualifier						
Benzene	<0.50		50.0	45.3		ug/L		91	70 - 120	2	20
Dichlorodifluoromethane	<1.0		50.0	47.5		ug/L		95	40 - 140	6	20
Chloromethane	<1.0		50.0	42.3		ug/L		85	50 - 134	4	20
Vinyl chloride	<0.50		50.0	42.7		ug/L		85	62 - 138	4	20
Bromomethane	<1.0		50.0	51.1		ug/L		102	50 - 150	6	20
Chloroethane	<1.0		50.0	43.5		ug/L		87	50 - 150	6	20
Trichlorofluoromethane	<1.0		50.0	51.4		ug/L		103	63 - 134	5	20
1,1-Dichloroethene	<1.0		50.0	44.8		ug/L		90	58 - 122	1	20
Carbon disulfide	<5.0		50.0	48.5		ug/L		97	50 - 120	1	20
Acetone	<5.0		50.0	26.7		ug/L		53	46 - 153	9	20
Methylene Chloride	<5.0		50.0	44.9		ug/L		90	65 - 125	1	20
trans-1,2-Dichloroethene	<1.0		50.0	48.4		ug/L		97	70 - 124	1	20

TestAmerica Chicago

QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Method: 8260B - VOC (Continued)

Lab Sample ID: 500-57291-1 MSD

Client Sample ID: RFW-1A

Matrix: Water

Prep Type: Total/NA

Analysis Batch: 187369

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	Limits	RPD	RPD Limit
1,1-Dichloroethane	<1.0		50.0	43.1		ug/L		86	68 - 121	1	20
2,2-Dichloropropane	<1.0		50.0	53.5		ug/L		107	67 - 125	1	20
cis-1,2-Dichloroethene	<1.0		50.0	46.8		ug/L		94	70 - 120	1	20
Methyl Ethyl Ketone	<5.0		50.0	28.9		ug/L		58	54 - 138	9	20
Bromochloromethane	<1.0		50.0	44.6		ug/L		89	67 - 122	2	20
Chloroform	<1.0		50.0	45.5		ug/L		91	70 - 120	0	20
1,1,1-Trichloroethane	<1.0		50.0	51.7		ug/L		103	70 - 123	1	20
1,1-Dichloropropene	<1.0		50.0	48.1		ug/L		96	70 - 120	2	20
Carbon tetrachloride	<1.0		50.0	52.0		ug/L		104	70 - 125	1	20
1,2-Dichloroethane	<1.0		50.0	38.5		ug/L		77	69 - 120	4	20
Trichloroethene	<0.50		50.0	48.7		ug/L		97	70 - 120	0	20
1,2-Dichloropropane	<1.0		50.0	43.8		ug/L		88	70 - 120	2	20
Dibromomethane	<1.0		50.0	42.5		ug/L		85	70 - 120	5	20
Bromodichloromethane	<1.0		50.0	46.7		ug/L		93	70 - 120	1	20
cis-1,3-Dichloropropene	<1.0		50.0	47.4		ug/L		95	70 - 120	6	20
methyl isobutyl ketone	<5.0		50.0	34.6		ug/L		69	59 - 135	5	20
Toluene	<0.50		50.0	48.7		ug/L		97	70 - 120	7	20
trans-1,3-Dichloropropene	<1.0		50.0	50.6		ug/L		101	70 - 120	1	20
1,1,2-Trichloroethane	<1.0		50.0	45.9		ug/L		92	69 - 120	0	20
Tetrachloroethene	<1.0		50.0	49.0		ug/L		98	70 - 123	3	20
1,3-Dichloropropane	<1.0		50.0	42.0		ug/L		84	70 - 120	1	20
2-Hexanone	<5.0		50.0	35.0		ug/L		70	55 - 144	5	20
Dibromochloromethane	<1.0		50.0	47.2		ug/L		94	70 - 120	1	20
1,2-Dibromoethane	<1.0		50.0	43.9		ug/L		88	70 - 120	2	20
Chlorobenzene	<1.0		50.0	47.0		ug/L		94	70 - 120	3	20
1,1,1,2-Tetrachloroethane	<1.0		50.0	49.9		ug/L		100	75 - 120	5	20
Ethylbenzene	<0.50		50.0	48.3		ug/L		97	75 - 120	4	20
m&p-Xylene	<1.0		50.0	47.8		ug/L		96	75 - 120	4	20
o-Xylene	<0.50		50.0	48.0		ug/L		96	70 - 120	5	20
Styrene	<1.0		50.0	46.7		ug/L		93	75 - 120	0	20
Bromoform	<1.0		50.0	43.1		ug/L		86	70 - 125	2	20
Isopropylbenzene	<1.0		50.0	52.7		ug/L		105	70 - 120	1	20
Bromobenzene	<1.0		50.0	50.1		ug/L		100	70 - 120	3	20
1,1,2,2-Tetrachloroethane	<1.0		50.0	44.4		ug/L		89	70 - 128	3	20
1,2,3-Trichloropropane	<1.0		50.0	46.1		ug/L		92	70 - 120	3	20
N-Propylbenzene	<1.0		50.0	51.5		ug/L		103	70 - 120	0	20
2-Chlorotoluene	<1.0		50.0	50.5		ug/L		101	70 - 120	0	20
1,3,5-Trimethylbenzene	<1.0		50.0	50.8		ug/L		102	75 - 123	2	20
4-Chlorotoluene	<1.0		50.0	50.5		ug/L		101	70 - 120	2	20
tert-Butylbenzene	<1.0		50.0	52.8		ug/L		106	70 - 120	2	20
1,2,4-Trimethylbenzene	<1.0		50.0	49.2		ug/L		98	75 - 121	0	20
sec-Butylbenzene	<1.0		50.0	51.6		ug/L		103	70 - 120	1	20
1,3-Dichlorobenzene	<1.0		50.0	47.9		ug/L		96	70 - 120	1	20
p-Isopropyltoluene	<1.0		50.0	50.6		ug/L		101	70 - 120	2	20
1,4-Dichlorobenzene	<1.0		50.0	46.4		ug/L		93	75 - 120	0	20
n-Butylbenzene	<1.0		50.0	48.8		ug/L		98	75 - 120	2	20
1,2-Dichlorobenzene	<1.0		50.0	46.7		ug/L		93	75 - 120	2	20
1,2-Dibromo-3-Chloropropane	<2.0		50.0	41.2		ug/L		82	60 - 121	4	20

TestAmerica Chicago



QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Method: 8260B - VOC (Continued)

Lab Sample ID: 500-57291-1 MSD
Matrix: Water
Analysis Batch: 187369

Client Sample ID: RFW-1A
Prep Type: Total/NA

Analyte	Sample	Sample	Spike	MSD	MSD	Unit	D	%Rec	%Rec.	RPD	Limit
	Result	Qualifier	Added	Result	Qualifier				Limits		
1,2,4-Trichlorobenzene	<1.0		50.0	39.0		ug/L		78	65 - 121	6	20
Hexachlorobutadiene	<1.0		50.0	42.9		ug/L		86	65 - 135	8	20
Naphthalene	<1.0		50.0	38.0		ug/L		76	55 - 132	5	20
1,2,3-Trichlorobenzene	<1.0		50.0	35.4		ug/L		71	56 - 137	8	20

Surrogate	MSD	MSD	Limits
	%Recovery	Qualifier	
1,2-Dichloroethane-d4 (Surr)	83		75 - 125
Toluene-d8 (Surr)	100		75 - 120
4-Bromofluorobenzene (Surr)	99		75 - 120
Dibromofluoromethane	95		75 - 120

Lab Sample ID: MB 500-187605/6
Matrix: Water
Analysis Batch: 187605

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Benzene	<0.50		0.50	0.074	ug/L			05/28/13 10:36	1
Dichlorodifluoromethane	<1.0		1.0	0.20	ug/L			05/28/13 10:36	1
Chloromethane	<1.0		1.0	0.18	ug/L			05/28/13 10:36	1
Vinyl chloride	<0.50		0.50	0.10	ug/L			05/28/13 10:36	1
Bromomethane	<1.0		1.0	0.31	ug/L			05/28/13 10:36	1
Chloroethane	<1.0		1.0	0.34	ug/L			05/28/13 10:36	1
Trichlorofluoromethane	<1.0		1.0	0.19	ug/L			05/28/13 10:36	1
1,1-Dichloroethene	<1.0		1.0	0.31	ug/L			05/28/13 10:36	1
Carbon disulfide	<5.0		5.0	0.43	ug/L			05/28/13 10:36	1
Acetone	<5.0		5.0	1.3	ug/L			05/28/13 10:36	1
Methylene Chloride	<5.0		5.0	0.68	ug/L			05/28/13 10:36	1
trans-1,2-Dichloroethene	<1.0		1.0	0.25	ug/L			05/28/13 10:36	1
1,1-Dichloroethane	<1.0		1.0	0.19	ug/L			05/28/13 10:36	1
2,2-Dichloropropane	<1.0		1.0	0.32	ug/L			05/28/13 10:36	1
cis-1,2-Dichloroethene	<1.0		1.0	0.12	ug/L			05/28/13 10:36	1
Methyl Ethyl Ketone	<5.0		5.0	1.5	ug/L			05/28/13 10:36	1
Bromochloromethane	<1.0		1.0	0.40	ug/L			05/28/13 10:36	1
Chloroform	<1.0		1.0	0.20	ug/L			05/28/13 10:36	1
1,1,1-Trichloroethane	<1.0		1.0	0.20	ug/L			05/28/13 10:36	1
1,1-Dichloropropene	<1.0		1.0	0.34	ug/L			05/28/13 10:36	1
Carbon tetrachloride	<1.0		1.0	0.26	ug/L			05/28/13 10:36	1
1,2-Dichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 10:36	1
Trichloroethene	<0.50		0.50	0.19	ug/L			05/28/13 10:36	1
1,2-Dichloropropane	<1.0		1.0	0.20	ug/L			05/28/13 10:36	1
Dibromomethane	<1.0		1.0	0.33	ug/L			05/28/13 10:36	1
Bromodichloromethane	<1.0		1.0	0.17	ug/L			05/28/13 10:36	1
cis-1,3-Dichloropropene	<1.0		1.0	0.18	ug/L			05/28/13 10:36	1
methyl isobutyl ketone	<5.0		5.0	0.33	ug/L			05/28/13 10:36	1
Toluene	<0.50		0.50	0.11	ug/L			05/28/13 10:36	1
trans-1,3-Dichloropropene	<1.0		1.0	0.21	ug/L			05/28/13 10:36	1
1,1,2-Trichloroethane	<1.0		1.0	0.28	ug/L			05/28/13 10:36	1
Tetrachloroethene	<1.0		1.0	0.17	ug/L			05/28/13 10:36	1

TestAmerica Chicago



QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Method: 8260B - VOC (Continued)

Lab Sample ID: MB 500-187605/6
Matrix: Water
Analysis Batch: 187605

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB MB		RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
1,3-Dichloropropane	<1.0		1.0	0.13	ug/L			05/28/13 10:36	1
2-Hexanone	<5.0		5.0	0.56	ug/L			05/28/13 10:36	1
Dibromochloromethane	<1.0		1.0	0.32	ug/L			05/28/13 10:36	1
1,2-Dibromoethane	<1.0		1.0	0.36	ug/L			05/28/13 10:36	1
Chlorobenzene	<1.0		1.0	0.14	ug/L			05/28/13 10:36	1
1,1,1,2-Tetrachloroethane	<1.0		1.0	0.25	ug/L			05/28/13 10:36	1
Ethylbenzene	<0.50		0.50	0.13	ug/L			05/28/13 10:36	1
m&p-Xylene	<1.0		1.0	0.26	ug/L			05/28/13 10:36	1
o-Xylene	<0.50		0.50	0.068	ug/L			05/28/13 10:36	1
Styrene	<1.0		1.0	0.10	ug/L			05/28/13 10:36	1
Bromoform	<1.0		1.0	0.28	ug/L			05/28/13 10:36	1
Isopropylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 10:36	1
Bromobenzene	<1.0		1.0	0.25	ug/L			05/28/13 10:36	1
1,1,2,2-Tetrachloroethane	<1.0		1.0	0.23	ug/L			05/28/13 10:36	1
1,2,3-Trichloropropane	<1.0		1.0	0.45	ug/L			05/28/13 10:36	1
N-Propylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 10:36	1
2-Chlorotoluene	<1.0		1.0	0.21	ug/L			05/28/13 10:36	1
1,3,5-Trimethylbenzene	<1.0		1.0	0.18	ug/L			05/28/13 10:36	1
4-Chlorotoluene	<1.0		1.0	0.20	ug/L			05/28/13 10:36	1
tert-Butylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 10:36	1
1,2,4-Trimethylbenzene	<1.0		1.0	0.14	ug/L			05/28/13 10:36	1
sec-Butylbenzene	<1.0		1.0	0.15	ug/L			05/28/13 10:36	1
1,3-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 10:36	1
p-Isopropyltoluene	<1.0		1.0	0.17	ug/L			05/28/13 10:36	1
1,4-Dichlorobenzene	<1.0		1.0	0.15	ug/L			05/28/13 10:36	1
n-Butylbenzene	<1.0		1.0	0.13	ug/L			05/28/13 10:36	1
1,2-Dichlorobenzene	<1.0		1.0	0.27	ug/L			05/28/13 10:36	1
1,2-Dibromo-3-Chloropropane	<2.0		2.0	0.87	ug/L			05/28/13 10:36	1
1,2,4-Trichlorobenzene	<1.0		1.0	0.31	ug/L			05/28/13 10:36	1
Hexachlorobutadiene	<1.0		1.0	0.26	ug/L			05/28/13 10:36	1
Naphthalene	<1.0		1.0	0.16	ug/L			05/28/13 10:36	1
1,2,3-Trichlorobenzene	<1.0		1.0	0.24	ug/L			05/28/13 10:36	1

Surrogate	MB MB		Limits	Prepared	Analyzed	Dil Fac
	%Recovery	Qualifier				
1,2-Dichloroethane-d4 (Surr)	85		75 - 125		05/28/13 10:36	1
Toluene-d8 (Surr)	98		75 - 120		05/28/13 10:36	1
4-Bromofluorobenzene (Surr)	103		75 - 120		05/28/13 10:36	1
Dibromofluoromethane	87		75 - 120		05/28/13 10:36	1

Lab Sample ID: LCS 500-187605/4
Matrix: Water
Analysis Batch: 187605

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec.
							Limits
Benzene	50.0	45.4		ug/L		91	70 - 120
Dichlorodifluoromethane	50.0	41.2		ug/L		82	40 - 140
Chloromethane	50.0	38.8		ug/L		78	50 - 134
Vinyl chloride	50.0	40.4		ug/L		81	62 - 138

TestAmerica Chicago

QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1



Method: 8260B - VOC (Continued)

Lab Sample ID: LCS 500-187605/4
Matrix: Water
Analysis Batch: 187605

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike	LCS	LCS	Unit	D	%Rec	%Rec. Limits
	Added	Result	Qualifier				
Bromomethane	50.0	49.3		ug/L		99	50 - 150
Chloroethane	50.0	40.3		ug/L		81	50 - 150
Trichlorofluoromethane	50.0	49.9		ug/L		100	63 - 134
1,1-Dichloroethene	50.0	45.4		ug/L		91	58 - 122
Carbon disulfide	50.0	48.7		ug/L		97	50 - 120
Acetone	50.0	38.6		ug/L		77	46 - 153
Methylene Chloride	50.0	44.7		ug/L		89	65 - 125
trans-1,2-Dichloroethene	50.0	47.9		ug/L		96	70 - 124
1,1-Dichloroethane	50.0	43.7		ug/L		87	68 - 121
2,2-Dichloropropane	50.0	52.3		ug/L		105	67 - 125
cis-1,2-Dichloroethene	50.0	46.9		ug/L		94	70 - 120
Methyl Ethyl Ketone	50.0	30.4		ug/L		61	54 - 138
Bromochloromethane	50.0	45.1		ug/L		90	67 - 122
Chloroform	50.0	45.8		ug/L		92	70 - 120
1,1,1-Trichloroethane	50.0	51.6		ug/L		103	70 - 123
1,1-Dichloropropene	50.0	49.0		ug/L		98	70 - 120
Carbon tetrachloride	50.0	52.2		ug/L		104	70 - 125
1,2-Dichloroethane	50.0	39.3		ug/L		79	69 - 120
Trichloroethene	50.0	48.1		ug/L		96	70 - 120
1,2-Dichloropropane	50.0	43.2		ug/L		86	70 - 120
Dibromomethane	50.0	43.4		ug/L		87	70 - 120
Bromodichloromethane	50.0	46.8		ug/L		94	70 - 120
cis-1,3-Dichloropropene	50.0	47.7		ug/L		95	70 - 120
methyl isobutyl ketone	50.0	33.8		ug/L		68	59 - 135
Toluene	50.0	47.4		ug/L		95	70 - 120
trans-1,3-Dichloropropene	50.0	52.2		ug/L		104	70 - 120
1,1,2-Trichloroethane	50.0	44.8		ug/L		90	69 - 120
Tetrachloroethene	50.0	48.5		ug/L		97	70 - 123
1,3-Dichloropropane	50.0	41.3		ug/L		83	70 - 120
2-Hexanone	50.0	36.2		ug/L		72	55 - 144
Dibromochloromethane	50.0	45.3		ug/L		91	70 - 120
1,2-Dibromoethane	50.0	43.7		ug/L		87	70 - 120
Chlorobenzene	50.0	46.1		ug/L		92	70 - 120
1,1,1,2-Tetrachloroethane	50.0	44.7		ug/L		89	75 - 120
Ethylbenzene	50.0	47.8		ug/L		96	75 - 120
m&p-Xylene	50.0	46.8		ug/L		94	75 - 120
o-Xylene	50.0	45.3		ug/L		91	70 - 120
Styrene	50.0	45.6		ug/L		91	75 - 120
Bromoform	50.0	44.2		ug/L		88	70 - 125
Isopropylbenzene	50.0	50.6		ug/L		101	70 - 120
Bromobenzene	50.0	50.1		ug/L		100	70 - 120
1,1,2,2-Tetrachloroethane	50.0	42.7		ug/L		85	70 - 128
1,2,3-Trichloropropane	50.0	46.8		ug/L		94	70 - 120
N-Propylbenzene	50.0	51.4		ug/L		103	70 - 120
2-Chlorotoluene	50.0	49.3		ug/L		99	70 - 120
1,3,5-Trimethylbenzene	50.0	49.9		ug/L		100	75 - 123
4-Chlorotoluene	50.0	50.0		ug/L		100	70 - 120
tert-Butylbenzene	50.0	50.1		ug/L		100	70 - 120

TestAmerica Chicago

QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Method: 8260B - VOC (Continued)

Lab Sample ID: LCS 500-187605/4

Client Sample ID: Lab Control Sample

Matrix: Water

Prep Type: Total/NA

Analysis Batch: 187605

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec.	Limits
1,2,4-Trimethylbenzene	50.0	48.1		ug/L		96	75 - 121	
sec-Butylbenzene	50.0	50.4		ug/L		101	70 - 120	
1,3-Dichlorobenzene	50.0	47.7		ug/L		95	70 - 120	
p-Isopropyltoluene	50.0	50.0		ug/L		100	70 - 120	
1,4-Dichlorobenzene	50.0	46.4		ug/L		93	75 - 120	
n-Butylbenzene	50.0	50.2		ug/L		100	75 - 120	
1,2-Dichlorobenzene	50.0	46.8		ug/L		94	75 - 120	
1,2-Dibromo-3-Chloropropane	50.0	41.1		ug/L		82	60 - 121	
1,2,4-Trichlorobenzene	50.0	44.0		ug/L		88	65 - 121	
Hexachlorobutadiene	50.0	47.9		ug/L		96	65 - 135	
Naphthalene	50.0	40.3		ug/L		81	55 - 132	
1,2,3-Trichlorobenzene	50.0	40.3		ug/L		81	56 - 137	

Surrogate	LCS LCS		Limits
	%Recovery	Qualifier	
1,2-Dichloroethane-d4 (Surr)	84		75 - 125
Toluene-d8 (Surr)	94		75 - 120
4-Bromofluorobenzene (Surr)	101		75 - 120
Dibromofluoromethane	95		75 - 120



Lab Chronicle

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1



Client Sample ID: RFW-1A

Lab Sample ID: 500-57291-1

Date Collected: 05/20/13 09:10

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 10:40	BDA	TAL CHI

Client Sample ID: RFW-1B

Lab Sample ID: 500-57291-2

Date Collected: 05/20/13 18:00

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 11:05	BDA	TAL CHI

Client Sample ID: RFW-2A

Lab Sample ID: 500-57291-3

Date Collected: 05/20/13 08:00

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 11:29	BDA	TAL CHI

Client Sample ID: RFW-2B

Lab Sample ID: 500-57291-4

Date Collected: 05/20/13 08:20

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 11:54	BDA	TAL CHI

Client Sample ID: RFW-3B

Lab Sample ID: 500-57291-5

Date Collected: 05/20/13 14:45

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 12:18	BDA	TAL CHI

Client Sample ID: RFW-4A

Lab Sample ID: 500-57291-6

Date Collected: 05/21/13 09:15

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 12:43	BDA	TAL CHI

TestAmerica Chicago

Lab Chronicle

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-4A DUP

Lab Sample ID: 500-57291-7

Date Collected: 05/21/13 09:15

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 13:07	BDA	TAL CHI

Client Sample ID: RFW-4B

Lab Sample ID: 500-57291-8

Date Collected: 05/21/13 08:45

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 13:32	BDA	TAL CHI

Client Sample ID: RFW-6

Lab Sample ID: 500-57291-9

Date Collected: 05/20/13 17:40

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 13:56	BDA	TAL CHI

Client Sample ID: RFW-7

Lab Sample ID: 500-57291-10

Date Collected: 05/20/13 11:05

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 14:21	BDA	TAL CHI

Client Sample ID: RFW-9

Lab Sample ID: 500-57291-11

Date Collected: 05/20/13 16:45

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 14:45	BDA	TAL CHI

Client Sample ID: RFW-11B

Lab Sample ID: 500-57291-12

Date Collected: 05/20/13 17:35

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 15:10	BDA	TAL CHI

TestAmerica Chicago

Lab Chronicle

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: RFW-12B

Lab Sample ID: 500-57291-13

Date Collected: 05/21/13 11:10

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 15:34	BDA	TAL CHI

Client Sample ID: RFW-13

Lab Sample ID: 500-57291-14

Date Collected: 05/20/13 16:05

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 15:59	BDA	TAL CHI

Client Sample ID: RFW-17

Lab Sample ID: 500-57291-15

Date Collected: 05/20/13 12:00

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 16:24	BDA	TAL CHI

Client Sample ID: Trip Blank

Lab Sample ID: 500-57291-16

Date Collected: 05/20/13 06:00

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 16:48	BDA	TAL CHI

Client Sample ID: EW-2

Lab Sample ID: 500-57291-17

Date Collected: 05/21/13 12:00

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 17:13	BDA	TAL CHI

Client Sample ID: EW-3

Lab Sample ID: 500-57291-18

Date Collected: 05/21/13 11:15

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 18:02	BDA	TAL CHI

TestAmerica Chicago

Lab Chronicle

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-4

Lab Sample ID: 500-57291-19

Date Collected: 05/21/13 11:50

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187369	05/24/13 18:27	BDA	TAL CHI
Total/NA	Analysis	8260B	DL	10	187369	05/24/13 18:52	BDA	TAL CHI

Client Sample ID: EW-5

Lab Sample ID: 500-57291-20

Date Collected: 05/21/13 11:00

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187605	05/28/13 15:07	BDA	TAL CHI

Client Sample ID: EW-6

Lab Sample ID: 500-57291-21

Date Collected: 05/21/13 09:15

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187605	05/28/13 15:31	BDA	TAL CHI

Client Sample ID: EW-7

Lab Sample ID: 500-57291-22

Date Collected: 05/21/13 09:05

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187605	05/28/13 15:56	BDA	TAL CHI

Client Sample ID: EW-8

Lab Sample ID: 500-57291-23

Date Collected: 05/21/13 09:00

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187605	05/28/13 16:20	BDA	TAL CHI

Client Sample ID: EW-9

Lab Sample ID: 500-57291-24

Date Collected: 05/21/13 08:50

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187605	05/28/13 16:45	BDA	TAL CHI

TestAmerica Chicago

Lab Chronicle

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Client Sample ID: EW-9 DUP

Lab Sample ID: 500-57291-25

Date Collected: 05/21/13 08:50

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187605	05/28/13 17:09	BDA	TAL CHI

Client Sample ID: EW-10

Lab Sample ID: 500-57291-26

Date Collected: 05/21/13 08:40

Matrix: Water

Date Received: 05/22/13 10:10

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	8260B		1	187605	05/28/13 17:34	BDA	TAL CHI

Laboratory References:

TAL CHI = TestAmerica Chicago, 2417 Bond Street, University Park, IL 60484, TEL (708)534-5200



Certification Summary

Client: Weston Solutions, Inc.
Project/Site: Black and Decker

TestAmerica Job ID: 500-57291-1

Laboratory: TestAmerica Chicago

All certifications held by this laboratory are listed. Not all certifications are applicable to this report.

Authority	Program	EPA Region	Certification ID	Expiration Date
Alabama	State Program	4	40461	05-31-13
California	NELAP	9	01132CA	04-30-14
Georgia	State Program	4	N/A	04-30-14
Georgia	State Program	4	939	04-30-14
Hawaii	State Program	9	N/A	04-30-14
Illinois	NELAP	5	100201	04-30-14
Indiana	State Program	5	C-IL-02	04-30-14
Iowa	State Program	7	82	05-01-14
Kansas	NELAP	7	E-10161	10-31-13
Kentucky	State Program	4	90023	12-31-13
Kentucky (UST)	State Program	4	66	04-30-14
Louisiana	NELAP	6	30720	06-30-13
Massachusetts	State Program	1	M-IL035	06-30-13
Mississippi	State Program	4	N/A	04-30-14
North Carolina DENR	State Program	4	291	12-31-13
North Dakota	State Program	8	R-194	04-30-14
Oklahoma	State Program	6	8908	08-31-13
South Carolina	State Program	4	77001	05-31-13 *
Texas	NELAP	6	T104704252-09-TX	02-28-14
USDA	Federal		P330-12-00038	02-06-15
Virginia	NELAP	3	460142	06-14-13
Wisconsin	State Program	5	999580010	08-31-13
Wyoming	State Program	8	8TMS-Q	07-15-13

* Expired certification is currently pending renewal and is considered valid.



TestAmerica

THE LEADER IN ENVIRONMENTAL

2417 Bond Street, University Park, IL 604
Phone: 708.534.5200 Fax: 708.534.



500-57291 COC

Report To (optional)
Contact: _____
Company: _____
Address: _____
Address: _____
Phone: _____
Fax: _____
E-Mail: _____

Bill To (optional)
Contact: _____
Company: _____
Address: _____
Address: _____
Phone: _____
Fax: _____
PO#/Reference# _____

Chain of Custody Record

Lab Job #: 500-57291
Chain of Custody Number: _____
Page 1 of 3
Temperature °C of Cooler: 22

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14
- 15

Client		Client Project #		Preservative		Parameter		Matrix		Preservative Key 1. HCL, Cool to 4° 2. H2SO4, Cool to 4° 3. HNO3, Cool to 4° 4. NaOH, Cool to 4° 5. NaOH/Zn, Cool to 4° 6. NaHSO4 7. Cool to 4° 8. None 9. Other
Western Solutions		02501.004.004		HCl						
Project Name Black + Decker		Lab Project #								
Project Location/State Hampstead, MD		Lab PM Dick Wright								
Lab ID	MS/MSD	Sample ID	Sampling		# of Containers	Matrix				
			Date	Time						
1		RFW-1A	5/20	910	3 W	VOA				
2		RFW-1B		1200						
3		RFW-2A		800						
4		RFW-2B		820						
5		RFW-3B		1445						
6		RFW-4A	5/21	915						
7		RFW-4A Dup	5/21	915						
8		RFW-4B	5/21	845						
9		RFW-6	5/20	1740						
10		RFW-7	5/20	1105						

Turnaround Time Required (Business Days)
 1 Day 2 Days 5 Days 7 Days 10 Days 15 Days Other _____

Requested Due Date _____

Sample Disposal
 Return to Client Disposal by Lab Archive for _____ Months (A fee may be assessed if samples are retained longer than 1 month)

Relinquished By: <u>[Signature]</u> Company: <u>Western</u> Date: <u>5/21/13</u> Time: <u>1630</u>	Received By: <u>[Signature]</u> Company: <u>Fed Ex</u> Date: _____ Time: _____
Relinquished By: _____ Company: _____ Date: _____ Time: _____	Received By: <u>[Signature]</u> Company: <u>FA-CPT</u> Date: <u>5/22/13</u> Time: <u>1010</u>
Relinquished By: _____ Company: _____ Date: _____ Time: _____	Received By: _____ Company: _____ Date: _____ Time: _____

Lab Courier: _____
Shipped: Fed Ex
Hand Delivered: _____

- Matrix Key
- WW - Wastewater
 - W - Water
 - S - Soil
 - SL - Sludge
 - MS - Miscellaneous
 - OL - Oil
 - A - Air
 - SE - Sediment
 - SO - Soil
 - L - Leachate
 - WI - Wipe
 - DW - Drinking Water
 - O - Other

Client Comments: _____

Lab Comments: _____

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

2417 Bond Street, University Park, IL 60484
Phone: 708.534.5200 Fax: 708.534.5211

Report To _____ (optional)	Bill To _____ (optional)
Contact: _____	Contact: _____
Company: _____	Company: _____
Address: _____	Address: _____
Address: _____	Address: _____
Phone: _____	Phone: _____
Fax: _____	Fax: _____
E-Mail: _____	PO#/Reference# _____

Chain of Custody Record

Lab Job #: 500-57291

Chain of Custody Number: _____

Page 2 of 3

Temperature °C of Cooler: 2.2

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14
- 15

Client		Client Project #		Preservative		Parameter		Matrix		Preservative Key 1. HCL, Cool to 4° 2. H2SO4, Cool to 4° 3. HNO3, Cool to 4° 4. NaOH, Cool to 4° 5. NaOH/Zn, Cool to 4° 6. NaHSO4 7. Cool to 4° 8. None 9. Other
Weston				HCl						
Project Name Black & Decker										
Project Location/State		Lab Project #								
Sampler Greg Flawski		Lab PM Dick Wright								Comments
Lab ID	MS/MSCL	Sample ID		Sampling		# of Containers	Matrix			
		Date	Time							
11		RFW-9	5/20	1645	3	W	VOA	✓		
12		RFW-11B	5/20	1735	1			✓		
13		RFW-12B	5/21	1110	1					
14		RFW-13	5/20	1605	1			✓		
15		RFW-17	5/20	1200	1			✓		
16		Trip Blank	5/20	600	2			✓		

Turnaround Time Required (Business Days)
 1 Day 2 Days 5 Days 7 Days 10 Days 15 Days Other

Requested Due Date _____

Sample Disposal: Return to Client Disposal by Lab Archive for _____ Months (A fee may be assessed if samples are retained longer than 1 month)

Relinquished By: <u>[Signature]</u>	Company: <u>Weston</u>	Date: <u>5/21/13</u>	Time: <u>1630</u>	Received By: <u>Fed Ex</u>	Company: <u>JA-CHT</u>	Date: <u>5/22/13</u>	Time: <u>1010</u>
Relinquished By: _____	Company: _____	Date: _____	Time: _____	Received By: _____	Company: _____	Date: _____	Time: _____
Relinquished By: _____	Company: _____	Date: _____	Time: _____	Received By: _____	Company: _____	Date: _____	Time: _____

Lab Courier: _____

Shipped: FedEx

Hand Delivered: _____

- Matrix Key
- WW - Wastewater
 - W - Water
 - S - Soil
 - SL - Sludge
 - MS - Miscellaneous
 - OL - Oil
 - A - Air
 - SE - Sediment
 - SO - Soil
 - L - Leachate
 - WI - Wipe
 - DW - Drinking Water
 - O - Other

Client Comments: _____

Lab Comments: _____

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

2417 Bond Street, University Park, IL 60484
 Phone: 708.534.5200 Fax: 708.534.5211

Report To (optional)
 Contact: _____
 Company: _____
 Address: _____
 Address: _____
 Phone: _____
 Fax: _____
 E-Mail: _____

Bill To (optional)
 Contact: _____
 Company: _____
 Address: _____
 Address: _____
 Phone: _____
 Fax: _____
 PO#/Reference# _____

Chain of Custody Record

Lab Job #: 500-57291
 Chain of Custody Number: _____
 Page 3 of 3
 Temperature °C of Cooler: 2.2



Client		Client Project #		Preservative		Parameter		Matrix		Preservative Key
Western				HCl				VOA		
Project Name		Lab Project #		Date		Time		# of Containers		Comments
Black + Decker										
Project Location/State		Lab PM		Date		Time		# of Containers		Comments
Sampler		Lab PM		Date		Time		# of Containers		Comments
Greg Fasuski										
Lab ID	MS/MSD	Sample ID	Date	Time	# of Containers	Matrix	Preservative	Parameter	Matrix	Comments
17		EW-2	5/31/13	1200	3	W	✓			
18		EW-3		1115			✓			
19		EW-4		1150			✓			
20		EW-5		1100			✓			
21		EW-6		915			✓			
22		EW-7		905			✓			
23		EW-8		900			✓			
24		EW-9		850			✓			
25		EW-9 Dup		850			✓			
26		EW-10		840			✓			

- Preservative Key
1. HCL, Cool to 4°
 2. H2SO4, Cool to 4°
 3. HNO3, Cool to 4°
 4. NaOH, Cool to 4°
 5. NaOH/Zn, Cool to 4°
 6. NaHSO4
 7. Cool to 4°
 8. None
 9. Other

Turnaround Time Required (Business Days)

1 Day 2 Days 5 Days 7 Days 10 Days 15 Days Other

Sample Disposal

Return to Client Disposal by Lab Archive for _____ Months (A fee may be assessed if samples are retained longer than 1 month)

Relinquished By: <u>[Signature]</u>	Company: Western	Date: 5/31/13	Time: 1630	Received By: <u>[Signature]</u>	Company: JA-CHS	Date: 5/22/13	Time: 1010
Relinquished By:	Company:	Date:	Time:	Received By:	Company:	Date:	Time:
Relinquished By:	Company:	Date:	Time:	Received By:	Company:	Date:	Time:

Lab Courier: _____
 Shipped: Fed-X
 Hand Delivered: _____

- Matrix Key
- WW - Wastewater
 - W - Water
 - S - Soil
 - SL - Sludge
 - MS - Miscellaneous
 - OL - Oil
 - A - Air
 - SE - Sediment
 - SO - Soil
 - L - Leachate
 - WI - Wipe
 - DW - Drinking Water
 - O - Other

Client Comments:

Lab Comments:

Login Sample Receipt Checklist

Client: Weston Solutions, Inc.

Job Number: 500-57291-1

Login Number: 57291

List Source: TestAmerica Chicago

List Number: 1

Creator: Scott, Sherri L

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	True	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	2.2
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	False	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	False	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	



TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

ANALYTICAL REPORT

TestAmerica Laboratories, Inc.
TestAmerica Savannah
5102 LaRoche Avenue
Savannah, GA 31404
Tel: (912)354-7858

TestAmerica Job ID: 680-90584-1
Client Project/Site: Black & Decker

For:
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, Pennsylvania 19380

Attn: Greg Flasinski

Kathryn Smith

Authorized for release by:
6/5/2013 4:46:47 PM
Kathryn Smith, Project Manager II
(912)354-7858
kathy.smith@testamericainc.com

Designee for

Lisa Harvey, Project Manager II
lisa.harvey@testamericainc.com

LINKS

Review your project
results through

Total Access

Have a Question?

**Ask
The
Expert**

Visit us at:

www.testamericainc.com

The test results in this report meet all 2003 NELAC and 2009 TNI requirements for accredited parameters, exceptions are noted in this report. This report may not be reproduced except in full, and with written approval from the laboratory. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

Case Narrative

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Job ID: 680-90584-1

Laboratory: TestAmerica Savannah

Narrative

CASE NARRATIVE

Client: Weston Solutions, Inc.

Project: Black & Decker

Report Number: 680-90584-1

With the exceptions noted as flags or footnotes, standard analytical protocols were followed in the analysis of the samples and no problems were encountered or anomalies observed. In addition all laboratory quality control samples were within established control limits, with any exceptions noted below. Each sample was analyzed to achieve the lowest possible reporting limit within the constraints of the method. In some cases, due to interference or analytes present at high concentrations, samples were diluted. For diluted samples, the reporting limits are adjusted relative to the dilution required.

Calculations are performed before rounding to avoid round-off errors in calculated results.

All holding times were met and proper preservation noted for the methods performed on these samples, unless otherwise detailed in the individual sections below.

RECEIPT

The samples were received on 05/22/2013; the samples arrived in good condition, properly preserved and on ice. The temperature of the coolers at receipt was 3.0 C.

VOLATILE ORGANIC COMPOUNDS (GC-MS)


Samples RFW-20 (680-90584-1), RFW-21 (680-90584-2), HAMP-22 (680-90584-3), HAMP-23 (680-90584-4) and Trip Blank (680-90584-5) were analyzed for Volatile organic Compounds (GC-MS) in accordance with EPA Method 524.2. The samples were analyzed on 06/02/2013.

The following sample(s) was received with headspace in the sample vial: RFW-20 (680-90584-1). All of the sample vials have headspace in them.

1,2,3-Trichlorobenzene and 1,2,4-Trichlorobenzene failed the recovery criteria low for LCSD 680-278828/4. Refer to the QC report for details.

No other difficulties were encountered during the volatiles analysis.

All other quality control parameters were within the acceptance limits.



Sample Summary

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-90584-1	RFW-20	Water	05/20/13 18:10	05/22/13 09:59
680-90584-2	RFW-21	Water	05/20/13 12:55	05/22/13 09:59
680-90584-3	HAMP-22	Water	05/21/13 10:00	05/22/13 09:59
680-90584-4	HAMP-23	Water	05/21/13 10:05	05/22/13 09:59
680-90584-5	Trip Blank	Water	05/21/13 08:00	05/22/13 09:59



Method Summary

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1


Method	Method Description	Protocol	Laboratory
524.2	Volatile Organic Compounds (GC/MS)	EPA-DW	TAL SAV

Protocol References:

EPA-DW = "Methods For The Determination Of Organic Compounds In Drinking Water", EPA/600/4-88/039, December 1988 And Its Supplements.

Laboratory References:

TAL SAV = TestAmerica Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858



Definitions/Glossary

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Qualifiers

GC/MS VOA

Qualifier	Qualifier Description
*	LCS or LCSD exceeds the control limits
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
□	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CNF	Contains no Free Liquid
DER	Duplicate error ratio (normalized absolute difference)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision level concentration
MDA	Minimum detectable activity
EDL	Estimated Detection Limit
MDC	Minimum detectable concentration
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
ND	Not detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative error ratio
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Client Sample ID: RFW-20

Lab Sample ID: 680-90584-1

Date Collected: 05/20/13 18:10

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Acetone	<10		10	5.0	ug/L			06/02/13 20:09	1
Benzene	<0.50		0.50	0.18	ug/L			06/02/13 20:09	1
Bromobenzene	<0.50		0.50	0.42	ug/L			06/02/13 20:09	1
Bromoform	<0.50		0.50	0.39	ug/L			06/02/13 20:09	1
Bromomethane	<1.0		1.0	0.45	ug/L			06/02/13 20:09	1
Carbon tetrachloride	<0.50		0.50	0.22	ug/L			06/02/13 20:09	1
Chlorobenzene	<0.50		0.50	0.27	ug/L			06/02/13 20:09	1
Chlorobromomethane	<0.50		0.50	0.30	ug/L			06/02/13 20:09	1
Chlorodibromomethane	<0.50		0.50	0.43	ug/L			06/02/13 20:09	1
Chloroethane	<1.0		1.0	0.33	ug/L			06/02/13 20:09	1
Chloroform	<0.50		0.50	0.29	ug/L			06/02/13 20:09	1
Chloromethane	<0.50		0.50	0.32	ug/L			06/02/13 20:09	1
2-Chlorotoluene	<0.50		0.50	0.17	ug/L			06/02/13 20:09	1
4-Chlorotoluene	<0.50		0.50	0.16	ug/L			06/02/13 20:09	1
cis-1,2-Dichloroethene	<0.50		0.50	0.37	ug/L			06/02/13 20:09	1
cis-1,3-Dichloropropene	<0.50		0.50	0.32	ug/L			06/02/13 20:09	1
1,2-Dibromo-3-Chloropropane	<0.50		0.50	0.30	ug/L			06/02/13 20:09	1
Dibromomethane	<0.50		0.50	0.38	ug/L			06/02/13 20:09	1
1,2-Dichlorobenzene	<0.50		0.50	0.17	ug/L			06/02/13 20:09	1
1,3-Dichlorobenzene	<0.50		0.50	0.14	ug/L			06/02/13 20:09	1
1,4-Dichlorobenzene	<0.50		0.50	0.18	ug/L			06/02/13 20:09	1
Dichlorobromomethane	<0.50		0.50	0.10	ug/L			06/02/13 20:09	1
Dichlorodifluoromethane	<0.50		0.50	0.34	ug/L			06/02/13 20:09	1
1,1-Dichloroethane	<0.50		0.50	0.39	ug/L			06/02/13 20:09	1
1,2-Dichloroethane	<0.50		0.50	0.17	ug/L			06/02/13 20:09	1
1,1-Dichloroethene	<0.50		0.50	0.32	ug/L			06/02/13 20:09	1
1,2-Dichloropropane	<0.50		0.50	0.45	ug/L			06/02/13 20:09	1
1,3-Dichloropropane	<0.50		0.50	0.43	ug/L			06/02/13 20:09	1
2,2-Dichloropropane	<0.50		0.50	0.31	ug/L			06/02/13 20:09	1
1,1-Dichloropropene	<0.50		0.50	0.19	ug/L			06/02/13 20:09	1
1,3-Dichloropropene, Total	<0.50		0.50	0.32	ug/L			06/02/13 20:09	1
Diisopropyl ether	<0.50		0.50	0.28	ug/L			06/02/13 20:09	1
Ethylbenzene	<0.50		0.50	0.12	ug/L			06/02/13 20:09	1
Ethylene Dibromide	<0.50		0.50	0.20	ug/L			06/02/13 20:09	1
Freon 113	<0.50		0.50	0.15	ug/L			06/02/13 20:09	1
Hexachlorobutadiene	<0.50		0.50	0.26	ug/L			06/02/13 20:09	1
2-Hexanone	<10		10	5.0	ug/L			06/02/13 20:09	1
Isopropylbenzene	<0.50		0.50	0.15	ug/L			06/02/13 20:09	1
4-Isopropyltoluene	<0.50		0.50	0.21	ug/L			06/02/13 20:09	1
Methylene Chloride	<0.50		0.50	0.36	ug/L			06/02/13 20:09	1
2-Butanone (MEK)	<10		10	5.0	ug/L			06/02/13 20:09	1
4-Methyl-2-pentanone (MIBK)	<10		10	5.0	ug/L			06/02/13 20:09	1
m-Xylene & p-Xylene	<0.50		0.50	0.42	ug/L			06/02/13 20:09	1
Naphthalene	<1.0		1.0	0.43	ug/L			06/02/13 20:09	1
n-Butylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 20:09	1
N-Propylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 20:09	1
o-Xylene	<0.50		0.50	0.27	ug/L			06/02/13 20:09	1
sec-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 20:09	1
Styrene	<0.50		0.50	0.28	ug/L			06/02/13 20:09	1

TestAmerica Savannah

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Client Sample ID: RFW-20

Lab Sample ID: 680-90584-1

Date Collected: 05/20/13 18:10

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Tert-amyl methyl ether	<0.50		0.50	0.20	ug/L			06/02/13 20:09	1
tert-Butyl alcohol	<2.0		2.0	1.6	ug/L			06/02/13 20:09	1
tert-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 20:09	1
Tert-butyl ethyl ether	<0.50		0.50	0.26	ug/L			06/02/13 20:09	1
1,1,1,2-Tetrachloroethane	<0.50		0.50	0.16	ug/L			06/02/13 20:09	1
1,1,2,2-Tetrachloroethane	<0.50		0.50	0.18	ug/L			06/02/13 20:09	1
Tetrachloroethene	<0.50		0.50	0.30	ug/L			06/02/13 20:09	1
Toluene	<0.50		0.50	0.23	ug/L			06/02/13 20:09	1
trans-1,2-Dichloroethene	<0.50		0.50	0.24	ug/L			06/02/13 20:09	1
trans-1,3-Dichloropropene	<0.50		0.50	0.48	ug/L			06/02/13 20:09	1
1,2,3-Trichlorobenzene	<0.50	*	0.50	0.14	ug/L			06/02/13 20:09	1
1,2,4-Trichlorobenzene	<0.50	*	0.50	0.18	ug/L			06/02/13 20:09	1
1,1,1-Trichloroethane	<0.50		0.50	0.27	ug/L			06/02/13 20:09	1
1,1,2-Trichloroethane	<0.50		0.50	0.22	ug/L			06/02/13 20:09	1
Trichloroethene	0.40	J	0.50	0.37	ug/L			06/02/13 20:09	1
Trichlorofluoromethane	<0.50		0.50	0.23	ug/L			06/02/13 20:09	1
1,2,3-Trichloropropane	<0.50		0.50	0.18	ug/L			06/02/13 20:09	1
Trihalomethanes, Total	<0.50		0.50	0.10	ug/L			06/02/13 20:09	1
1,2,4-Trimethylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 20:09	1
1,3,5-Trimethylbenzene	<0.50		0.50	0.16	ug/L			06/02/13 20:09	1
Vinyl chloride	<0.50		0.50	0.33	ug/L			06/02/13 20:09	1
Xylenes, Total	<0.50		0.50	0.27	ug/L			06/02/13 20:09	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	83		70 - 130					06/02/13 20:09	1
1,2-Dichlorobenzene-d4	72		70 - 130					06/02/13 20:09	1

Client Sample ID: RFW-21

Lab Sample ID: 680-90584-2

Date Collected: 05/20/13 12:55

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Acetone	<10		10	5.0	ug/L			06/02/13 20:36	1
Benzene	<0.50		0.50	0.18	ug/L			06/02/13 20:36	1
Bromobenzene	<0.50		0.50	0.42	ug/L			06/02/13 20:36	1
Bromoform	<0.50		0.50	0.39	ug/L			06/02/13 20:36	1
Bromomethane	<1.0		1.0	0.45	ug/L			06/02/13 20:36	1
Carbon tetrachloride	<0.50		0.50	0.22	ug/L			06/02/13 20:36	1
Chlorobenzene	<0.50		0.50	0.27	ug/L			06/02/13 20:36	1
Chlorobromomethane	<0.50		0.50	0.30	ug/L			06/02/13 20:36	1
Chlorodibromomethane	<0.50		0.50	0.43	ug/L			06/02/13 20:36	1
Chloroethane	<1.0		1.0	0.33	ug/L			06/02/13 20:36	1
Chloroform	<0.50		0.50	0.29	ug/L			06/02/13 20:36	1
Chloromethane	<0.50		0.50	0.32	ug/L			06/02/13 20:36	1
2-Chlorotoluene	<0.50		0.50	0.17	ug/L			06/02/13 20:36	1
4-Chlorotoluene	<0.50		0.50	0.16	ug/L			06/02/13 20:36	1
cis-1,2-Dichloroethene	<0.50		0.50	0.37	ug/L			06/02/13 20:36	1
cis-1,3-Dichloropropene	<0.50		0.50	0.32	ug/L			06/02/13 20:36	1
1,2-Dibromo-3-Chloropropane	<0.50		0.50	0.30	ug/L			06/02/13 20:36	1

TestAmerica Savannah

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Client Sample ID: RFW-21

Lab Sample ID: 680-90584-2

Date Collected: 05/20/13 12:55

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Dibromomethane	<0.50		0.50	0.38	ug/L			06/02/13 20:36	1
1,2-Dichlorobenzene	<0.50		0.50	0.17	ug/L			06/02/13 20:36	1
1,3-Dichlorobenzene	<0.50		0.50	0.14	ug/L			06/02/13 20:36	1
1,4-Dichlorobenzene	<0.50		0.50	0.18	ug/L			06/02/13 20:36	1
Dichlorobromomethane	<0.50		0.50	0.10	ug/L			06/02/13 20:36	1
Dichlorodifluoromethane	<0.50		0.50	0.34	ug/L			06/02/13 20:36	1
1,1-Dichloroethane	<0.50		0.50	0.39	ug/L			06/02/13 20:36	1
1,2-Dichloroethane	<0.50		0.50	0.17	ug/L			06/02/13 20:36	1
1,1-Dichloroethene	<0.50		0.50	0.32	ug/L			06/02/13 20:36	1
1,2-Dichloropropane	<0.50		0.50	0.45	ug/L			06/02/13 20:36	1
1,3-Dichloropropane	<0.50		0.50	0.43	ug/L			06/02/13 20:36	1
2,2-Dichloropropane	<0.50		0.50	0.31	ug/L			06/02/13 20:36	1
1,1-Dichloropropene	<0.50		0.50	0.19	ug/L			06/02/13 20:36	1
1,3-Dichloropropene, Total	<0.50		0.50	0.32	ug/L			06/02/13 20:36	1
Diisopropyl ether	<0.50		0.50	0.28	ug/L			06/02/13 20:36	1
Ethylbenzene	<0.50		0.50	0.12	ug/L			06/02/13 20:36	1
Ethylene Dibromide	<0.50		0.50	0.20	ug/L			06/02/13 20:36	1
Freon 113	<0.50		0.50	0.15	ug/L			06/02/13 20:36	1
Hexachlorobutadiene	<0.50		0.50	0.26	ug/L			06/02/13 20:36	1
2-Hexanone	<10		10	5.0	ug/L			06/02/13 20:36	1
Isopropylbenzene	<0.50		0.50	0.15	ug/L			06/02/13 20:36	1
4-Isopropyltoluene	<0.50		0.50	0.21	ug/L			06/02/13 20:36	1
Methylene Chloride	<0.50		0.50	0.36	ug/L			06/02/13 20:36	1
2-Butanone (MEK)	<10		10	5.0	ug/L			06/02/13 20:36	1
4-Methyl-2-pentanone (MIBK)	<10		10	5.0	ug/L			06/02/13 20:36	1
m-Xylene & p-Xylene	<0.50		0.50	0.42	ug/L			06/02/13 20:36	1
Naphthalene	<1.0		1.0	0.43	ug/L			06/02/13 20:36	1
n-Butylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 20:36	1
N-Propylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 20:36	1
o-Xylene	<0.50		0.50	0.27	ug/L			06/02/13 20:36	1
sec-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 20:36	1
Styrene	<0.50		0.50	0.28	ug/L			06/02/13 20:36	1
Tert-amyl methyl ether	<0.50		0.50	0.20	ug/L			06/02/13 20:36	1
tert-Butyl alcohol	<2.0		2.0	1.6	ug/L			06/02/13 20:36	1
tert-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 20:36	1
Tert-butyl ethyl ether	<0.50		0.50	0.26	ug/L			06/02/13 20:36	1
1,1,1,2-Tetrachloroethane	<0.50		0.50	0.16	ug/L			06/02/13 20:36	1
1,1,2,2-Tetrachloroethane	<0.50		0.50	0.18	ug/L			06/02/13 20:36	1
Tetrachloroethene	<0.50		0.50	0.30	ug/L			06/02/13 20:36	1
Toluene	<0.50		0.50	0.23	ug/L			06/02/13 20:36	1
trans-1,2-Dichloroethene	<0.50		0.50	0.24	ug/L			06/02/13 20:36	1
trans-1,3-Dichloropropene	<0.50		0.50	0.48	ug/L			06/02/13 20:36	1
1,2,3-Trichlorobenzene	<0.50		0.50	0.14	ug/L			06/02/13 20:36	1
1,2,4-Trichlorobenzene	<0.50		0.50	0.18	ug/L			06/02/13 20:36	1
1,1,1-Trichloroethane	<0.50		0.50	0.27	ug/L			06/02/13 20:36	1
1,1,2-Trichloroethane	<0.50		0.50	0.22	ug/L			06/02/13 20:36	1
Trichloroethene	<0.50		0.50	0.37	ug/L			06/02/13 20:36	1
Trichlorofluoromethane	<0.50		0.50	0.23	ug/L			06/02/13 20:36	1
1,2,3-Trichloropropane	<0.50		0.50	0.18	ug/L			06/02/13 20:36	1

TestAmerica Savannah

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Client Sample ID: RFW-21

Lab Sample ID: 680-90584-2

Date Collected: 05/20/13 12:55

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Trihalomethanes, Total	<0.50		0.50	0.10	ug/L			06/02/13 20:36	1
1,2,4-Trimethylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 20:36	1
1,3,5-Trimethylbenzene	<0.50		0.50	0.16	ug/L			06/02/13 20:36	1
Vinyl chloride	<0.50		0.50	0.33	ug/L			06/02/13 20:36	1
Xylenes, Total	<0.50		0.50	0.27	ug/L			06/02/13 20:36	1
Surrogate	%Recovery	Qualifier	Limits				Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	88		70 - 130					06/02/13 20:36	1
1,2-Dichlorobenzene-d4	77		70 - 130					06/02/13 20:36	1

Client Sample ID: HAMP-22

Lab Sample ID: 680-90584-3

Date Collected: 05/21/13 10:00

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Acetone	<10		10	5.0	ug/L			06/02/13 21:03	1
Benzene	<0.50		0.50	0.18	ug/L			06/02/13 21:03	1
Bromobenzene	<0.50		0.50	0.42	ug/L			06/02/13 21:03	1
Bromoform	<0.50		0.50	0.39	ug/L			06/02/13 21:03	1
Bromomethane	<1.0		1.0	0.45	ug/L			06/02/13 21:03	1
Carbon tetrachloride	<0.50		0.50	0.22	ug/L			06/02/13 21:03	1
Chlorobenzene	<0.50		0.50	0.27	ug/L			06/02/13 21:03	1
Chlorobromomethane	<0.50		0.50	0.30	ug/L			06/02/13 21:03	1
Chlorodibromomethane	<0.50		0.50	0.43	ug/L			06/02/13 21:03	1
Chloroethane	<1.0		1.0	0.33	ug/L			06/02/13 21:03	1
Chloroform	<0.50		0.50	0.29	ug/L			06/02/13 21:03	1
Chloromethane	<0.50		0.50	0.32	ug/L			06/02/13 21:03	1
2-Chlorotoluene	<0.50		0.50	0.17	ug/L			06/02/13 21:03	1
4-Chlorotoluene	<0.50		0.50	0.16	ug/L			06/02/13 21:03	1
cis-1,2-Dichloroethene	<0.50		0.50	0.37	ug/L			06/02/13 21:03	1
cis-1,3-Dichloropropene	<0.50		0.50	0.32	ug/L			06/02/13 21:03	1
1,2-Dibromo-3-Chloropropane	<0.50		0.50	0.30	ug/L			06/02/13 21:03	1
Dibromomethane	<0.50		0.50	0.38	ug/L			06/02/13 21:03	1
1,2-Dichlorobenzene	<0.50		0.50	0.17	ug/L			06/02/13 21:03	1
1,3-Dichlorobenzene	<0.50		0.50	0.14	ug/L			06/02/13 21:03	1
1,4-Dichlorobenzene	<0.50		0.50	0.18	ug/L			06/02/13 21:03	1
Dichlorobromomethane	<0.50		0.50	0.10	ug/L			06/02/13 21:03	1
Dichlorodifluoromethane	<0.50		0.50	0.34	ug/L			06/02/13 21:03	1
1,1-Dichloroethane	<0.50		0.50	0.39	ug/L			06/02/13 21:03	1
1,2-Dichloroethane	<0.50		0.50	0.17	ug/L			06/02/13 21:03	1
1,1-Dichloroethene	<0.50		0.50	0.32	ug/L			06/02/13 21:03	1
1,2-Dichloropropane	<0.50		0.50	0.45	ug/L			06/02/13 21:03	1
1,3-Dichloropropane	<0.50		0.50	0.43	ug/L			06/02/13 21:03	1
2,2-Dichloropropane	<0.50		0.50	0.31	ug/L			06/02/13 21:03	1
1,1-Dichloropropene	<0.50		0.50	0.19	ug/L			06/02/13 21:03	1
1,3-Dichloropropene, Total	<0.50		0.50	0.32	ug/L			06/02/13 21:03	1
Diisopropyl ether	<0.50		0.50	0.28	ug/L			06/02/13 21:03	1
Ethylbenzene	<0.50		0.50	0.12	ug/L			06/02/13 21:03	1
Ethylene Dibromide	<0.50		0.50	0.20	ug/L			06/02/13 21:03	1

TestAmerica Savannah

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Client Sample ID: HAMP-22

Lab Sample ID: 680-90584-3

Date Collected: 05/21/13 10:00

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Freon 113	<0.50		0.50	0.15	ug/L			06/02/13 21:03	1
Hexachlorobutadiene	<0.50		0.50	0.26	ug/L			06/02/13 21:03	1
2-Hexanone	<10	10		5.0	ug/L			06/02/13 21:03	1
Isopropylbenzene	<0.50		0.50	0.15	ug/L			06/02/13 21:03	1
4-Isopropyltoluene	<0.50		0.50	0.21	ug/L			06/02/13 21:03	1
Methylene Chloride	<0.50		0.50	0.36	ug/L			06/02/13 21:03	1
2-Butanone (MEK)	<10	10		5.0	ug/L			06/02/13 21:03	1
4-Methyl-2-pentanone (MIBK)	<10	10		5.0	ug/L			06/02/13 21:03	1
m-Xylene & p-Xylene	<0.50		0.50	0.42	ug/L			06/02/13 21:03	1
Naphthalene	<1.0	1.0		0.43	ug/L			06/02/13 21:03	1
n-Butylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 21:03	1
N-Propylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 21:03	1
o-Xylene	<0.50		0.50	0.27	ug/L			06/02/13 21:03	1
sec-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 21:03	1
Styrene	<0.50		0.50	0.28	ug/L			06/02/13 21:03	1
Tert-amyl methyl ether	<0.50		0.50	0.20	ug/L			06/02/13 21:03	1
tert-Butyl alcohol	<2.0	2.0		1.6	ug/L			06/02/13 21:03	1
tert-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 21:03	1
Tert-butyl ethyl ether	<0.50		0.50	0.26	ug/L			06/02/13 21:03	1
1,1,1,2-Tetrachloroethane	<0.50		0.50	0.16	ug/L			06/02/13 21:03	1
1,1,2,2-Tetrachloroethane	<0.50		0.50	0.18	ug/L			06/02/13 21:03	1
Tetrachloroethene	<0.50		0.50	0.30	ug/L			06/02/13 21:03	1
Toluene	<0.50		0.50	0.23	ug/L			06/02/13 21:03	1
trans-1,2-Dichloroethene	<0.50		0.50	0.24	ug/L			06/02/13 21:03	1
trans-1,3-Dichloropropene	<0.50		0.50	0.48	ug/L			06/02/13 21:03	1
1,2,3-Trichlorobenzene	<0.50		0.50	0.14	ug/L			06/02/13 21:03	1
1,2,4-Trichlorobenzene	<0.50		0.50	0.18	ug/L			06/02/13 21:03	1
1,1,1-Trichloroethane	<0.50		0.50	0.27	ug/L			06/02/13 21:03	1
1,1,2-Trichloroethane	<0.50		0.50	0.22	ug/L			06/02/13 21:03	1
Trichloroethene	<0.50		0.50	0.37	ug/L			06/02/13 21:03	1
Trichlorofluoromethane	<0.50		0.50	0.23	ug/L			06/02/13 21:03	1
1,2,3-Trichloropropane	<0.50		0.50	0.18	ug/L			06/02/13 21:03	1
Trihalomethanes, Total	<0.50		0.50	0.10	ug/L			06/02/13 21:03	1
1,2,4-Trimethylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 21:03	1
1,3,5-Trimethylbenzene	<0.50		0.50	0.16	ug/L			06/02/13 21:03	1
Vinyl chloride	<0.50		0.50	0.33	ug/L			06/02/13 21:03	1
Xylenes, Total	<0.50		0.50	0.27	ug/L			06/02/13 21:03	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	88		70 - 130		06/02/13 21:03	1
1,2-Dichlorobenzene-d4	76		70 - 130		06/02/13 21:03	1

Client Sample ID: HAMP-23

Lab Sample ID: 680-90584-4

Date Collected: 05/21/13 10:05

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Acetone	<10		10	5.0	ug/L			06/02/13 21:30	1
Benzene	<0.50		0.50	0.18	ug/L			06/02/13 21:30	1

TestAmerica Savannah

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Client Sample ID: HAMP-23

Lab Sample ID: 680-90584-4

Date Collected: 05/21/13 10:05

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Bromobenzene	<0.50		0.50	0.42	ug/L			06/02/13 21:30	1
Bromoform	<0.50		0.50	0.39	ug/L			06/02/13 21:30	1
Bromomethane	<1.0		1.0	0.45	ug/L			06/02/13 21:30	1
Carbon tetrachloride	<0.50		0.50	0.22	ug/L			06/02/13 21:30	1
Chlorobenzene	<0.50		0.50	0.27	ug/L			06/02/13 21:30	1
Chlorobromomethane	<0.50		0.50	0.30	ug/L			06/02/13 21:30	1
Chlorodibromomethane	<0.50		0.50	0.43	ug/L			06/02/13 21:30	1
Chloroethane	<1.0		1.0	0.33	ug/L			06/02/13 21:30	1
Chloroform	<0.50		0.50	0.29	ug/L			06/02/13 21:30	1
Chloromethane	<0.50		0.50	0.32	ug/L			06/02/13 21:30	1
2-Chlorotoluene	<0.50		0.50	0.17	ug/L			06/02/13 21:30	1
4-Chlorotoluene	<0.50		0.50	0.16	ug/L			06/02/13 21:30	1
cis-1,2-Dichloroethene	<0.50		0.50	0.37	ug/L			06/02/13 21:30	1
cis-1,3-Dichloropropene	<0.50		0.50	0.32	ug/L			06/02/13 21:30	1
1,2-Dibromo-3-Chloropropane	<0.50		0.50	0.30	ug/L			06/02/13 21:30	1
Dibromomethane	<0.50		0.50	0.38	ug/L			06/02/13 21:30	1
1,2-Dichlorobenzene	<0.50		0.50	0.17	ug/L			06/02/13 21:30	1
1,3-Dichlorobenzene	<0.50		0.50	0.14	ug/L			06/02/13 21:30	1
1,4-Dichlorobenzene	<0.50		0.50	0.18	ug/L			06/02/13 21:30	1
Dichlorobromomethane	<0.50		0.50	0.10	ug/L			06/02/13 21:30	1
Dichlorodifluoromethane	<0.50		0.50	0.34	ug/L			06/02/13 21:30	1
1,1-Dichloroethane	<0.50		0.50	0.39	ug/L			06/02/13 21:30	1
1,2-Dichloroethane	<0.50		0.50	0.17	ug/L			06/02/13 21:30	1
1,1-Dichloroethene	<0.50		0.50	0.32	ug/L			06/02/13 21:30	1
1,2-Dichloropropane	<0.50		0.50	0.45	ug/L			06/02/13 21:30	1
1,3-Dichloropropane	<0.50		0.50	0.43	ug/L			06/02/13 21:30	1
2,2-Dichloropropane	<0.50		0.50	0.31	ug/L			06/02/13 21:30	1
1,1-Dichloropropene	<0.50		0.50	0.19	ug/L			06/02/13 21:30	1
1,3-Dichloropropene, Total	<0.50		0.50	0.32	ug/L			06/02/13 21:30	1
Diisopropyl ether	<0.50		0.50	0.28	ug/L			06/02/13 21:30	1
Ethylbenzene	<0.50		0.50	0.12	ug/L			06/02/13 21:30	1
Ethylene Dibromide	<0.50		0.50	0.20	ug/L			06/02/13 21:30	1
Freon 113	<0.50		0.50	0.15	ug/L			06/02/13 21:30	1
Hexachlorobutadiene	<0.50		0.50	0.26	ug/L			06/02/13 21:30	1
2-Hexanone	<10		10	5.0	ug/L			06/02/13 21:30	1
Isopropylbenzene	<0.50		0.50	0.15	ug/L			06/02/13 21:30	1
4-Isopropyltoluene	<0.50		0.50	0.21	ug/L			06/02/13 21:30	1
Methylene Chloride	<0.50		0.50	0.36	ug/L			06/02/13 21:30	1
2-Butanone (MEK)	<10		10	5.0	ug/L			06/02/13 21:30	1
4-Methyl-2-pentanone (MIBK)	<10		10	5.0	ug/L			06/02/13 21:30	1
m-Xylene & p-Xylene	<0.50		0.50	0.42	ug/L			06/02/13 21:30	1
Naphthalene	<1.0		1.0	0.43	ug/L			06/02/13 21:30	1
n-Butylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 21:30	1
N-Propylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 21:30	1
o-Xylene	<0.50		0.50	0.27	ug/L			06/02/13 21:30	1
sec-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 21:30	1
Styrene	<0.50		0.50	0.28	ug/L			06/02/13 21:30	1
Tert-amyl methyl ether	<0.50		0.50	0.20	ug/L			06/02/13 21:30	1
tert-Butyl alcohol	<2.0		2.0	1.6	ug/L			06/02/13 21:30	1

TestAmerica Savannah



Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Client Sample ID: HAMP-23

Lab Sample ID: 680-90584-4

Date Collected: 05/21/13 10:05

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
tert-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 21:30	1
Tert-butyl ethyl ether	<0.50		0.50	0.26	ug/L			06/02/13 21:30	1
1,1,1,2-Tetrachloroethane	<0.50		0.50	0.16	ug/L			06/02/13 21:30	1
1,1,2,2-Tetrachloroethane	<0.50		0.50	0.18	ug/L			06/02/13 21:30	1
Tetrachloroethene	<0.50		0.50	0.30	ug/L			06/02/13 21:30	1
Toluene	<0.50		0.50	0.23	ug/L			06/02/13 21:30	1
trans-1,2-Dichloroethene	<0.50		0.50	0.24	ug/L			06/02/13 21:30	1
trans-1,3-Dichloropropene	<0.50		0.50	0.48	ug/L			06/02/13 21:30	1
1,2,3-Trichlorobenzene	<0.50		0.50	0.14	ug/L			06/02/13 21:30	1
1,2,4-Trichlorobenzene	<0.50		0.50	0.18	ug/L			06/02/13 21:30	1
1,1,1-Trichloroethane	<0.50		0.50	0.27	ug/L			06/02/13 21:30	1
1,1,2-Trichloroethane	<0.50		0.50	0.22	ug/L			06/02/13 21:30	1
Trichloroethene	<0.50		0.50	0.37	ug/L			06/02/13 21:30	1
Trichlorofluoromethane	<0.50		0.50	0.23	ug/L			06/02/13 21:30	1
1,2,3-Trichloropropane	<0.50		0.50	0.18	ug/L			06/02/13 21:30	1
Trihalomethanes, Total	<0.50		0.50	0.10	ug/L			06/02/13 21:30	1
1,2,4-Trimethylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 21:30	1
1,3,5-Trimethylbenzene	<0.50		0.50	0.16	ug/L			06/02/13 21:30	1
Vinyl chloride	<0.50		0.50	0.33	ug/L			06/02/13 21:30	1
Xylenes, Total	<0.50		0.50	0.27	ug/L			06/02/13 21:30	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	86		70 - 130		06/02/13 21:30	1
1,2-Dichlorobenzene-d4	80		70 - 130		06/02/13 21:30	1

Client Sample ID: Trip Blank

Lab Sample ID: 680-90584-5

Date Collected: 05/21/13 08:00

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Acetone	<10		10	5.0	ug/L			06/02/13 18:48	1
Benzene	<0.50		0.50	0.18	ug/L			06/02/13 18:48	1
Bromobenzene	<0.50		0.50	0.42	ug/L			06/02/13 18:48	1
Bromoform	<0.50		0.50	0.39	ug/L			06/02/13 18:48	1
Bromomethane	<1.0		1.0	0.45	ug/L			06/02/13 18:48	1
Carbon tetrachloride	<0.50		0.50	0.22	ug/L			06/02/13 18:48	1
Chlorobenzene	<0.50		0.50	0.27	ug/L			06/02/13 18:48	1
Chlorobromomethane	<0.50		0.50	0.30	ug/L			06/02/13 18:48	1
Chlorodibromomethane	<0.50		0.50	0.43	ug/L			06/02/13 18:48	1
Chloroethane	<1.0		1.0	0.33	ug/L			06/02/13 18:48	1
Chloroform	<0.50		0.50	0.29	ug/L			06/02/13 18:48	1
Chloromethane	<0.50		0.50	0.32	ug/L			06/02/13 18:48	1
2-Chlorotoluene	<0.50		0.50	0.17	ug/L			06/02/13 18:48	1
4-Chlorotoluene	<0.50		0.50	0.16	ug/L			06/02/13 18:48	1
cis-1,2-Dichloroethene	<0.50		0.50	0.37	ug/L			06/02/13 18:48	1
cis-1,3-Dichloropropene	<0.50		0.50	0.32	ug/L			06/02/13 18:48	1
1,2-Dibromo-3-Chloropropane	<0.50		0.50	0.30	ug/L			06/02/13 18:48	1
Dibromomethane	<0.50		0.50	0.38	ug/L			06/02/13 18:48	1
1,2-Dichlorobenzene	<0.50		0.50	0.17	ug/L			06/02/13 18:48	1

TestAmerica Savannah

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Client Sample ID: Trip Blank

Lab Sample ID: 680-90584-5

Date Collected: 05/21/13 08:00

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3-Dichlorobenzene	<0.50		0.50	0.14	ug/L			06/02/13 18:48	1
1,4-Dichlorobenzene	<0.50		0.50	0.18	ug/L			06/02/13 18:48	1
Dichlorobromomethane	<0.50		0.50	0.10	ug/L			06/02/13 18:48	1
Dichlorodifluoromethane	<0.50		0.50	0.34	ug/L			06/02/13 18:48	1
1,1-Dichloroethane	<0.50		0.50	0.39	ug/L			06/02/13 18:48	1
1,2-Dichloroethane	<0.50		0.50	0.17	ug/L			06/02/13 18:48	1
1,1-Dichloroethene	<0.50		0.50	0.32	ug/L			06/02/13 18:48	1
1,2-Dichloropropane	<0.50		0.50	0.45	ug/L			06/02/13 18:48	1
1,3-Dichloropropane	<0.50		0.50	0.43	ug/L			06/02/13 18:48	1
2,2-Dichloropropane	<0.50		0.50	0.31	ug/L			06/02/13 18:48	1
1,1-Dichloropropene	<0.50		0.50	0.19	ug/L			06/02/13 18:48	1
1,3-Dichloropropene, Total	<0.50		0.50	0.32	ug/L			06/02/13 18:48	1
Diisopropyl ether	<0.50		0.50	0.28	ug/L			06/02/13 18:48	1
Ethylbenzene	<0.50		0.50	0.12	ug/L			06/02/13 18:48	1
Ethylene Dibromide	<0.50		0.50	0.20	ug/L			06/02/13 18:48	1
Freon 113	<0.50		0.50	0.15	ug/L			06/02/13 18:48	1
Hexachlorobutadiene	<0.50		0.50	0.26	ug/L			06/02/13 18:48	1
2-Hexanone	<10		10	5.0	ug/L			06/02/13 18:48	1
Isopropylbenzene	<0.50		0.50	0.15	ug/L			06/02/13 18:48	1
4-Isopropyltoluene	<0.50		0.50	0.21	ug/L			06/02/13 18:48	1
Methylene Chloride	<0.50		0.50	0.36	ug/L			06/02/13 18:48	1
2-Butanone (MEK)	<10		10	5.0	ug/L			06/02/13 18:48	1
4-Methyl-2-pentanone (MIBK)	<10		10	5.0	ug/L			06/02/13 18:48	1
m-Xylene & p-Xylene	<0.50		0.50	0.42	ug/L			06/02/13 18:48	1
Naphthalene	<1.0		1.0	0.43	ug/L			06/02/13 18:48	1
n-Butylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 18:48	1
N-Propylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 18:48	1
o-Xylene	<0.50		0.50	0.27	ug/L			06/02/13 18:48	1
sec-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 18:48	1
Styrene	<0.50		0.50	0.28	ug/L			06/02/13 18:48	1
Tert-amyl methyl ether	<0.50		0.50	0.20	ug/L			06/02/13 18:48	1
tert-Butyl alcohol	<2.0		2.0	1.6	ug/L			06/02/13 18:48	1
tert-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 18:48	1
Tert-butyl ethyl ether	<0.50		0.50	0.26	ug/L			06/02/13 18:48	1
1,1,1,2-Tetrachloroethane	<0.50		0.50	0.16	ug/L			06/02/13 18:48	1
1,1,1,2-Tetrachloroethane	<0.50		0.50	0.18	ug/L			06/02/13 18:48	1
Tetrachloroethene	<0.50		0.50	0.30	ug/L			06/02/13 18:48	1
Toluene	<0.50		0.50	0.23	ug/L			06/02/13 18:48	1
trans-1,2-Dichloroethene	<0.50		0.50	0.24	ug/L			06/02/13 18:48	1
trans-1,3-Dichloropropene	<0.50		0.50	0.48	ug/L			06/02/13 18:48	1
1,2,3-Trichlorobenzene	<0.50		0.50	0.14	ug/L			06/02/13 18:48	1
1,2,4-Trichlorobenzene	<0.50		0.50	0.18	ug/L			06/02/13 18:48	1
1,1,1-Trichloroethane	<0.50		0.50	0.27	ug/L			06/02/13 18:48	1
1,1,2-Trichloroethane	<0.50		0.50	0.22	ug/L			06/02/13 18:48	1
Trichloroethene	<0.50		0.50	0.37	ug/L			06/02/13 18:48	1
Trichlorofluoromethane	<0.50		0.50	0.23	ug/L			06/02/13 18:48	1
1,2,3-Trichloropropane	<0.50		0.50	0.18	ug/L			06/02/13 18:48	1
Trihalomethanes, Total	<0.50		0.50	0.10	ug/L			06/02/13 18:48	1
1,2,4-Trimethylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 18:48	1

TestAmerica Savannah

Client Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Client Sample ID: Trip Blank

Lab Sample ID: 680-90584-5

Date Collected: 05/21/13 08:00

Matrix: Water

Date Received: 05/22/13 09:59

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
1,3,5-Trimethylbenzene	<0.50		0.50	0.16	ug/L			06/02/13 18:48	1
Vinyl chloride	<0.50		0.50	0.33	ug/L			06/02/13 18:48	1
Xylenes, Total	<0.50		0.50	0.27	ug/L			06/02/13 18:48	1

Surrogate	%Recovery	Qualifier	Limits	Prepared	Analyzed	Dil Fac
4-Bromofluorobenzene	90		70 - 130		06/02/13 18:48	1
1,2-Dichlorobenzene-d4	84		70 - 130		06/02/13 18:48	1



QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Method: 524.2 - Volatile Organic Compounds (GC/MS)

Lab Sample ID: MB 680-278828/6

Matrix: Water

Analysis Batch: 278828

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB MB		RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Acetone	<10		10	5.0	ug/L			06/02/13 17:24	1
Benzene	<0.50		0.50	0.18	ug/L			06/02/13 17:24	1
Bromobenzene	<0.50		0.50	0.42	ug/L			06/02/13 17:24	1
Bromoform	<0.50		0.50	0.39	ug/L			06/02/13 17:24	1
Bromomethane	<1.0		1.0	0.45	ug/L			06/02/13 17:24	1
Carbon tetrachloride	<0.50		0.50	0.22	ug/L			06/02/13 17:24	1
Chlorobenzene	<0.50		0.50	0.27	ug/L			06/02/13 17:24	1
Chlorobromomethane	<0.50		0.50	0.30	ug/L			06/02/13 17:24	1
Chlorodibromomethane	<0.50		0.50	0.43	ug/L			06/02/13 17:24	1
Chloroethane	<1.0		1.0	0.33	ug/L			06/02/13 17:24	1
Chloroform	<0.50		0.50	0.29	ug/L			06/02/13 17:24	1
Chloromethane	<0.50		0.50	0.32	ug/L			06/02/13 17:24	1
2-Chlorotoluene	<0.50		0.50	0.17	ug/L			06/02/13 17:24	1
4-Chlorotoluene	<0.50		0.50	0.16	ug/L			06/02/13 17:24	1
cis-1,2-Dichloroethene	<0.50		0.50	0.37	ug/L			06/02/13 17:24	1
cis-1,3-Dichloropropene	<0.50		0.50	0.32	ug/L			06/02/13 17:24	1
1,2-Dibromo-3-Chloropropane	<0.50		0.50	0.30	ug/L			06/02/13 17:24	1
Dibromomethane	<0.50		0.50	0.38	ug/L			06/02/13 17:24	1
1,2-Dichlorobenzene	<0.50		0.50	0.17	ug/L			06/02/13 17:24	1
1,3-Dichlorobenzene	<0.50		0.50	0.14	ug/L			06/02/13 17:24	1
1,4-Dichlorobenzene	<0.50		0.50	0.18	ug/L			06/02/13 17:24	1
Dichlorobromomethane	<0.50		0.50	0.10	ug/L			06/02/13 17:24	1
Dichlorodifluoromethane	<0.50		0.50	0.34	ug/L			06/02/13 17:24	1
1,1-Dichloroethane	<0.50		0.50	0.39	ug/L			06/02/13 17:24	1
1,2-Dichloroethane	<0.50		0.50	0.17	ug/L			06/02/13 17:24	1
1,1-Dichloroethene	<0.50		0.50	0.32	ug/L			06/02/13 17:24	1
1,2-Dichloropropane	<0.50		0.50	0.45	ug/L			06/02/13 17:24	1
1,3-Dichloropropane	<0.50		0.50	0.43	ug/L			06/02/13 17:24	1
2,2-Dichloropropane	<0.50		0.50	0.31	ug/L			06/02/13 17:24	1
1,1-Dichloropropene	<0.50		0.50	0.19	ug/L			06/02/13 17:24	1
1,3-Dichloropropene, Total	<0.50		0.50	0.32	ug/L			06/02/13 17:24	1
Diisopropyl ether	<0.50		0.50	0.28	ug/L			06/02/13 17:24	1
Ethylbenzene	<0.50		0.50	0.12	ug/L			06/02/13 17:24	1
Ethylene Dibromide	<0.50		0.50	0.20	ug/L			06/02/13 17:24	1
Freon 113	<0.50		0.50	0.15	ug/L			06/02/13 17:24	1
Hexachlorobutadiene	<0.50		0.50	0.26	ug/L			06/02/13 17:24	1
2-Hexanone	<10		10	5.0	ug/L			06/02/13 17:24	1
Isopropylbenzene	<0.50		0.50	0.15	ug/L			06/02/13 17:24	1
4-Isopropyltoluene	<0.50		0.50	0.21	ug/L			06/02/13 17:24	1
Methylene Chloride	<0.50		0.50	0.36	ug/L			06/02/13 17:24	1
2-Butanone (MEK)	<10		10	5.0	ug/L			06/02/13 17:24	1
4-Methyl-2-pentanone (MIBK)	<10		10	5.0	ug/L			06/02/13 17:24	1
m-Xylene & p-Xylene	<0.50		0.50	0.42	ug/L			06/02/13 17:24	1
Naphthalene	<1.0		1.0	0.43	ug/L			06/02/13 17:24	1
n-Butylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 17:24	1
N-Propylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 17:24	1
o-Xylene	<0.50		0.50	0.27	ug/L			06/02/13 17:24	1
sec-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 17:24	1

TestAmerica Savannah



QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: MB 680-278828/6

Matrix: Water

Analysis Batch: 278828

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB	MB	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier							
Styrene	<0.50		0.50	0.28	ug/L			06/02/13 17:24	1
tert-amyl methyl ether	<0.50		0.50	0.20	ug/L			06/02/13 17:24	1
tert-Butyl alcohol	<2.0		2.0	1.6	ug/L			06/02/13 17:24	1
tert-Butylbenzene	<0.50		0.50	0.14	ug/L			06/02/13 17:24	1
Tert-butyl ethyl ether	<0.50		0.50	0.26	ug/L			06/02/13 17:24	1
1,1,1,2-Tetrachloroethane	<0.50		0.50	0.16	ug/L			06/02/13 17:24	1
1,1,2,2-Tetrachloroethane	<0.50		0.50	0.18	ug/L			06/02/13 17:24	1
Tetrachloroethene	<0.50		0.50	0.30	ug/L			06/02/13 17:24	1
Toluene	<0.50		0.50	0.23	ug/L			06/02/13 17:24	1
trans-1,2-Dichloroethene	<0.50		0.50	0.24	ug/L			06/02/13 17:24	1
trans-1,3-Dichloropropene	<0.50		0.50	0.48	ug/L			06/02/13 17:24	1
1,2,3-Trichlorobenzene	<0.50		0.50	0.14	ug/L			06/02/13 17:24	1
1,2,4-Trichlorobenzene	<0.50		0.50	0.18	ug/L			06/02/13 17:24	1
1,1,1-Trichloroethane	<0.50		0.50	0.27	ug/L			06/02/13 17:24	1
1,1,2-Trichloroethane	<0.50		0.50	0.22	ug/L			06/02/13 17:24	1
Trichloroethene	<0.50		0.50	0.37	ug/L			06/02/13 17:24	1
Trichlorofluoromethane	<0.50		0.50	0.23	ug/L			06/02/13 17:24	1
1,2,3-Trichloropropane	<0.50		0.50	0.18	ug/L			06/02/13 17:24	1
Trihalomethanes, Total	<0.50		0.50	0.10	ug/L			06/02/13 17:24	1
1,2,4-Trimethylbenzene	<0.50		0.50	0.17	ug/L			06/02/13 17:24	1
1,3,5-Trimethylbenzene	<0.50		0.50	0.16	ug/L			06/02/13 17:24	1
Vinyl chloride	<0.50		0.50	0.33	ug/L			06/02/13 17:24	1
Xylenes, Total	<0.50		0.50	0.27	ug/L			06/02/13 17:24	1

Surrogate	MB	MB	Limits	Prepared	Analyzed	Dil Fac
	%Recovery	Qualifier				
4-Bromofluorobenzene	88		70 - 130		06/02/13 17:24	1
1,2-Dichlorobenzene-d4	81		70 - 130		06/02/13 17:24	1

Lab Sample ID: LCS 680-278828/3

Matrix: Water

Analysis Batch: 278828

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS	LCS	Unit	D	%Rec	%Rec.
		Result	Qualifier				Limits
Acetone	40.0	38.5		ug/L		96	70 - 130
Benzene	20.0	19.4		ug/L		97	70 - 130
Bromobenzene	20.0	20.0		ug/L		100	70 - 130
Bromoform	20.0	17.3		ug/L		86	70 - 130
Bromomethane	20.0	16.5		ug/L		83	70 - 130
Carbon tetrachloride	20.0	20.8		ug/L		104	70 - 130
Chlorobenzene	20.0	19.6		ug/L		98	70 - 130
Chlorobromomethane	20.0	19.0		ug/L		95	70 - 130
Chlorodibromomethane	20.0	16.5		ug/L		82	70 - 130
Chloroethane	20.0	18.5		ug/L		93	70 - 130
Chloroform	20.0	19.5		ug/L		97	70 - 130
Chloromethane	20.0	18.5		ug/L		92	70 - 130
2-Chlorotoluene	20.0	20.1		ug/L		100	70 - 130
4-Chlorotoluene	20.0	20.9		ug/L		104	70 - 130
cis-1,2-Dichloroethene	20.0	19.4		ug/L		97	70 - 130

TestAmerica Savannah

QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: LCS 680-278828/3

Client Sample ID: Lab Control Sample

Matrix: Water

Prep Type: Total/NA

Analysis Batch: 278828

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
cis-1,3-Dichloropropene	20.0	20.9		ug/L		104	70 - 130
1,2-Dibromo-3-Chloropropane	20.0	19.8		ug/L		99	70 - 130
Dibromomethane	20.0	18.4		ug/L		92	70 - 130
1,2-Dichlorobenzene	20.0	20.5		ug/L		103	70 - 130
1,3-Dichlorobenzene	20.0	18.9		ug/L		95	70 - 130
1,4-Dichlorobenzene	20.0	18.7		ug/L		94	70 - 130
Dichlorobromomethane	20.0	19.5		ug/L		97	70 - 130
Dichlorodifluoromethane	20.0	19.4		ug/L		97	70 - 130
1,1-Dichloroethane	20.0	19.2		ug/L		96	70 - 130
1,2-Dichloroethane	20.0	19.2		ug/L		96	70 - 130
1,1-Dichloroethene	20.0	19.4		ug/L		97	70 - 130
1,2-Dichloropropane	20.0	19.3		ug/L		97	70 - 130
1,3-Dichloropropane	20.0	19.4		ug/L		97	70 - 130
2,2-Dichloropropane	20.0	21.2		ug/L		106	70 - 130
1,1-Dichloropropene	20.0	19.9		ug/L		100	70 - 130
1,3-Dichloropropene, Total	40.0	42.0		ug/L		105	70 - 130
Diisopropyl ether	16.0	16.2		ug/L		101	70 - 130
Ethylbenzene	20.0	20.1		ug/L		100	70 - 130
Ethylene Dibromide	20.0	20.0		ug/L		100	70 - 130
Freon 113	16.0	16.2		ug/L		101	70 - 130
Hexachlorobutadiene	20.0	19.1		ug/L		95	70 - 130
2-Hexanone	40.0	42.5		ug/L		106	70 - 130
Isopropylbenzene	20.0	20.4		ug/L		102	70 - 130
4-Isopropyltoluene	20.0	18.5		ug/L		93	70 - 130
Methylene Chloride	20.0	19.5		ug/L		97	70 - 130
2-Butanone (MEK)	40.0	40.5		ug/L		101	70 - 130
4-Methyl-2-pentanone (MIBK)	40.0	40.9		ug/L		102	70 - 130
m-Xylene & p-Xylene	40.0	40.5		ug/L		101	70 - 130
Naphthalene	20.0	20.8		ug/L		104	70 - 130
n-Butylbenzene	20.0	20.6		ug/L		103	70 - 130
N-Propylbenzene	20.0	21.0		ug/L		105	70 - 130
o-Xylene	20.0	20.1		ug/L		101	70 - 130
sec-Butylbenzene	20.0	18.6		ug/L		93	70 - 130
Styrene	20.0	18.7		ug/L		93	70 - 130
Tert-amyl methyl ether	16.0	16.3		ug/L		102	70 - 130
tert-Butyl alcohol	80.0	72.6		ug/L		91	70 - 130
tert-Butylbenzene	20.0	20.5		ug/L		103	70 - 130
Tert-butyl ethyl ether	16.0	16.4		ug/L		103	70 - 130
1,1,1,2-Tetrachloroethane	20.0	18.3		ug/L		91	70 - 130
1,1,1,2,2-Tetrachloroethane	20.0	19.5		ug/L		97	70 - 130
Tetrachloroethene	20.0	19.3		ug/L		97	70 - 130
Toluene	20.0	19.5		ug/L		98	70 - 130
trans-1,2-Dichloroethene	20.0	19.5		ug/L		97	70 - 130
trans-1,3-Dichloropropene	20.0	21.1		ug/L		105	70 - 130
1,2,3-Trichlorobenzene	20.0	14.6		ug/L		73	70 - 130
1,2,4-Trichlorobenzene	20.0	15.4		ug/L		77	70 - 130
1,1,1-Trichloroethane	20.0	20.0		ug/L		100	70 - 130
1,1,2-Trichloroethane	20.0	19.6		ug/L		98	70 - 130

TestAmerica Savannah

QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: LCS 680-278828/3

Matrix: Water

Analysis Batch: 278828

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike	LCS	LCS	Unit	D	%Rec	%Rec. Limits
	Added	Result	Qualifier				
Trichloroethene	20.0	19.2		ug/L		96	70 - 130
Trichlorofluoromethane	20.0	20.0		ug/L		100	70 - 130
1,2,3-Trichloropropane	20.0	20.5		ug/L		102	70 - 130
Trihalomethanes, Total	80.0	72.8		ug/L		91	70 - 130
1,2,4-Trimethylbenzene	20.0	18.6		ug/L		93	70 - 130
1,3,5-Trimethylbenzene	20.0	21.0		ug/L		105	70 - 130
Vinyl chloride	20.0	19.7		ug/L		99	70 - 130
Xylenes, Total	60.0	60.6		ug/L		101	70 - 130

Surrogate	LCS LCS		Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	104		70 - 130
1,2-Dichlorobenzene-d4	105		70 - 130

Lab Sample ID: LCSD 680-278828/4

Matrix: Water

Analysis Batch: 278828

Client Sample ID: Lab Control Sample Dup

Prep Type: Total/NA

Analyte	Spike Added	LCSD	LCSD	Unit	D	%Rec	%Rec. Limits	RPD	
		Result	Qualifier					RPD	Limit
Acetone	40.0	39.2		ug/L		98	70 - 130	2	30
Benzene	20.0	19.7		ug/L		98	70 - 130	1	30
Bromobenzene	20.0	20.5		ug/L		103	70 - 130	3	30
Bromoform	20.0	17.9		ug/L		90	70 - 130	4	30
Bromomethane	20.0	18.8		ug/L		94	70 - 130	13	30
Carbon tetrachloride	20.0	21.3		ug/L		106	70 - 130	2	30
Chlorobenzene	20.0	19.8		ug/L		99	70 - 130	1	30
Chlorobromomethane	20.0	19.4		ug/L		97	70 - 130	2	30
Chlorodibromomethane	20.0	16.6		ug/L		83	70 - 130	1	30
Chloroethane	20.0	17.8		ug/L		89	70 - 130	4	30
Chloroform	20.0	19.4		ug/L		97	70 - 130	0	30
Chloromethane	20.0	18.2		ug/L		91	70 - 130	2	30
2-Chlorotoluene	20.0	20.4		ug/L		102	70 - 130	2	30
4-Chlorotoluene	20.0	20.9		ug/L		105	70 - 130	0	30
cis-1,2-Dichloroethene	20.0	19.2		ug/L		96	70 - 130	1	30
cis-1,3-Dichloropropene	20.0	21.2		ug/L		106	70 - 130	1	30
1,2-Dibromo-3-Chloropropane	20.0	19.9		ug/L		99	70 - 130	0	30
Dibromomethane	20.0	18.9		ug/L		94	70 - 130	3	30
1,2-Dichlorobenzene	20.0	20.5		ug/L		102	70 - 130	0	30
1,3-Dichlorobenzene	20.0	19.0		ug/L		95	70 - 130	1	30
1,4-Dichlorobenzene	20.0	19.0		ug/L		95	70 - 130	1	30
Dichlorobromomethane	20.0	20.2		ug/L		101	70 - 130	4	30
Dichlorodifluoromethane	20.0	19.2		ug/L		96	70 - 130	1	30
1,1-Dichloroethane	20.0	19.4		ug/L		97	70 - 130	1	30
1,2-Dichloroethane	20.0	18.9		ug/L		94	70 - 130	2	30
1,1-Dichloroethene	20.0	19.8		ug/L		99	70 - 130	2	30
1,2-Dichloropropane	20.0	19.6		ug/L		98	70 - 130	2	30
1,3-Dichloropropane	20.0	19.7		ug/L		99	70 - 130	2	30
2,2-Dichloropropane	20.0	21.0		ug/L		105	70 - 130	1	30
1,1-Dichloropropene	20.0	20.0		ug/L		100	70 - 130	0	30

TestAmerica Savannah

QC Sample Results

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Method: 524.2 - Volatile Organic Compounds (GC/MS) (Continued)

Lab Sample ID: LCSD 680-278828/4

Client Sample ID: Lab Control Sample Dup

Matrix: Water

Prep Type: Total/NA

Analysis Batch: 278828

Analyte	Spike Added	LCSD Result	LCSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
1,3-Dichloropropene, Total	40.0	42.6		ug/L		107	70 - 130	2	30
Diisopropyl ether	16.0	16.2		ug/L		101	70 - 130	0	30
Ethylbenzene	20.0	20.5		ug/L		102	70 - 130	2	30
Ethylene Dibromide	20.0	20.3		ug/L		102	70 - 130	1	30
Freon 113	16.0	16.3		ug/L		102	70 - 130	0	30
Hexachlorobutadiene	20.0	19.3		ug/L		96	70 - 130	1	30
2-Hexanone	40.0	42.8		ug/L		107	70 - 130	1	30
Isopropylbenzene	20.0	20.6		ug/L		103	70 - 130	1	30
4-Isopropyltoluene	20.0	18.5		ug/L		93	70 - 130	0	30
Methylene Chloride	20.0	19.3		ug/L		97	70 - 130	1	30
2-Butanone (MEK)	40.0	40.9		ug/L		102	70 - 130	1	30
4-Methyl-2-pentanone (MIBK)	40.0	42.1		ug/L		105	70 - 130	3	30
m-Xylene & p-Xylene	40.0	40.9		ug/L		102	70 - 130	1	30
Naphthalene	20.0	18.8		ug/L		94	70 - 130	10	30
n-Butylbenzene	20.0	20.1		ug/L		100	70 - 130	2	30
N-Propylbenzene	20.0	21.1		ug/L		106	70 - 130	0	30
o-Xylene	20.0	20.3		ug/L		102	70 - 130	1	30
sec-Butylbenzene	20.0	18.6		ug/L		93	70 - 130	0	30
Styrene	20.0	18.9		ug/L		95	70 - 130	1	30
Tert-amyl methyl ether	16.0	16.3		ug/L		102	70 - 130	0	30
tert-Butyl alcohol	80.0	78.6		ug/L		98	70 - 130	8	30
tert-Butylbenzene	20.0	20.5		ug/L		103	70 - 130	0	30
Tert-butyl ethyl ether	16.0	16.8		ug/L		105	70 - 130	2	30
1,1,1,2-Tetrachloroethane	20.0	18.5		ug/L		93	70 - 130	1	30
1,1,2,2-Tetrachloroethane	20.0	20.0		ug/L		100	70 - 130	3	30
Tetrachloroethene	20.0	19.0		ug/L		95	70 - 130	2	30
Toluene	20.0	19.6		ug/L		98	70 - 130	1	30
trans-1,2-Dichloroethene	20.0	19.4		ug/L		97	70 - 130	0	30
trans-1,3-Dichloropropene	20.0	21.4		ug/L		107	70 - 130	2	30
1,2,3-Trichlorobenzene	20.0	12.2		ug/L		61	70 - 130	18	30
1,2,4-Trichlorobenzene	20.0	13.4		ug/L		67	70 - 130	13	30
1,1,1-Trichloroethane	20.0	20.8		ug/L		104	70 - 130	4	30
1,1,2-Trichloroethane	20.0	20.0		ug/L		100	70 - 130	2	30
Trichloroethene	20.0	19.3		ug/L		97	70 - 130	1	30
Trichlorofluoromethane	20.0	19.7		ug/L		98	70 - 130	1	30
1,2,3-Trichloropropane	20.0	21.0		ug/L		105	70 - 130	2	30
Trihalomethanes, Total	80.0	74.1		ug/L		93	70 - 130	2	30
1,2,4-Trimethylbenzene	20.0	18.8		ug/L		94	70 - 130	1	30
1,3,5-Trimethylbenzene	20.0	20.9		ug/L		105	70 - 130	0	30
Vinyl chloride	20.0	20.0		ug/L		100	70 - 130	1	30
Xylenes, Total	60.0	61.2		ug/L		102	70 - 130	1	30

Surrogate	LCSD		Limits
	%Recovery	Qualifier	
4-Bromofluorobenzene	103		70 - 130
1,2-Dichlorobenzene-d4	103		70 - 130

TestAmerica Savannah

QC Association Summary

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

GC/MS VOA

Analysis Batch: 278828

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-90584-1	RFW-20	Total/NA	Water	524.2	
680-90584-2	RFW-21	Total/NA	Water	524.2	
680-90584-3	HAMP-22	Total/NA	Water	524.2	
680-90584-4	HAMP-23	Total/NA	Water	524.2	
680-90584-5	Trip Blank	Total/NA	Water	524.2	
LCS 680-278828/3	Lab Control Sample	Total/NA	Water	524.2	
LCSD 680-278828/4	Lab Control Sample Dup	Total/NA	Water	524.2	
MB 680-278828/6	Method Blank	Total/NA	Water	524.2	



TestAmerica Savannah

Lab Chronicle

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Client Sample ID: RFW-20

Lab Sample ID: 680-90584-1

Date Collected: 05/20/13 18:10

Matrix: Water

Date Received: 05/22/13 09:59

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	524.2		1	278828	06/02/13 20:09	AGM	TAL SAV

Client Sample ID: RFW-21

Lab Sample ID: 680-90584-2

Date Collected: 05/20/13 12:55

Matrix: Water

Date Received: 05/22/13 09:59

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	524.2		1	278828	06/02/13 20:36	AGM	TAL SAV

Client Sample ID: HAMP-22

Lab Sample ID: 680-90584-3

Date Collected: 05/21/13 10:00

Matrix: Water

Date Received: 05/22/13 09:59

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	524.2		1	278828	06/02/13 21:03	AGM	TAL SAV

Client Sample ID: HAMP-23

Lab Sample ID: 680-90584-4

Date Collected: 05/21/13 10:05

Matrix: Water

Date Received: 05/22/13 09:59

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	524.2		1	278828	06/02/13 21:30	AGM	TAL SAV

Client Sample ID: Trip Blank

Lab Sample ID: 680-90584-5

Date Collected: 05/21/13 08:00

Matrix: Water

Date Received: 05/22/13 09:59

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	524.2		1	278828	06/02/13 18:48	AGM	TAL SAV

Laboratory References:

TAL SAV = TestAmerica Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

TestAmerica Savannah

Login Sample Receipt Checklist

Client: Weston Solutions, Inc.

Job Number: 680-90584-1

Login Number: 90584

List Source: TestAmerica Savannah

List Number: 1

Creator: Conner, Keaton

Question	Answer	Comment
Radioactivity wasn't checked or is \leq background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	N/A	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	N/A	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ ($1/4"$).	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	



Certification Summary

Client: Weston Solutions, Inc.
Project/Site: Black & Decker

TestAmerica Job ID: 680-90584-1

Laboratory: TestAmerica Savannah

All certifications held by this laboratory are listed. Not all certifications are applicable to this report.

Authority	Program	EPA Region	Certification ID	Expiration Date
A2LA	DoD ELAP		399.01	07-31-13
Alabama	State Program	4	41450	06-30-13
Alaska (UST)	State Program	10	UST-104	06-19-13
Arkansas DEQ	State Program	6	88-0692	02-01-13 *
California	NELAP	9	3217CA	07-31-13
Colorado	State Program	8	N/A	12-31-13
Florida	NELAP	4	E87052	06-30-13
GA Dept. of Agriculture	State Program	4	N/A	12-31-13
Georgia	State Program	4	N/A	06-30-13
Georgia	State Program	4	803	06-30-13
Hawaii	State Program	9	N/A	06-30-13
Illinois	NELAP	5	200022	11-30-13
Indiana	State Program	5	N/A	06-30-13
Iowa	State Program	7	353	07-01-13 *
Kentucky	State Program	4	90084	12-31-12 *
Kentucky (UST)	State Program	4	18	03-31-13 *
Louisiana	NELAP	6	30690	06-30-13
Louisiana	NELAP	6	LA100015	12-31-13
Maine	State Program	1	GA00006	08-16-14
Maryland	State Program	3	250	12-31-13
Massachusetts	State Program	1	M-GA006	06-30-13
Michigan	State Program	5	9925	06-30-13
Mississippi	State Program	4	N/A	06-30-13
Montana	State Program	8	CERT0081	01-01-14
Nebraska	State Program	7	TestAmerica-Savannah	06-30-13 *
New Jersey	NELAP	2	GA769	06-30-13
New Mexico	State Program	6	N/A	06-30-13
New York	NELAP	2	10842	04-01-14
North Carolina DENR	State Program	4	269	12-31-13
North Carolina DHHS	State Program	4	13701	07-31-13
Oklahoma	State Program	6	9984	08-31-13
Pennsylvania	NELAP	3	68-00474	06-30-13 *
Puerto Rico	State Program	2	GA00006	01-01-14
South Carolina	State Program	4	98001	06-30-13
Tennessee	State Program	4	TN02961	06-30-13
Texas	NELAP	6	T104704185-08-TX	11-30-13
USDA	Federal		SAV 3-04	04-07-14
Virginia	NELAP	3	460161	06-14-13 *
Washington	State Program	10	C1794	06-10-13
West Virginia	State Program	3	9950C	12-31-13
West Virginia DEP	State Program	3	94	06-30-13
Wisconsin	State Program	5	999819810	08-31-13
Wyoming	State Program	8	8TMS-Q	06-30-13

* Expired certification is currently pending renewal and is considered valid.