

ANNUAL REPORT

Prepared for

BLACK & DECKER (U.S.), INC.
Hampstead, Maryland

July 2007

Prepared by

WESTON SOLUTIONS, INC.
West Chester, Pennsylvania 19380-1499

W.O. No. 02501.004.004.0700

TABLE OF CONTENTS

Section	Page
1. INTRODUCTION.....	1-1
2. SITE CHARACTERISTICS.....	2-1
2.1 HYDRAULIC PROPERTIES	2-1
2.2 EFFLUENT CHARACTERISTICS	2-1
2.3 GROUNDWATER QUALITY DATA	2-1
3. OPERATION AND MAINTENANCE OF THE TREATMENT SYSTEM.....	3-1
4. TREATMENT SYSTEM PERFORMANCE EVALUATION.....	4-1
5. RECOMMENDATIONS.....	5-1

LIST OF APPENDICES

APPENDIX A – WITHDRAWAL REPORTS

APPENDIX B – DISCHARGE MONITORING REPORTS

APPENDIX C – GROUNDWATER TREATMENT SYSTEM ANALYTICAL RESULTS

APPENDIX D - GROUNDWATER ANALYTICAL DATA PACKAGE (MAY 2007)

LIST OF FIGURES

Figure	Page
Figure 2-1 Groundwater Elevation Contour Map Under Pumping Conditions (June 2007)	2-6

LIST OF TABLES

Table	Page
Table 2-1 Treatment System Pumping Records (July 2006 through June 2007)	2-2
Table 2-2 Groundwater Elevation Data (July 2006 through June 2007)	2-3
Table 2-3 Effluent Characteristics Summary (July 2006 through June 2007).....	2-7
Table 2-4 Summary of Groundwater Analytical Results – August 2006	2-10
Table 2-5 Summary of Groundwater Analytical Results – November 2006.....	2-13
Table 2-6 Summary of Groundwater Analytical Results – February 2007	2-16
Table 2-7 Summary of Groundwater Analytical Results – May 2007	2-19
Table 3-1 Treatment System Maintenance Activities (July 2006 through June 2007).....	3-2

1. INTRODUCTION

This Annual Report has been prepared to meet the requirements of Condition IV.L of the Administrative Consent Order between the State of Maryland Department of the Environment (MDE) and Black & Decker (U.S.) Inc. (April 1995) (Consent Order) and the Addendum to Administrative Consent Order dated 29 June 1995. Specifically, Condition IV.L calls for preparation of an Annual Report containing a summary of the information contained in the Discharge Monitoring Reports (Table 2-3), a summary of all analyses of water samples (Tables 2-4 to 2-7), an explanation of all problems encountered and the manner in which they were resolved (Table 3-1), a performance evaluation of the treatment system (Section 4), and recommendations for continuation of, or changes to, the treatment system (Section 5). This document is one of several that are being prepared in response to the Consent Order; each of these documents are to be submitted to the MDE in accordance with the schedule outlined in the Consent Order. This document will become part of the Administrative Record for the site, which is maintained at the Hampstead Public Library.

2. SITE CHARACTERISTICS

2.1 HYDRAULIC PROPERTIES

In accordance with the Consent Order and the Water Appropriation Permit issued to the Black & Decker (U.S.) Inc. Hampstead, Maryland, facility, the following pumping and water level information is included for the period of July 2006 through June 2007.

Pumping records showing the total gallons pumped per month of treatment system operation are presented in Table 2-1. Copies of the Withdrawal Reports, for the periods of July through December 2006 and January through June 2007, are included in Appendix A.

Water levels (Water Level Monitoring Report) for wells included in the water level monitoring plan are presented in Table 2-2. Based on the June 2007 water levels, a representative groundwater elevation contour map under pumping conditions is presented in Figure 2-1. At the time the data were collected, the extraction wells were pumping at a combined rate of approximately 160 gpm.

2.2 EFFLUENT CHARACTERISTICS

Effluent characteristics of the NPDES discharge points are recorded monthly on Discharge Monitoring Reports (DMRs) and are submitted to MDE, Water Management Administration on a quarterly basis. A summary of the sample results from the DMRs is presented in Table 2-3. DMRs for the period of July 2006 through June 2007 are included in Appendix B.

2.3 GROUNDWATER QUALITY DATA

For the reporting period of July 2006 through June 2007, approximately 98 pounds (lb) of total volatile organic compounds (VOCs) were removed from the groundwater by the extraction and treatment system. In general, the total VOCs were comprised of trichloroethene (TCE) (67 %) and tetrachloroethene (PCE) (33 %). Analytical results of the groundwater collected at the inlet to the air stripper for the period of July 2006 through June 2007 are included in Appendix C.

A summary of the analytical results of the groundwater samples collected from the monitor and extraction wells during the third and fourth quarters of 2006 and the first and second quarters of

Table 2-1
Treatment System Pumping Records
(July 2006 through June 2007)

Black & Decker
Hampstead, Maryland

Date	Water Pumped (gallons)
July 2006	6,719,488
August 2006	6,287,027
September 2006	6,261,273
October 2006	6,331,362
November 2006	6,299,879
December 2006	6,160,966
January 2007	6,483,875
February 2007	6,216,560
March 2007	6,855,271
April 2007	6,696,430
May 2007	6,500,140
June 2007	6,759,810

Table 2-2
Groundwater Elevation Data (July 2006 through June 2007)
Black & Decker
Hampstead, Maryland

WELL NO.	TOC ELEV	TOTAL DEPTH	7/19/2006		8/16/2006		9/22/2006		10/18/2006	
			DTW	ELEV	DTW	ELEV	DTW	ELEV	DTW	ELEV
EW-1	847.21	55	DRY	NA	DRY	NA	DRY	NA	DRY	NA
EW-2	849.21	110	86.36	762.85	93.68	755.53	92.88	756.33	94.12	755.09
EW-3	846.64	118	101.60	745.04	100.30	746.34	81.11	765.53	88.91	757.73
EW-4	858.01	97.5	NA	NA	NA	NA	NA	NA	NA	NA
EW-5	864.17	98	76.31	787.86	70.65	793.52	68.88	795.29	71.13	793.04
EW-6	831.98	115	83.20	748.78	101.25	730.73	100.42	731.56	98.90	733.08
EW-7	818.38	78	44.71	773.67	44.37	774.01	44.91	773.47	48.46	769.92
EW-8	811.13	98	49.92	761.21	43.73	767.40	45.60	765.53	47.11	764.02
EW-9	811.35	141	102.00	709.35	98.80	712.55	100.99	710.36	102.00	709.35
EW-10	807.74	NA	42.60	765.14	50.27	757.47	51.47	756.27	58.74	749.00
RFW-1A	864.37	78	50.17	814.20	49.90	814.47	50.61	813.76	51.33	813.04
RFW-1B	864.23	200	50.24	813.99	49.92	814.31	50.64	813.59	51.35	812.88
RFW-2A	857.41	35	15.03	842.38	17.22	840.19	15.83	841.58	15.67	841.74
RFW-2B	857.73	75	15.26	842.47	17.83	839.90	16.40	841.33	16.28	841.45
RFW-3B	839.21	153	31.79	807.42	33.05	806.16	33.63	805.58	34.17	805.04
RFW-4A	830.37	62	38.28	792.09	38.74	791.63	37.64	792.73	40.83	789.54
RFW-4B	830.37	120	38.46	791.91	38.67	791.70	37.57	792.80	40.76	789.61
RFW-5A	817.50	30	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-6	785.04	120	3.61	781.43	4.94	780.10	4.88	780.16	3.61	781.43
RFW-7	805.14	29	7.86	797.28	7.83	797.31	8.19	796.95	7.43	797.71
RFW-8	860.07	53	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-9	862.02	49	27.11	834.91	27.71	834.31	26.84	835.18	29.46	832.56
RFW-10	852.06	58	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-11A	849.32	72	NA	NA	NA	NA	NA	NA	NA	NA
RFW-11B	849.62	116	71.04	778.58	69.71	779.91	70.05	779.57	71.40	778.22
RFW-12B	844.87	264	52.61	792.26	51.88	792.99	52.17	792.70	54.65	790.22
RFW-13	849.11	150	62.73	786.38	62.39	786.72	62.61	786.50	63.60	785.51
RFW-14B	812.39	281	49.11	763.28	48.78	763.61	47.82	764.57	48.27	764.12
RFW-16	856.14	41	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-17	834.66	60.5	27.57	807.09	29.08	805.58	29.41	805.25	30.17	804.49
RFW-20	842.29	142	35.06	807.23	35.75	806.54	36.34	805.95	37.08	805.21
RFW-21	832.65	102	21.70	810.95	23.02	809.63	22.73	809.92	22.94	809.71
PH-7	805.94	89	31.28	774.66	28.20	777.74	28.11	777.83	32.16	773.78
PH-9	814.94	98	32.84	782.10	38.22	776.72	38.13	776.81	40.58	774.36
PH-11	820.68	78	42.51	778.17	44.27	776.41	44.90	775.78	45.43	775.25
PH-12	828.35	87	42.70	785.65	47.81	780.54	47.47	780.88	48.87	779.48
B-3	803.02	83	NA	NA	NA	NA	NA	NA	NA	NA
Amoco	842.29	NA	NA	NA	NA	NA	NA	NA	NA	NA
Hamp. Town #22	804.96	NA	29.13	775.83	31.26	773.70	26.43	778.53	29.56	775.40
Pembroke #1	NA	NA	12.14	NA	11.88	NA	12.61	NA	NA	NA
Pembroke #2	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
N. Houcks. Rd.	NA	NA	9.47	NA	9.56	NA	9.06	NA	8.49	NA
E. Century St.	NA	NA	23.41	NA	20.89	NA	21.11	NA	12.99	NA
Lwr. Beckleys. Rd.	NA	NA	55.61	NA	56.22	NA	55.89	NA	56.41	NA

Table 2-2
Groundwater Elevation Data (July 2006 through June 2007)
Black & Decker
Hampstead, Maryland

WELL NO.	TOC ELEV	TOTAL DEPTH	11/20/2006		12/15/2006		1/18/2007		2/20/2007	
			DTW	ELEV	DTW	ELEV	DTW	ELEV	DTW	ELEV
EW-1	847.21	55	DRY	NA	DRY	NA	DRY	NA	DRY	NA
EW-2	849.21	110	93.06	756.15	74.71	774.50	76.12	773.09	67.92	781.29
EW-3	846.64	118	87.47	759.17	88.04	758.60	84.47	762.17	81.29	765.35
EW-4	858.01	97.5	NA	NA	NA	NA	NA	NA	NA	NA
EW-5	864.17	98	70.57	793.60	96.00	768.17	68.18	795.99	69.48	794.69
EW-6	831.98	115	95.95	736.03	97.11	734.87	103.16	728.82	95.29	736.69
EW-7	818.38	78	46.80	771.58	55.29	763.09	45.11	773.27	49.49	768.89
EW-8	811.13	98	91.70	719.43	68.08	743.05	64.36	746.77	71.69	739.44
EW-9	811.35	141	101.50	709.85	98.96	712.39	99.41	711.94	91.28	720.07
EW-10	807.74	NA	55.22	752.52	61.22	746.52	59.73	748.01	54.21	753.53
RFW-1A	864.37	78	51.11	813.26	50.96	813.41	50.47	813.90	48.60	815.77
RFW-1B	864.23	200	51.15	813.08	51.00	813.23	50.49	813.74	48.64	815.59
RFW-2A	857.41	35	15.82	841.59	14.91	842.50	15.17	842.24	14.57	842.84
RFW-2B	857.73	75	16.62	841.11	15.43	842.30	15.59	842.14	15.32	842.41
RFW-3B	839.21	153	35.62	803.59	36.41	802.80	35.83	803.38	33.90	805.31
RFW-4A	830.37	62	38.87	791.50	39.94	790.43	37.98	792.39	37.94	792.43
RFW-4B	830.37	120	38.69	791.68	39.88	790.49	38.74	791.63	37.80	792.57
RFW-5A	817.50	30	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-6	785.04	120	3.86	781.18	2.94	782.10	3.96	781.08	4.55	780.49
RFW-7	805.14	29	6.35	798.79	7.87	797.27	8.09	797.05	6.08	799.06
RFW-8	860.07	53	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-9	862.02	49	27.00	835.02	30.27	831.75	25.61	836.41	26.11	835.91
RFW-10	852.06	58	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-11A	849.32	72	NA	NA	NA	NA	NA	NA	NA	NA
RFW-11B	849.62	116	69.48	780.14	73.14	776.48	72.81	776.81	66.84	782.78
RFW-12B	844.87	264	52.37	792.50	62.06	782.81	61.92	782.95	50.88	793.99
RFW-13	849.11	150	64.08	785.03	63.81	785.30	61.57	787.54	64.23	784.88
RFW-14B	812.39	281	50.10	762.29	52.62	759.77	50.60	761.79	51.79	760.60
RFW-16	856.14	41	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-17	834.66	60.5	28.61	806.05	30.43	804.23	30.08	804.58	27.31	807.35
RFW-20	842.29	142	36.65	805.64	37.61	804.68	37.55	804.74	35.02	807.27
RFW-21	832.65	102	23.33	809.32	23.67	808.98	23.49	809.16	22.74	809.91
PH-7	805.94	89	33.77	772.17	34.03	771.91	32.66	773.28	31.62	774.32
PH-9	814.94	98	40.51	774.43	40.63	774.31	40.30	774.64	38.89	776.05
PH-11	820.68	78	42.96	777.72	46.81	773.87	44.73	775.95	45.11	775.57
PH-12	828.35	87	47.89	780.46	49.03	779.32	46.36	781.99	48.71	779.64
B-3	803.02	83	NA	NA	NA	NA	NA	NA	NA	NA
Amoco	842.29	NA	NA	NA	NA	NA	NA	NA	NA	NA
Hamp. Town #22	804.96	NA	27.11	777.85	27.43	777.53	31.12	773.84	26.53	778.43
Pembroke #1	NA	NA	11.93	NA	12.13	NA	NA	NA	NA	NA
Pembroke #2	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
N. Houcks. Rd.	NA	NA	9.17	NA	10.08	NA	9.08	NA	8.98	NA
E. Century St.	NA	NA	22.61	NA	28.11	NA	14.95	NA	19.56	NA
Lwr. Beckleys. Rd.	NA	NA	55.86	NA	55.06	NA	55.89	NA	53.86	NA

Table 2-2
Groundwater Elevation Data (July 2006 through June 2007)
Black & Decker
Hampstead, Maryland

WELL NO.	TOC ELEV	TOTAL DEPTH	3/10/07		4/19/07		5/3/07		6/29/07	
			DTW	ELEV	DTW	ELEV	DTW	ELEV	DTW	ELEV
EW-1	847.21	55	DRY	NA	DRY	NA	DRY	NA	DRY	NA
EW-2	849.21	110	69.01	780.20	69.81	779.40	68.45	780.76	71.71	777.50
EW-3	846.64	118	87.43	759.21	88.11	758.53	87.89	758.75	88.04	758.60
EW-4	858.01	97.5	NA	NA	NA	NA	NA	NA	NA	NA
EW-5	864.17	98	69.38	794.79	68.08	796.09	67.61	796.56	68.43	795.74
EW-6	831.98	115	92.41	739.57	83.11	748.87	81.84	750.14	83.64	748.34
EW-7	818.38	78	56.31	762.07	45.16	773.22	45.63	772.75	49.11	769.27
EW-8	811.13	98	77.80	733.33	68.44	742.69	66.08	745.05	66.81	744.32
EW-9	811.35	141	103.50	707.85	105.78	705.57	103.27	708.08	103.41	707.94
EW-10	807.74	NA	53.58	754.16	51.25	756.49	50.17	757.57	51.84	755.90
RFW-1A	864.37	78	51.11	813.26	50.87	813.50	46.72	817.65	48.51	815.86
RFW-1B	864.23	200	51.15	813.08	50.89	813.34	46.81	817.42	48.54	815.69
RFW-2A	857.41	35	15.71	841.70	15.32	842.09	11.72	845.69	15.74	841.67
RFW-2B	857.73	75	16.15	841.58	15.57	842.16	12.12	845.61	15.83	841.90
RFW-3B	839.21	153	34.61	804.60	34.71	804.50	29.03	810.18	33.80	805.41
RFW-4A	830.37	62	37.14	793.23	37.00	793.37	35.03	795.34	36.71	793.66
RFW-4B	830.37	120	37.02	793.35	36.86	793.51	34.92	795.45	36.40	793.97
RFW-5A	817.50	30	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-6	785.04	120	2.94	782.10	3.02	782.02	3.02	782.02	4.87	780.17
RFW-7	805.14	29	7.12	798.02	7.40	797.74	4.92	800.22	8.19	796.95
RFW-8	860.07	53	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-9	862.02	49	25.57	836.45	24.64	837.38	24.24	837.78	25.06	836.96
RFW-10	852.06	58	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-11A	849.32	72	NA	NA	NA	NA	NA	NA	NA	NA
RFW-11B	849.62	116	68.37	781.25	68.49	781.13	67.26	782.36	69.90	779.72
RFW-12B	844.87	264	51.34	793.53	52.46	792.41	48.92	795.95	53.22	791.65
RFW-13	849.11	150	64.81	784.30	63.88	785.23	62.28	786.83	62.83	786.28
RFW-14B	812.39	281	53.21	759.18	53.61	758.78	52.17	760.22	54.28	758.11
RFW-16	856.14	41	DRY	NA	DRY	NA	DRY	NA	DRY	NA
RFW-17	834.66	60.5	27.88	806.78	27.60	807.06	25.89	808.77	26.96	807.70
RFW-20	842.29	142	35.41	806.88	35.62	806.67	33.87	808.42	34.87	807.42
RFW-21	832.65	102	23.21	809.44	23.27	809.38	21.32	811.33	24.10	808.55
PH-7	805.94	89	31.62	774.32	30.61	775.33	27.43	778.51	29.07	776.87
PH-9	814.94	98	38.77	776.17	39.02	775.92	38.33	776.61	39.14	775.80
PH-11	820.68	78	45.26	775.42	44.04	776.64	45.21	775.47	45.06	775.62
PH-12	828.35	87	48.17	780.18	47.60	780.75	47.94	780.41	47.98	780.37
B-3	803.02	83	NA	NA	NA	NA	NA	NA	NA	NA
Amoco	842.29	NA	NA	NA	NA	NA	NA	NA	NA	NA
Hamp. Town #22	804.96	NA	28.79	776.17	43.00	761.96	29.63	775.33	33.56	771.40
Pembroke #1	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Pembroke #2	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
N. Houcks. Rd.	NA	NA	9.13	NA	9.71	NA	NA	NA	9.89	NA
E. Century St.	NA	NA	20.25	NA	19.29	NA	NA	NA	27.56	NA
Lwr. Beckleys. Rd.	NA	NA	56.17	NA	56.04	NA	NA	NA	54.89	NA

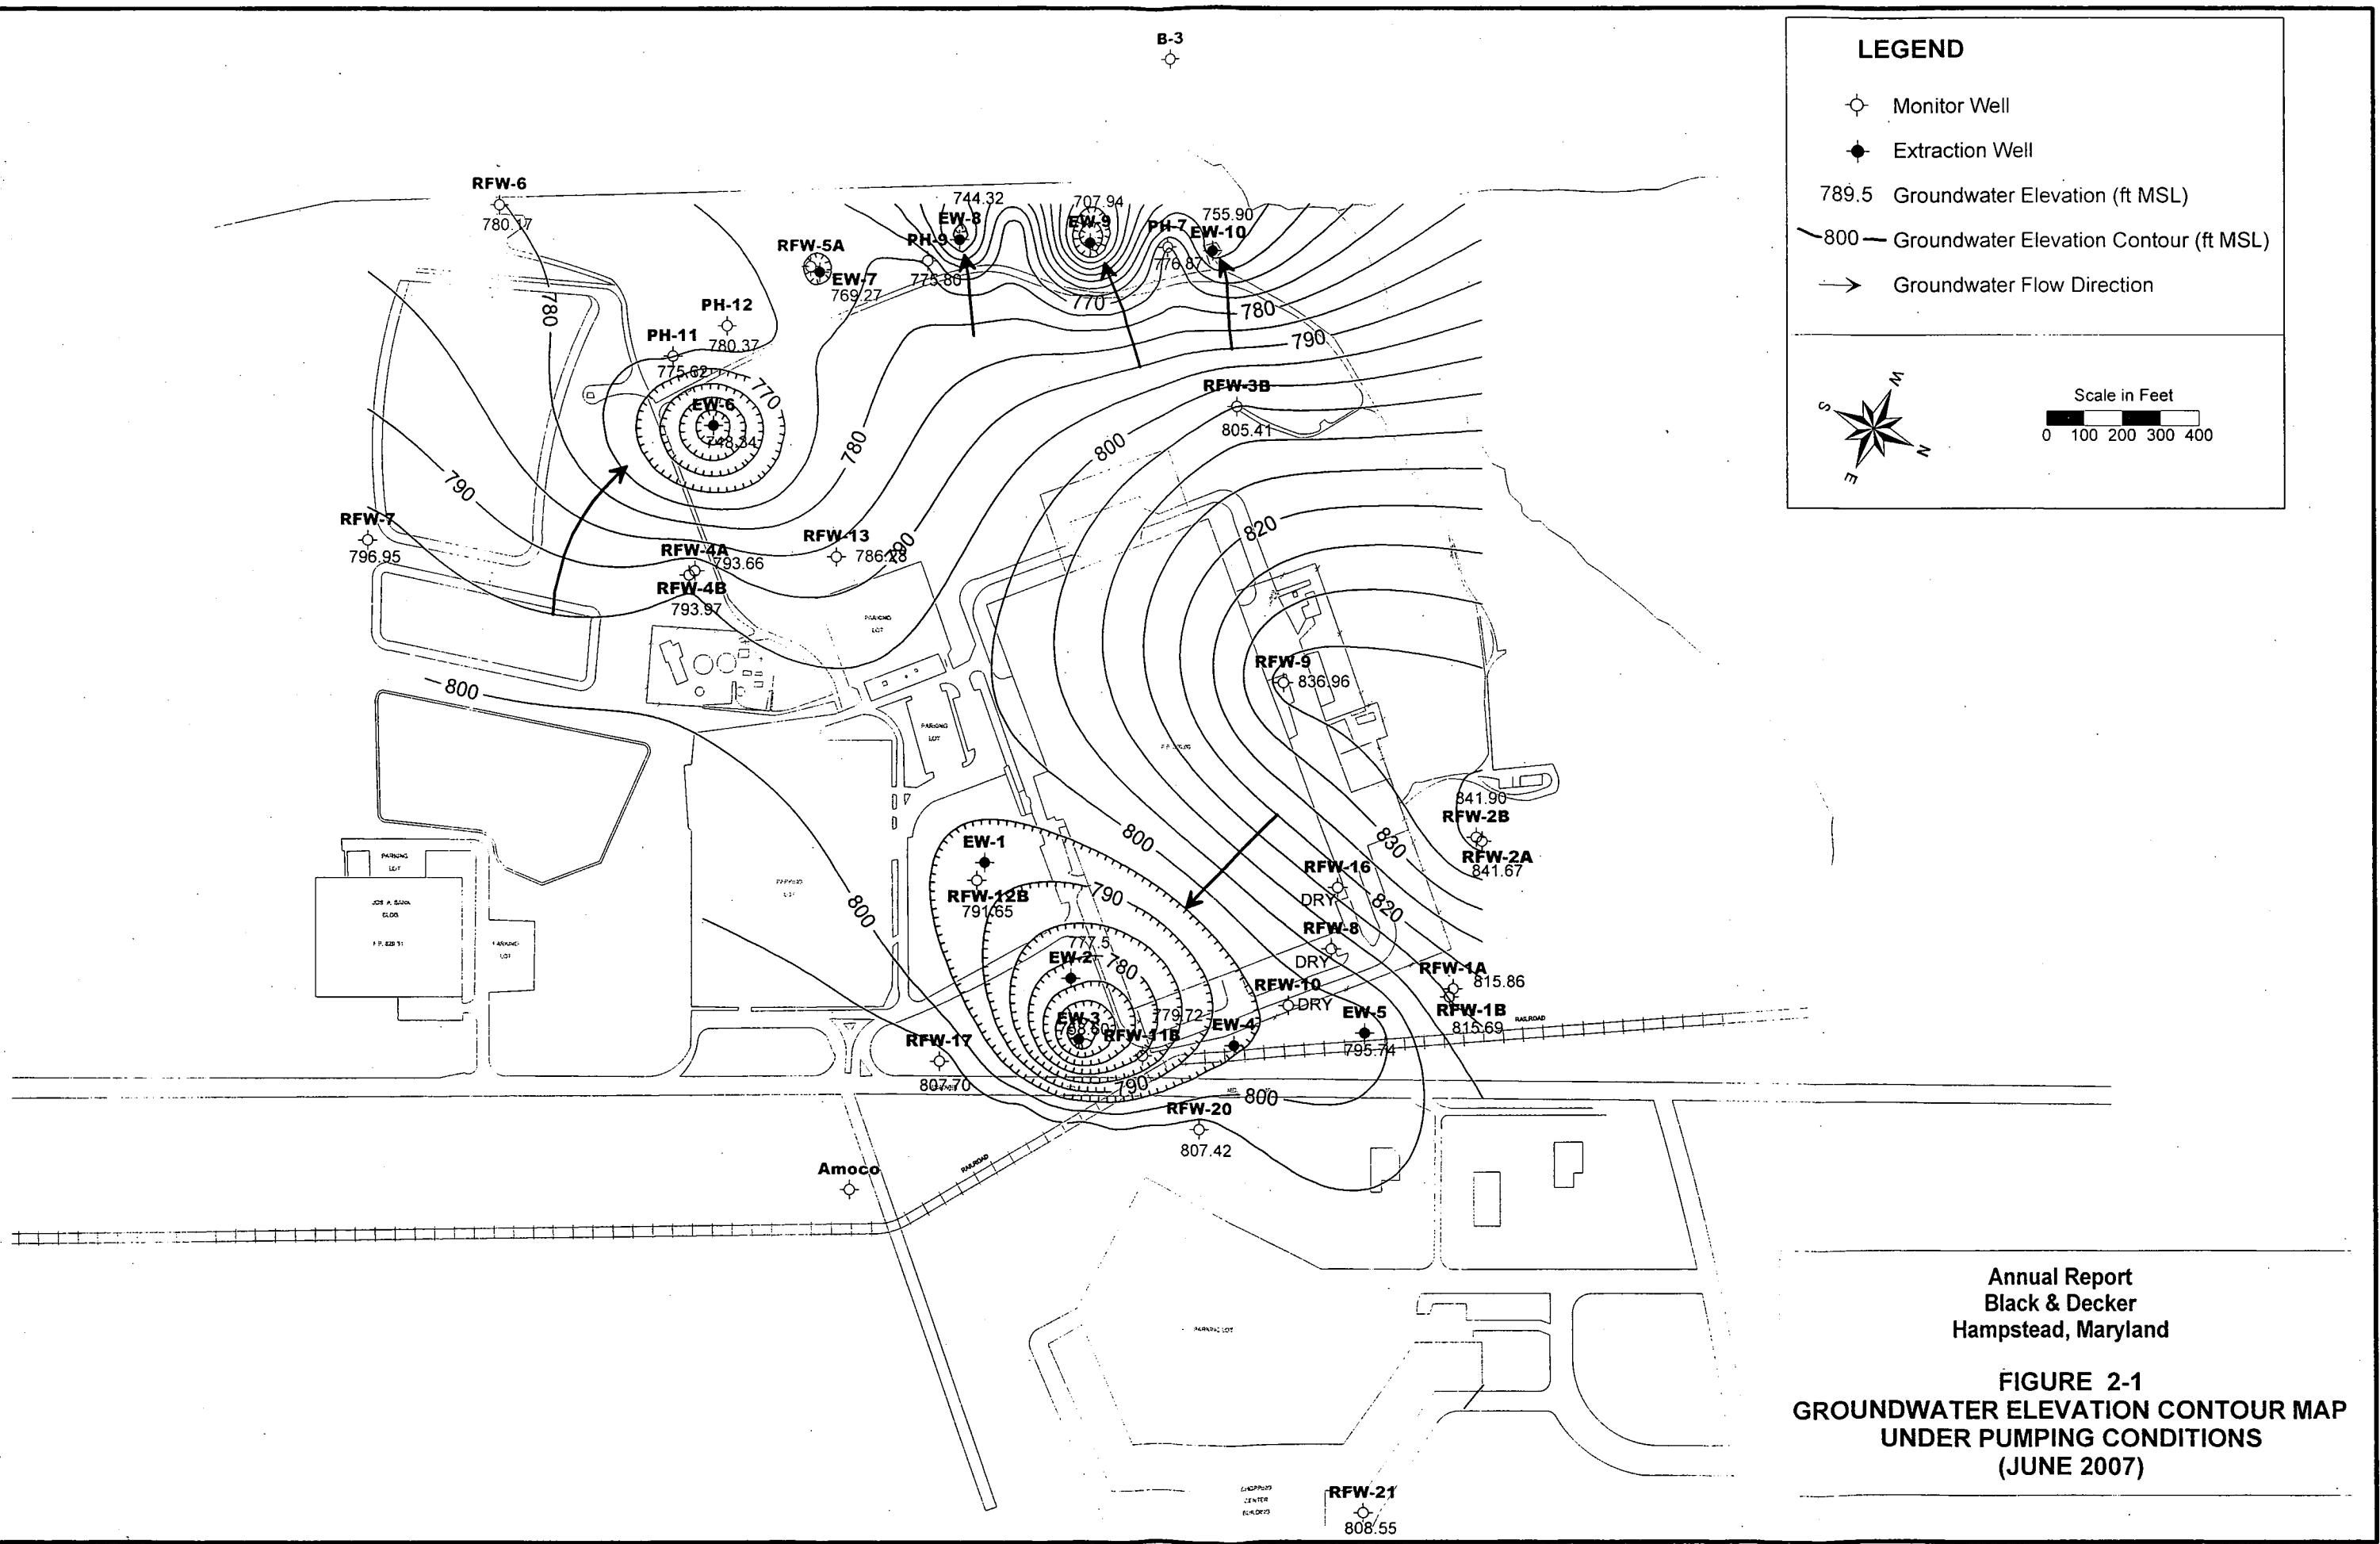


Table 2-3
Effluent Characteristics Summary (July 2006 through June 2007)
Black & Decker
Hampstead, Maryland

Discharge Number	Parameter	Units	Permit Limits	DMR DATE					
				July 2006	August 2006	September 2006	October 2006	November 2006	December 2006
001	FLOW average	MGD	NA	0.161	0.065	0.271	0.182	0.251	0.219
	maximum	MGD	NA	0.234	0.095	0.901	0.657	0.988	0.630
	1,1,1-Trichloroethane	ug/l	5	<5	<5	<5	<5	<5	<5
	Tetrachloroethylene	ug/l	5	<5	<5	<5	<5	<5	<5
	Trichloroethylene	ug/l	5	<5	<5	<5	<5	<5	<5
	Total Residual Chlorine	mg/l	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
	Oil & Grease maximum	mg/l	15	<5	<5	<5	<5	<5	<5
	quarterly average	mg/l	10	NR	NR	<5	NR	NR	<5
	pH minimum	STD	6.0	6.00	6.20	6.10	6.00	6.10	6.10
	maximum	STD	8.5	6.80	6.60	6.70	6.40	6.40	6.40
	BOD	mg/l	15	3.8	2.7	<2	5.3	6.0	<2
	TSS maximum	mg/l	30	3.5	<2.5	9.0	14.0	7.0	<5
	quarterly average	mg/l	20	NR	NR	5.0	NR	NR	<5
101 (Monitoring Point)	FLOW average	MGD	NA	0.235	0.232	0.340	0.344	0.282	0.294
	maximum	MGD	NA	0.266	0.246	0.381	0.383	0.288	0.320
201 (Monitoring Point)	Fecal Coliform	MPN/100ml	200	<2	<2	<2	<2	<2	<2
	FLOW average	MGD	NA	0.217	0.203	0.209	0.204	0.210	0.308
	maximum	MGD	NA	0.253	0.234	0.246	0.242	0.238	1.020
	1,1,1-Trichloroethane	ug/l	NA	<5	<5	<5	<5	<5	<5
	Tetrachloroethylene	ug/l	NA	<5	<5	<5	<5	<5	<5
	Trichloroethylene	ug/l	NA	<5	<5	<5	<5	<5	<5

DMR - Discharge Monitoring Report

NA - Not Applicable

NR - Not Reported

* As noted on the DMR dated 6/30/04, a collection or lab error on the oil/grease caused month/quarter to register high. Follow up tested <5 ppb as in the past.

Table 2-3
Effluent Characteristics Summary (July 2006 through June 2007)
Black & Decker
Hampstead, Maryland

Discharge Number	Parameter	Units	Permit Limits	DMR DATE					
				January 2007	February 2007	March 2007	April 2007	May 2007	June 2007
001	FLOW average maximum	MGD	NA	0.113	0.132	0.317	0.218	0.180	0.089
		MGD	NA	0.132	0.302	0.693	0.249	0.241	0.103
	1,1,1-Trichloroethane	ug/l	5	< 1	< 1	< 1	< 5	< 5	< 5
	Tetrachloroethylene	ug/l	5	< 1	< 1	< 1	< 5	< 5	< 5
	Trichloroethylene	ug/l	5	< 1	< 1	< 1	< 5	< 5	< 5
	Total Residual Chlorine	mg/l	<0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1
	Oil & Grease maximum quarterly average	mg/l	15	< 5	< 5	< 5	< 5	< 5	< 5
		mg/l	10	NR	NR	< 5	< 5	< 5	< 5
	pH minimum maximum	STD	6.0	6.00	6.00	6.40	6.70	6.80	6.70
		STD	8.5	6.90	6.90	7.10	6.90	7.30	8.30
	BOD	mg/l	15	< 2	3.0	4.0	2.0	0.0	< 2
	TSS maximum quarterly average	mg/l	30	< 4	< 4	17.0	6.0	< 4	6.0
		mg/l	20	NR	NR	17.0	NR	NR	6.0
101 (Monitoring Point)	FLOW average maximum	MGD	NA	ND	ND	0.037	0.069	0.068	0.028
		MGD	NA	ND	ND	0.333	0.330	0.281	0.251
	Fecal Coliform	MPN/100ml	200	ND	ND	1.0	8.0	< 2	< 2
201 (Monitoring Point)	FLOW average maximum	MGD	NA	0.209	NR	0.250	NR	NR	0.237
		MGD	NA	0.368	NR	0.693	NR	NR	0.801
	1,1,1-Trichloroethane	ug/l	NA	< 1	NR	< 1	NR	NR	< 5
	Tetrachloroethylene	ug/l	NA	< 1	NR	< 1	NR	NR	< 5
	Trichloroethylene	ug/l	NA	< 1	NR	< 1	NR	NR	< 5

DMR - Discharge Monitoring Report

NA - Not Applicable

NR - Not Reported

* As noted on the DMR dated 6/30/04, a collection or lab error on the oil/grease caused month/quarter to register high. Follow up tested <5 ppb as in the past.

2007 are included in Tables 2-4, 2-5, 2-6, and 2-7, respectively. As found in earlier sampling events at the Black & Decker facility, TCE and PCE were the primary VOCs detected at the highest concentrations in the groundwater samples. The highest concentrations of TCE were detected in the groundwater samples collected from wells EW-2 and EW-4 and the highest concentrations of PCE were detected in the groundwater samples collected from well EW-9. The remainder of the detected VOCs, were detected at levels well below the Federal Maximum Concentration Levels (MCLs). The second quarter 2007 (May 2007) analytical data package is included in Appendix D. Analytical data packages for the remaining quarters are included in the respective Quarterly Groundwater Monitoring Reports.

Table 2-4
Summary of Groundwater Analytical Results - August 2006
Black & Decker
Hampstead, Maryland

PARAMETER	Units	EW-1	EW-2	EW-3	EW-3 (DUP)	EW-4	EW-5	EW-6	EW-7	EW-8	EW-9	EW-10
Chloromethane	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Acetone	ug/L	NS	5 U	5 U	5 U	10 U	5 U	5 U	5 U	5 U	5 U	5 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	10 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	0.94 J	1 U	1 U	1 U
1,2-Dichloroethene (total)	ug/L	NS	2.6	1.9	2	2'U	1 U	1 U	8.6	20	1 U	1 U
Chloroform	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	10 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Trichloroethene	ug/L	NS	460	160	160	770	250	12	7.3	11	1.3	1 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Benzene	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromoform	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	10 U	5 U	5 U	5 U	5 U	5 U	5 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	10 U	5 U	5 U	5 U	5 U	5 U	5 U
Tetrachloroethene	ug/L	NS	52	4.2	4.3	18	12	25	13	65	160	5
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Toluene	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Styrene	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	2 U	1 U	1 U	1 U	1 U	1 U	1 U

Notes: U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.

J = Indicates an estimated value.

Table 2-4
Summary of Groundwater Analytical Results - August 2006
Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-1A	RFW-1B	RFW-2A	RFW-2B	RFW-3B	RFW-4A	RFW-4B (DUP)	RFW-5A	RFW-6	RFW-7	RFW-8	RFW-9	RFW-10	
Chloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Bromomethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Vinyl Chloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Chloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Methylene Chloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Acetone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS	
Carbon Disulfide	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS	
1,1-Dichloroethene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1.2	NS	
1,1-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
1,2-Dichloroethene (total)	ug/L	1 U	1 U	1 U	1 U	7.5	1	4.3	4.7	NS	1.2	1 U	NS	6.3	NS
Chloroform	ug/L	1 U	1 U	1 U	1 U	1 U	0.93 J	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
2-Butanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS	
1,1,1-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1.6	NS
Carbon Tetrachloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromodichloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloropropane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
cis-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trichloroethene	ug/L	1 U	1 U	1.5	1 U	6.3	43	13	6.3	NS	8.1	6.7	NS	17	NS
Dibromochloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,1,2-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Benzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trans-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromoform	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
4-Methyl-2-pentanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
2-Hexanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Tetrachloroethene	ug/L	1 U	1 U	1 U	1 U	5	49	43	30	NS	5.2	1 U	NS	2.9	NS
1,1,2,2-Tetrachloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Toluene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chlorobenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Ethylbenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Styrene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Xylene (total)	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS

Notes: DUP = Duplicate sample

NS = Not sampled

U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.

J = Indicates an estimated value.

Table 2-4
Summary of Groundwater Analytical Results - August 2006
Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-11A	RFW-11B	RFW-12B	RFW-13	RFW-16	RFW-17	RFW-20	RFW-21	Town #22	Town #23	Leister Dairy	Leister Res.#1	Leister Res.#2	Trip Blank
Chloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Acetone	ug/L	NS	5 U	5 U	5 U	NS	5 U	10 U	10 U	10 U	10 U	5 U	5 U	5 U	5 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	NS	5 U	NA	NA	NA	NA	5 U	5 U	5 U	5 U
1,1-Dichloroethene	ug/L	NS	1 U	0.76 J	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
1,2-Dichloroethene (total)	ug/L	NS	1 U	6.4	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Chloroform	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	10 U	10 U	10 U	10 U	5 U	5 U	5 U	5 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Trichloroethene	ug/L	NS	19	320	15	NS	1 U	1.4	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Benzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Bromoform	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	10 U	10 U	10 U	10 U	5 U	5 U	5 U	5 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	10 U	10 U	10 U	10 U	5 U	5 U	5 U	5 U
Tetrachloroethene	ug/L	NS	1 U	27	46	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Toluene	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Styrene	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1 U	1 U	1 U	1 U

Notes: Samples from wells RFW-20 & 21, Town-22&23 are analyzed with the USEPA drinking water method 524.2 at the request of the MDE Source Protection and Appropriation Division. Samples from all of the other wells are analyzed with USEPA Method 8260.

NS = Not sampled

U = Compound was analyzed but not detected.

Table 2-5
Summary of Groundwater Analytical Results - November 2006
Black & Decker
Hampstead, Maryland

PARAMETER	UNITS	EW-1	EW-2	EW-3	EW-4	EW-5	EW-6	EW-7	EW-8	EW-9	EW-9 (DUP)	EW-10
Chloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1.4
Acetone	ug/L	NS	5 U	6.4	5 U	5 U	5.7	5 U	5 U	5 U	5 U	5 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 J	1 U	1 U	1 U	1 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethene (total)	ug/L	NS	3.6	2.2	1 U	1 U	1 U	8.8	35	1.4	1.4	1 U
Chloroform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trichloroethene	ug/L	NS	420	180	840	230	11	6.9	16	2.1	1.9	1 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Benzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromoform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Tetrachloroethene	ug/L	NS	56	4.6	16	10	21	14	100	230	220	5.4
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Toluene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Styrene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U

Notes: U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.

J = Indicates an estimated value.

Table 2-5
Summary of Groundwater Analytical Results - November 2006
Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-1A	RFW-1B	RFW-2A	RFW-2B	RFW-3B	RFW-4A	RFW-4B	RFW-4B (DUP)	RFW-5A	RFW-6	RFW-7	RFW-8	RFW-9	RFW-10
Chloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1.7	NS	1 U	NS
Bromomethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Vinyl Chloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Methylene Chloride	ug/L	1 U	1 U	1 U	1 U	1.3	7.2	1	1 U	NS	1 U	1 U	NS	1 U	NS
Acetone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5	8	NS	5 U	5 U	NS	5 U	NS
Carbon Disulfide	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1-Dichloroethene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1.1	NS
1,1-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1	NS
1,2-Dichloroethene (total)	ug/L	1 U	1 U	1 U	1 U	8.4	1.2	8.5	7.4	NS	1	1 U	NS	13	NS
Chloroform	ug/L	1 U	1 U	1 U	1 U	1 U	1.2	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
2-Butanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1,1-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Carbon Tetrachloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromodichloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloropropane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
cis-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trichloroethene	ug/L	1 U	1 U	2.2	1.6	1 U	36	9	8.8	NS	4.9	3.4	NS	16	NS
Dibromochloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,1,2-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Benzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trans-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromoform	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
4-Methyl-2-pentanone	ug/L	5 U	5 U	5 U	1 J	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
2-Hexanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Tetrachloroethene	ug/L	1 U	1 U	1 U	1 U	3	33	60	66	NS	4.1	1 U	NS	6.7	NS
1,1,2,2-Tetrachloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Toluene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chlorobenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Ethylbenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Styrene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Xylene (total)	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS

Notes: DUP = Duplicate sample

NS = Not sampled

U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.

J = Indicates an estimated value.

Table 2-5
Summary of Groundwater Analytical Results - November 2006
Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-11A	RFW-11B	RFW-12B	RFW-13	RFW-16	RFW-17	Leister Dairy	Leister Res. #1	Leister Res. #2	Trip Blank	RFW-20	RFW-21	Town #22	Town #23	Trip Blank
		USEPA drinking water method 524.2														
Chloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.66	0.5 U	1.5
Bromomethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Acetone	ug/L	NS	5 U	5 U	8.2	NS	5 U	5 U	5 U	NS	5 U	40	48	71	73	10 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	NS	5 U	5 U	5 U	NS	5 U	NA	NA	NA	NA	NA
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloroethene (total)	ug/L	NS	1 U	3.7	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroform	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	5 U	5 U	NS	5 U	10 U	10 U	10 U	10 U	10 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trichloroethene	ug/L	NS	19	560	3.3	NS	1 U	1 U	1 U	NS	1 U	0.6	0.5 U	0.5 U	0.5 U	0.5 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Benzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromoform	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	1
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	5 U	5 U	NS	5 U	10 U	10 U	10 U	10 U	10 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	5 U	5 U	NS	5 U	10 U	10 U	10 U	10 U	10 U
Tetrachloroethene	ug/L	NS	1 U	41	15	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Toluene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.3 J	0.2 J	0.29 J	0.44 J	0.5 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Styrene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U

Notes: Samples from wells RFW-20 & 21, Town-22&23 are analyzed with the USEPA drinking water method 524.2 at the request of the MDE Source Protection and Appropriation Division. Samples from all of the other wells are analyzed with USEPA Method 8260.

NS = Not sampled

U = Compound was analyzed but not detected.

Table 2-6
Summary of Groundwater Analytical Results - February 2007
Black & Decker
Hampstead, Maryland

PARAMETER	UNITS	EW-1	EW-2	EW-3	EW-4	EW-5	EW-6	EW-7	EW-8	EW-9	EW-9 (DUP)	EW-10
Chloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Acetone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethene (total)	ug/L	NS	2.7	2	1 U	1 U	1 U	7.2	23	1	1 U	1 U
Chloroform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1.6	1 U	1 U	1 U	1 U	1 U	1 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trichloroethene	ug/L	NS	400	140	1100	190	9	5.6	12	1.5	1.3	1 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Benzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromoform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Tetrachloroethene	ug/L	NS	59	4	20	9	17	11	83	180	150	3.7
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Toluene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Styrene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U

Notes: U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.

J = Indicates an estimated value.

Table 2-6
Summary of Groundwater Analytical Results - February 2007
Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-1A	RFW-1B	RFW-2A	RFW-2B	RFW-3B	RFW-4A	RFW-4B (DUP)	RFW-4B (DUP)	RFW-5A	RFW-6	RFW-7	RFW-8	RFW-9	RFW-10
Chloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromomethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Vinyl Chloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Methylene Chloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Acetone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Carbon Disulfide	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1-Dichloroethene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1.4	NS
1,1-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloroethene (total)	ug/L	1 U	1 U	1 U	1 U	6.5	1 U	4	3.8	NS	1 U	1 U	NS	13	NS
Chloroform	ug/L	1 U	1 U	1 U	1 U	1 U	1	1.8	1.7	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
2-Butanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
1,1,1-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1.7	NS
Carbon Tetrachloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromodichloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,2-Dichloropropane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
cis-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trichloroethene	ug/L	1 U	1 U	1.3	1.4	1.2	32	48	48	NS	2.8	6.4	NS	19	NS
Dibromochloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
1,1,2-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Benzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Trans-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Bromoform	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
4-Methyl-2-pentanone	ug/L	5 U	5 U	5 U	1 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
2-Hexanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	5 U	NS
Tetrachloroethene	ug/L	1 U	1 U	1 U	1 U	2.4	30	80	84	NS	2.7	1 U	NS	6.7	NS
1,1,2,2-Tetrachloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Toluene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Chlorobenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Ethylbenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Styrene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS
Xylene (total)	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS

Notes: DUP = Duplicate sample

NS = Not sampled

U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.

J = Indicates an estimated value.

Table 2-6
Summary of Groundwater Analytical Results - February 2007
Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-11A	RFW-11B	RFW-12B (5)	RFW-13	RFW-16	RFW-17	Leister Dairy	Leister Res. #1	Leister Res. #2	Trip Blank	RFW-20	RFW-21	Town #22	Town #23	Trip Blank
		USEPA drinking water method 524.2														
Chloromethane	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromomethane	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroethane	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Acetone	ug/L	NS	5 U	25 U	5 U	NS	5 U	5 U	5 U	NS	5 U	20	19	19	21	10 U
Carbon Disulfide	ug/L	NS	5 U	25 U	5 U	NS	5 U	5 U	5 U	NS	5 U	NA	NA	NA	NA	NA
1,1-Dichloroethene	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1-Dichloroethane	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloroethene (total)	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroform	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloroethane	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
2-Butanone	ug/L	NS	5 U	25 U	5 U	NS	5 U	5 U	5 U	NS	5 U	10 U	10 U	10 U	10 U	10 U
1,1,1-Trichloroethane	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Carbon Tetrachloride	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromodichloromethane	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloropropane	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trichloroethene	ug/L	NS	19	520	4.6	NS	1 U	1 U	1 U	NS	1 U	0.5 J	0.5 U	0.5 U	0.5 U	0.5 U
Dibromochloromethane	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2-Trichloroethane	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Benzene	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromoform	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
4-Methyl-2-pentanone	ug/L	NS	5 U	25 U	5 U	NS	5 U	5 U	5 U	NS	5 U	10 U	10 U	10 U	10 U	10 U
2-Hexanone	ug/L	NS	5 U	25 U	5 U	NS	5 U	5 U	5 U	NS	5 U	10 U	10 U	10 U	10 U	10 U
Tetrachloroethene	ug/L	NS	1.5	44	22	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Toluene	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chlorobenzene	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Ethylbenzene	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Styrene	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Xylene (total)	ug/L	NS	1 U	5 U	1 U	NS	1 U	1 U	1 U	NS	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U

Notes: Samples from wells RFW-20 & 21, Town-22&23 are analyzed with the USEPA drinking water method 524.2 at the request of the MDE Source Protection and Appropriation Division. Samples from all of the other wells are analyzed with USEPA Method 8260.

NS = Not sampled

U = Compound was analyzed but not detected.

Table 2-7
Summary of Groundwater Analytical Results - May 2007
Black & Decker
Hampstead, Maryland

PARAMETER	Units	EW-1	EW-2	EW-3	EW-4	EW-5	EW-6	EW-7	EW-8	EW-9	EW-9 DUP	EW-10
Chloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chloroethanane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	1.6	1.7	17	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Acetone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethene (total)	ug/L	NS	2.3	1.8	1 U	1 U	1 U	4.9	16	1 U	1 U	1 U
Chloroform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1.2	1 U	1 U	1 U	1 U	1 U	1 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trichloroethene	ug/L	NS	390	130	1300	160	9.2	4.4	8.6	1.4	1.4	1 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Benzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromoform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Tetrachloroethene	ug/L	NS	64	3.1	27	7	17	8.4	58	170	170	2.5
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Toluene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Styrene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U

DUP = Duplicate sample

NS = Not sampled

(2.5) = Dilution factor.

U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.

J = Indicates an estimated value.

B = Indicates that the analyte was found in the associated blank as well as in the sample.

Table 2-7
Summary of Groundwater Analytical Results - May 2007
Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-1A	RFW-1B	RFW-2A	RFW-2B	RFW-3B	RFW-4A	RFW-4B (DUP)	RFW-4B (DUP)	RFW-5A	RFW-6	RFW-7	RFW-8	RFW-9	RFW-10	
Chloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Bromomethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Vinyl Chloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Chloroethanane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Methylene Chloride	ug/L	3.4	2.8	2.9	3.1	3	2.8	3.1	2.2	NS	1.9	1.8	NS	1.8	NS	
Acetone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	1 U	5 U	NS	1 U	NS	
Carbon Disulfide	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	1 U	5 U	NS	1 U	NS	
1,1-Dichloroethene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1.1	NS	
1,1-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
1,2-Dichloroethene (total)	ug/L	1 U	1 U	1 U	1 U	1 U	6	1 U	3.9	4.1	NS	1 U	1 U	NS	9.6	NS
Chloroform	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1.5	1.6	NS	1 U	1 U	NS	1 U	NS	
1,2-Dichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
2-Butanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	1 U	5 U	NS	1 U	NS	
1,1,1-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1.5	NS	
Carbon Tetrachloride	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Bromodichloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
1,2-Dichloropropane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	5 U	1 U	NS	1 U	NS	
cis-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	5 U	1 U	NS	1 U	NS	
Trichloroethene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	30	44	47	NS	2.3	3.2	NS	15	NS
Dibromochloromethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
1,1,2-Trichloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Benzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Trans-1,3-Dichloropropene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Bromoform	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
4-Methyl-2-pentanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	1 U	NS	
2-Hexanone	ug/L	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	NS	5 U	5 U	NS	1 U	NS	
Tetrachloroethene	ug/L	1 U	1 U	1 U	1 U	2.1	26	74	80	NS	2.3	1 U	NS	3.6	NS	
1,1,2,2-Tetrachloroethane	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Toluene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Chlorobenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Ethylbenzene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Styrene	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	
Xylene (total)	ug/L	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	NS	1 U	1 U	NS	1 U	NS	

DUP = Duplicate sample

NS = Not sampled

(2.5) = Dilution factor.

U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.

J = Indicates an estimated value.

B = Indicates that the analyte was found in the associated blank as well as in the sample.

Table 2-7
Summary of Groundwater Analytical Results - May 2007
Black & Decker
Hampstead, Maryland

PARAMETER	Units	RFW-11A	RFW-11B	RFW-12B	RFW-13	RFW-16	RFW-17	Leister Dairy	Leister Res. #1	Leister Res. #2	Trip Blank	RFW-20	RFW-21	Town #22	Town #23	Trip Blank
		USEPA drinking water method 524.2														
Chloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroethanane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	1.9	1.9	2	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Acetone	ug/L	NS	5 U	5 U	5 U	NS	5 U	5 U	5 U	5 U	5 U	10 U	10 U	10 U	6.6 J	10 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	NS	5 U	5 U	5 U	5 U	5 U	NA	NA	NA	NA	NA
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloroethene (total)	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chloroform	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	5 U	5 U	5 U	5 U	10 U	10 U	10 U	10 U	10 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trichloroethene	ug/L	NS	15	20	3.7	NS	1 U	1 U	1 U	1 U	1 U	0.6	0.5 U	0.5 U	0.5 U	0.5 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Benzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Bromoform	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	5 U	5 U	5 U	5 U	10 U	10 U	10 U	10 U	10 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	NS	5 U	5 U	5 U	5 U	5 U	10 U	10 U	10 U	10 U	10 U
Tetrachloroethene	ug/L	NS	1 U	5	16	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Toluene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Styrene	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	NS	1 U	1 U	1 U	1 U	1 U	0.5 U	0.5 U	0.5 U	0.5 U	0.5 U

Note: Samples from wells RFW-20&21, Town-22&23 are analyzed with USEPA Method 524.2 at the request of the MDE Source Protection and Appropriation Division. Samples from all other wells are analyzed with

U = Compound was analyzed for but not detected. Value shown is the method detection

J = Indicates an estimated value.

B = Indicates that the analyte was found in the associated blank as well as in the sample.

DUP = Duplicate sample

NS = Not sampled

(2.5) = Dilution factor.

3. OPERATION AND MAINTENANCE OF THE TREATMENT SYSTEM

A summary of the maintenance activities that were performed on the extraction and treatment system during the reporting period (July 2006 through June 2007) is provided in Table 3-1. This table is comprehensive in summarizing significant maintenance events or activities, while not including those activities considered unworthy of note (such as replacement of light bulbs, lubrication of moving parts, as appropriate, or other routine activities).

Table 3-1
Treatment System Maintenance Activities (July 2006 through June 2007)
Black & Decker
Hampstead, Maryland

Date	Event/Corrective Action
August 2006	EW-10 went down. The pump motor was burned out . A new pump and motor were installed. The well was down for 7 days. The well is back online.
October 2006	Replaced the pump in well EW-8. Bleached the well, the well is back in service.
October 2006	Replaced the pump in well EW-7. Bleached the well, the well is back in service.
December 2006	Low wet well alarm. Substation tripped out. Restored power to substation.
December 2006	Pump in well EW-3 is surging between 0-30 GPM. A new pump is installed and the well is pumping 38 GPM. The well was down for two days.
December 2006	Pump in well EW-2 went down. A new pump and motor was installed The well was down for six days. The well is now back online.
December 2006	Alarm at the air stripper. High column and blower failure. Switch blowers, air stripper back online.
January 2007	Alarm at stripper, due to power outage. Power was restored, the system is back online.
March 2007	Electricity turned off to wells EW-1 through EW-5 to repair electrical connections. Wells were off for a few hours. The wells are back online.
May 2007	Power failure at the air stripper building and extraction wells, power was off for 24 hours. A backup power feed was run to the air stripper and the extraction wells. Once power was restored to the wells, only wells EW-2, 4 & 6 could be run without tripping the high column alarm. Adjustments were made to the Moore Controllers, all wells are back online. Wells EW-2,4 & 6 were the only wells pumping for 3 days.

4. TREATMENT SYSTEM PERFORMANCE EVALUATION

During the reporting period of July 2006 to June 2007, depth-to-water measurements were collected in all site monitor wells on a monthly basis. A groundwater elevation contour map was constructed each month to verify that the groundwater extraction system was providing a hydraulic barrier to prevent any groundwater contamination from migrating off-site. Pumping rates were adjusted as necessary to ensure that hydraulic control was being maintained across the site. Significant drawdown has been observed in both shallow and deeper monitor wells throughout the long-term pumping of the extraction well system, indicating that considerable interconnection exists between the shallow and deeper groundwater.

As evidenced by the groundwater elevation contour map (Figure 2-1), groundwater flow is still principally to the southwest, with some components to the south and east. However, depressions in the groundwater surface, due to the pumping of the extraction wells, are evident on the map and the flow lines indicate that direction of groundwater flow is toward the extraction wells. The system as presently configured is successful in meeting the objective of capturing on-site groundwater, thereby reducing the potential off-site migration of contaminated groundwater. The system is also successful in treating the collected groundwater to remove the VOCs from the water. The laboratory analytical results of the treated discharge water indicate that no VOCs are present.

5. RECOMMENDATIONS

As discussed in Section 4, the treatment system has created a hydraulic boundary that prevents the off-site migration of groundwater. The extraction system will continue to operate as currently configured to pump and treat contaminated groundwater. Depth-to-water measurements will continue to be collected on a monthly basis in all site monitor wells to construct a groundwater elevation contour map for the site. The groundwater elevation contour map will be used to verify that the required area of groundwater capture is being maintained. If necessary, pumping rates will be adjusted to maintain groundwater capture due to seasonal fluctuations in groundwater elevations. The treatment system will also continue to operate as currently configured, as data collected have proven that the treatment system is fully effective in removing VOCs from the extracted groundwater.

APPENDIX A
WITHDRAWAL REPORTS

MARYLAND DEPARTMENT of the ENVIRONMENT, WATER MANAGEMENT ADMINISTRATION, 1800 WASHINGTON BLVD, BALTIMORE, MD 21230

Operated By:

Maryland Environmental Service
259 Nokes Road, Millersville MD

Facility: BTR Capital Group

Penit Number: 02-DP-0022

Month: APRIL

Address: 626 Hanover Pike, Hampstead Maryland

Operator: Justin Myers

Year: # 2007

Certification # 8406

Date	Appearance	Final Effluent outfall 001										Outfall 101					Outfall 201					Comments
		Discharge MGD	pH	Cl2 mg/l	Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l	Trichloroethene ug/l	BOD ₅ mg/l	TSS mg/l	O&G mg/l	Flow MGD	Fecal mgps	Basin inches	Alum Gpd	Hypochlorite Gpd	Post Cl2 mg/l	Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l	Trichloroethene ug/l	Discharge mgd		
1	clear	0.1850									0.00000		0.0								0.214096	
2	clear	0.2110									0.27000		1.0	20.0		5.0					0.235441	
3	clear	0.1920	6.8	0.00							0.26500		3.0	20.0		2.8					0.227415	
4	clear	0.2030			< 1.00	< 1.00	< 1.00	2.0	6.0	< 5.0	0.26900	8	7.0	20.0		3.4	< 1	< 1	< 1	< 1	0.204945	
5	clear	0.1910	6.7	0.00							0.33000		10.0	20.0		3.0					0.239101	
6	clear	0.2280									0.07000		15.0	0.0		5.0					0.199754	
7	clear	0.2080									0.00000		12.0	0.0							0.219610	
8	clear	0.2020									0.00000		12.0	0.0							0.224351	
9	clear	0.2030									0.00000		12.0	0.0							0.219610	
10	clear	0.2200	6.7	0.00							0.00000		11.0	0.0							0.235569	
11	clear	0.2000									0.00000		10.0	0.0							0.206195	
12	clear	0.2080	6.8	0.00							0.00000		8.0	0.0							0.220934	
13	clear	0.2370									0.00000		7.0	0.0							0.236077	
14	clear	0.2090									0.00000		6.0	0.0							0.217442	
15	clear	0.2110									0.00000		3.0	0.0							0.215274	
16	clear	0.2170									0.00000		1.0	0.0							0.233796	
17	clear	0.2100	6.9	0.00							0.27900		1.0	20.0		1.4					0.207147	
18	clear	0.2240									0.30500		4.0	20.0		2.4					0.227784	
19	clear	0.2060	6.7	0.00							0.28900		8.0	20.0		2.3					0.216241	
20	clear	0.2490									0.00000	< 2	11.0	0.0		3.2					0.235099	
21	clear	0.2290									0.00000		11.0	0.0							0.220716	
22	clear	0.2160									0.00000		11.0	0.0							0.216303	
23	clear	0.2370									0.00000		9.0	0.0							0.239728	
24	clear	0.2270	6.9	0.00							0.00000		8.0	0.0							0.213051	
25	clear	0.2460									0.00000		7.0	0.0							0.222388	
26	clear	0.2350	6.8	0.00							0.00000		6.0	0.0							0.232564	
27	clear	0.2390									0.00000		0.0	0.0							0.212030	
28	clear	0.2490									0.00000		0.0	0.0							0.237590	
29	clear	0.2340									0.00000		0.0	0.0							0.232478	
30	clear	0.2240									0.00000		0.0	20.0		2.5					0.233701	
Total		6.5500	54.3		0.0	0.0	0.0	2	6	0	2.07700	9	194.0	160.0	0.0	31.0	0.00	0.00	0.00	6.69043		
Average		0.2183	6.8	<0.10	0.0	0.0	0.0	2	6	0	0.06923	5	6.7	5.3	#DIV/0!	3.1	0.00	0.00	0.00	0.22321		
Minimum		0.1850	6.7	<0.10	0.0	0.0	0.0	2	6	0	0.00000	1	0.0	0.0	0.0	1.4	0.00	0.00	0.00	0.19975		
Maximum		0.2490	6.9	<0.10	0.0	0.0	0.0	0.0	2	6	0	0.33000	8	15.0	20.0	0.0	5.0	0.00	0.00	0.00	0.23973	

MOR 3-15-07

MARYLAND DEPARTMENT of the ENVIRONMENT, WATER MANAGEMENT ADMINISTRATION, 1800 WASHINGTON BLVD, BALTIMORE, MD 21230

Operated By:

Maryland Environmental Service
259 Najoles Road, Millersville MD

Facility: BTR Capital Group

Address: 626 Hanover Pike, Hampstead Maryland

Permit Number: 02-DP-0022

Month: MAY

Operator: Justin Myers

Year: # 2007

Certification # 8406

Date	Appearance	Final Effluent outfall 001									Outfall 101							Outfall 201					Comments
		Discharge MGD	pH su	Cl2 mg/l	Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l	Trichloroethene ug/l	BOD ₅ mg/l	TSS mg/l	O&G mg/l	Flow MGD	Fecal mppn	Basin Inches	Alum Gpd	Hypochlorite Gpd	Post Cl2 mg/l	Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l	Trichloroethene ug/l	Discharge mgd			
1	clear	0.2280	7.0	0.00							0.27300		4.0	20.0	4.0	3.4						0.205082	
2	clear	0.2230			< 1.00	< 1.00	< 1.00	< 2.0	< 7.0	< 5.0	0.24300		7.0	20.0	6.0	2.0	< 1	< 1	< 1			0.226536	
3	clear	0.2370	6.9	0.00							0.28100		10.0	20.0	6.0	3.0						0.236101	
4	clear	0.2280									0.16500		14.0	20.0	6.0	5.0						0.225437	
5	clear	0.2190									0.00000		15.0	0.0	6.0	5.0						0.228402	
6	clear	0.2080									0.00000		15.0	0.0	0.0							0.258898	
7	clear	0.2190	6.9	0.00							0.00000		16.0	0.0	0.0							0.212236	
8	clear	0.2190									0.00000		14.0	0.0	0.0							0.217067	
9	clear	0.2290									0.00000		12.0	0.0	0.0							0.229163	
10	clear	0.2040	7.1	0.00							0.00000		12.0	0.0	0.0							0.210809	
11	clear	0.2410									0.00000		11.0	0.0	0.0							0.248051	
12	clear	0.2330									0.00000		10.0	0.0	0.0							0.241409	
13	clear	0.2000									0.00000		10.0	0.0	0.0							0.197610	
14	clear	0.2260	7.3	0.00							0.00000		8.0	0.0	0.0							0.251108	
15	clear	0.2120	7.3	0.00							0.00000		8.0	0.0	0.0							0.223139	
16	clear	0.2100									0.00000		7.0	0.0	0.0							0.219141	
17	clear	0.2150	6.8	0.00							0.00000		6.0	0.0	0.0							0.250152	
18	clear	0.2290									0.00000		5.0	0.0	0.0							0.223663	
19	clear	0.2160									0.00000		4.0	0.0	0.0							0.228516	
20	clear	0.2050									0.00000		4.0	0.0	0.0							0.228516	
21	clear	0.2230									0.00000		3.0	0.0	0.0							0.239637	
22	clear	0.1970	7.1	0.00							0.00000		2.0	0.0	0.0							0.219060	
23	clear	0.1020									0.00000		2.0	0.0	0.0							0.251156	
24	clear	0.0810	7.2	0.00							0.00000		1.0	0.0	0.0							0.224226	
25	clear	0.0630									0.00000		0.0	0.0	0.0							0.114333	Power outage
26	clear	0.1080									0.00000		0.0	0.0	0.0							0.059944	
27	clear	0.0810									0.19700		0.0	0.0	0.0							0.042610	
28	clear	0.0850									0.22000		1.0	20.0	5.0	2.7						0.080118	Power restored
29	clear	0.0930	6.9	0.00							0.26400		5.0	20.0	5.0	4.2						0.261001	
30	clear	0.0850									0.20500	< 2	8.0	20.0	4.0	4.2						0.229117	
31	clear	0.0750	7.1	0.00							0.26500		12.0	10.0	5.0	3.9						0.217897	
Total		5.5940	77.6	0.00	0.0	0.0	0.0	2	0	0	2.11300	1	226.0	150.0	47.0	33.4	0.00	0.00	0.00		6.50014		
Average		0.1805	7.1	<0.10	0.0	0.0	0.0	2	0	0	0.06816	1	7.3	4.8	1.5	3.7	0.00	0.00	0.00		0.20968		
Minimim		0.06	6.8	0.00	0.0	0.0	0.0	2	0	0	0.00000	1	0.0	0.0	0.0	2.0	0.00	0.00	0.00		0.04261		
Maximum		0.24	7.3	<0.10	0.0	0.0	0.0	0	0	0	0.28100	1	16.0	20.0	6.0	5.0	0.00	0.00	0.00		0.26100	MOR 3-15-07	

MARYLAND DEPARTMENT of the ENVIRONMENT, WATER MANAGEMENT ADMINISTRATION, 1800 WASHINGTON BLVD, BALTIMORE, MD 21230

Operated By:

Maryland Environmental Service
259 Najoles Road, Millersville MD

Facility: BTR Capital Group

Address: 626 Hanover Pike, Hampstead Maryland

Permit Number: 02-DP-0022

Operator: Justin Myers

Month: June

Year: # 2007

Certification # 8406

Final Effluent outfall 001											Outfall 101						Outfall 201						Comments
Date	Appearance	Discharge MGD	pH	Cl2 mg/l	Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l	Trichloroethene ug/l	BOD ₅ mg/l	TSS mg/l	O&G mg/l	Flow MGD	Fecal mpn	Basin Inches	Alum Gpd	Hypochlorite Gpd	Post Cl2 mg/l	Tetrachloroethylene ug/l	1,1,1-Trichloroethane ug/l	Trichloroethene ug/l	Discharge mgd			
1	clear	0.0910									0.00000		14.0	10.0	1.0	4.4					0.242372		
2	clear	0.0820									0.00000		14.0								0.213501		
3	clear	0.0800									0.00000		12.0								0.222633		
4	clear	0.0840									0.00000		10.0								0.222193		
5	clear	0.0830	6.9	0.00							0.00000		10.0								0.227825		
6	clear	0.0870									0.00000		9.0								0.226767		
7	clear	0.0850	7.0	0.00							0.00000		8.0								0.234820		
8	clear	0.0970									0.00000		7.0								0.224084		
9	clear	0.0890									0.00000		7.0								0.217635		
10	clear	0.0850									0.00000		7.0								0.216955		
11	clear	0.0900									0.00000		6.0								0.238084		
12	clear	0.0870	7.0	0.00							0.15700		5.0	0.5	6.0	4.6					0.210264		
13	clear	0.0930			< 1.00	< 1.00	< 1.00	< 2.0	6.0	< 5.0	0.21600	< 2	5.0	20.0	3.0	3.8					0.225492		
14	clear	0.0910	7.4								0.20800		7.0	20.0	3.0	2.6					0.229432		
15	clear	0.0860									0.25100		9.0	20.0	6.0	3.3					0.195354		
16	clear	0.0990									0.00000		12.0			3.0					0.241414		
17	clear	0.0860									0.00000		11.0								0.235414		
18	clear	0.0900									0.00000		11.0								0.220001		
19	clear	0.1030	7.0	0.00							0.00000		10.0								0.232132		
20	clear	0.0820									0.00000		9.0								0.210707		
21	clear	0.0920	7.0	0.00							0.00000		8.0								0.223193		
22	clear	0.0920									0.00000		7.0								0.227355		
23	clear	0.0900									0.00000		7.0								0.225068		
24	clear	0.0850									0.00000		6.0								0.218373		
25	clear	0.0920									0.00000		5.0								0.242538		
26	clear	0.0900	8.3	0.00							0.00000		4.0								0.226361		
27	clear	0.0890									0.00000		4.0								0.219677		
28	clear	0.0880	6.7	0.00							0.00000		3.0								0.221574		
29	clear	0.1010									0.00000		2.0								0.238906		
30	clear	0.0870									0.00000		1.0								0.229685		
31																							
Total		2.6760	57.3	0.00	0.0	0.0	0.0	2	6	0	0.83200	1	230.0	70.5	19.0	21.7	0.00	0.00	0.00	6.75981			
Average		0.0892	7.2	<0.10	0.0	0.0	0.0	2	6	0	0.02773	1	7.7	14.1	3.8	3.6	#DIV/0!	#DIV/0!	#DIV/0!	0.22533			
Minimim		0.08	6.7	0.00	0.0	0.0	0.0	2	6	0	0.00000	1	1.0	0.5	1.0	2.6	0.00	0.00	0.00	0.19535			
Maxiim		0.10	8.3	<0.10	0.0	0.0	0.0	0	6	0	0.25100	1	14.0	20.0	6.0	4.6	0.00	0.00	0.00	0.24254	MOR 3-15-07		

APPENDIX B
DISCHARGE MONITORING REPORTS

PERMITTEE NAME/ADDRESS (Include Facility Name/Location if different)
NAME AG/GFI Hampstead, Inc
ADDRESS 626 Hanover Pike

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
DISCHARGE MONITORING REPORT (DMR)
(2-16) (17-19)

State Discharge Permit
02-DP-0022

Form Approved. 12345

OMB No. 2040-0004.

Approval expires 05-31-98

MD0001881
PERMIT NUMBER

001
DISCHARGE NUMBER

Hampstead, MD 21074
FACILITY Black and Decker WWTP
LOCATION 626 Hanover Pike

ATTN.

PARAMETER (32-37)	SAMPLE MEASUREMENT	(3 Card Only) (46-53)			QUANTITY OR LOADING (54-61)			(4 Card Only) (38-45)			QUANTITY OR CONCENTRATION (46-53)			NO EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS								
BOD, 5-DAY (20 DEG. C) 00310 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	*****	*****	*****	2	MG/L	(19)	0	ONE/ MONTH	GRAB				
	PERMIT REQUIREMENT	*****	*****		*****	*****	15			*****			ONE/ MONTH	GRAB		
pH 00400 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	6.7	*****	6.9	SU	(12)	0	TWO/ WEEK	GRAB				
	PERMIT REQUIREMENT	*****	*****		6.0	*****	8.5			*****			TWO/ WEEK	GRAB		
SOLIDS, TOTAL SUSPENDED 00530 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	6	6	MG/L	(19)	0	ONE/ MONTH	GRAB				
	PERMIT REQUIREMENT	*****	*****		*****	20	30			*****			ONE/ MONTH	GRAB		
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	218333	249000	GPD	*****	*****	*****		*****	0	MEASURED	RECORD				
	PERMIT REQUIREMENT	REPORT	REPORT		*****	*****	*****			*****			MEASURED	RECORD		
CHLORINE, TOTAL RESIDUAL 50060 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	<0.1	<0.1	MG/L	(19)	0	ONE/ MONTH	GRAB				
	PERMIT REQUIREMENT	*****	*****		*****	0.01	0.019			*****			ONE/ MONTH	GRAB		
TETRACHLOROETHYLENE 34475 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	ug/l	(19)	0	ONE/ MONTH	GRAB				
	PERMIT REQUIREMENT	*****	*****		*****	*****	5			*****			ONE/ MONTH	GRAB		
1,1,1-TRICHLOROETHANE 34506 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	ug/l	(19)	0	ONE/ MONTH	GRAB				
	PERMIT REQUIREMENT	*****	*****		*****	*****	5			*****			ONE/ MONTH	GRAB		
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER		I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.						TELEPHONE		DATE						
Jim Harkins, Director MES																
TYPE OR PRINTED								SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT		410 729-8350 07 05 25						
						AREA CODE		NUMBER		YEAR MO DAY						

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include
Facility Name/Location if different)
NAME AG/GFI Hampstead, Inc

ADDRESS 626 Hanover Pike

Hampstead, MD 21074

FACILITY Black and Decker WWTP

LOCATION 626 Hanover Pike

ATTN

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
DISCHARGE MONITORING REPORT (DMR)
(2-16) (17-19)

State Discharge Permit
02-DP-0022

MD0001881

PERMIT NUMBER

001

DISCHARGE NUMBER

Form Approved. 12345

OMB No. 2040-0004.

Approval expires 05-31-98

MONITORING PERIOD

FROM	YEAR	MO	DAY	TO	YEAR	MO	DAY
	07	04	01		07	04	30

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form.

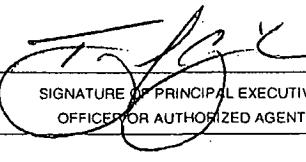
PARAMETER (132-37)		(3 Card Only) (46-53)			QUANTITY OR LOADING (54-61)			(4 Card Only) (38-45)			QUANTITY OR CONCENTRATION (46-53)			NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)	
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS	AVERAGE	MAXIMUM	UNITS						
TRICHLOROETHENE	SAMPLE MEASUREMENT	*****	*****		*****	*****	0					0	ONE/ MONTH	GRAB			
79141 1 0 0 EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****		*****	*****	5					ug/l	ONE/ MONTH	GRAB			
OIL AND GREASE TOTAL RECOVERABLE	SAMPLE MEASUREMENT	*****	*****		*****	0	0					(19)	0	ONE/ MONTH	GRAB		
70030 1 0 0 EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****		*****	10	15					MG/L	0	ONE/ MONTH	GRAB		
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																
	SAMPLE MEASUREMENT																
	PERMIT REQUIREMENT																

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER

Jim Harkins, Director MES

TYPED OR PRINTED

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.


SIGNATURE OF PRINCIPAL EXECUTIVE
OFFICER OR AUTHORIZED AGENT

TELEPHONE DATE

410 729-8350 07 05 25

AREA CODE NUMBER YEAR MO DAY

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include
Facility Name/Location if different)
NAME AG/GFI Hampstead, Inc

ADDRESS 626 Hanover Pike

Hampstead, MD 21074

FACILITY Black and Decker WWTP

LOCATION 626 Hanover Pike

ATTN

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
DISCHARGE MONITORING REPORT (DMR)
(2-16) (17-19)

MD0001881
PERMIT NUMBER

101
DISCHARGE NUMBER

State Discharge Permit
02-DP-0022

Form Approved. 12345

OMB No. 2040-0004.

Approval expires 05-31-98

MONITORING PERIOD					
FROM	YEAR	MO	DAY	TO	YEAR
	07	04	01		07
	(20-21)	(22-23)	(24-25)		(26-27)
					(28-29)
					(30-31)

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form.

PARAMETER (32-37)	<input checked="" type="checkbox"/>	(3 Card Only) (46-53)			(4 Card Only) (38-45)			(4 Card Only) (46-53)			NO EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS					
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	69233	330000	(07)	*****	*****	*****	(30)	0	ONE/ MONTH	GRAB		
	PERMIT REQUIREMENT	REPORT	REPORT	GPD	*****	*****	*****	MPN	****	ONE/ MONTH	GRAB		
COLIFORM, FECAL GENERAL 74055 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	*****	*****	*****	8	(30)	0	TWO/ WEEK	GRAB		
	PERMIT REQUIREMENT	*****	*****	*****	*****	*****	200			TWO/ WEEK	GRAB		
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER		I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.						TELEPHONE		DATE			
Jim Harkins, Director MES								410 729-8350		07	05	25	
TYPED OR PRINTED								AREA CODE	NUMBER	YEAR	MO	DAY	

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include Facility Name/Location if different)
NAME AG/GFI Hampstead, Inc

ADDRESS 626 Hanover Pike

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
DISCHARGE MONITORING REPORT (DMR)
(2-16) (17-19)

State Discharge Permit
02-DP-0022

MD0001881

001

PERMIT NUMBER

DISCHARGE NUMBER

Form Approved. 12345

OMB No. 2040-0004.

Approval expires 05-31-98

Hampstead, MD 21074

FACILITY Black and Decker WWTP

LOCATION 626 Hanover Pike

ATTN:

FROM			TO			MONITORING PERIOD		
YEAR	MO	DAY	YEAR	MO	DAY	(20-21)	(22-23)	(24-25)
07	05	01	07	05	31	(26-27)	(28-29)	(30-31)

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form.

PARAMETER (32-37)	SAMPLE MEASUREMENT	(3 Card Only) (46-53)			(4 Card Only) (38-45)			QUANTITY OR CONCENTRATION (46-53)			NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS					
BOD, 5-DAY (20 DEG. C) 00310 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	(19)	0	ONE/ MONTH	GRAB	MG/L	
	PERMIT REQUIREMENT	*****	*****		*****	*****	15						
pH 00400 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	6.8	*****	7.3	(12)	0	TWO/ WEEK	GRAB	SU	
	PERMIT REQUIREMENT	*****	*****		6.0	*****	8.5						
SOLIDS, TOTAL SUSPENDED 00530 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	0	0	(19)	0	ONE/ MONTH	GRAB	MG/L	
	PERMIT REQUIREMENT	*****	*****		*****	20	30						
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	180452	241000	GPD	*****	*****	*****	(07)	0	MEASURED	RECORD	ug/l	
	PERMIT REQUIREMENT	REPORT	REPORT		*****	*****	*****						
CHLORINE, TOTAL RESIDUAL 50060 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	20.1	20.1	(19)	0	ONE/ MONTH	GRAB	MG/L	
	PERMIT REQUIREMENT	*****	*****		*****	0.011	0.019						
TETRACHLOROETHYLENE 34475 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	(0)	0	ONE/ MONTH	GRAB	ug/l	
	PERMIT REQUIREMENT	*****	*****		*****	*****	5						
1,1,1-TRICHLOROETHANE 34506 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	****	*****	*****	0	(0)	0	ONE/ MONTH	GRAB	ug/l	
	PERMIT REQUIREMENT	*****	*****		*****	*****	15						

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER

Jim Harkins, Director MES

TYPED OR PRINTED

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

SIGNATURE OF PRINCIPAL EXECUTIVE
OFFICER OR AUTHORIZED AGENT

TELEPHONE		DATE		
410	729-8350	07	06	27
AREA CODE	NUMBER	YEAR	MO	DAY

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include Facility Name/Location if different)
 NAME AG/GFI Hampstead, Inc
 ADDRESS 626 Hanover Pike

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
 DISCHARGE MONITORING REPORT (DMR)
 (2-16) (17-19)

MD0001881
 PERMIT NUMBER

001
 DISCHARGE NUMBER

State Discharge Permit
 02-DP-0022

Form Approved. 12345
 OMB No. 2040-0004.
 Approval expires 05-31-98

Hampstead, MD 21074
 FACILITY Black and Decker WWTP
 LOCATION 626 Hanover Pike

ATTN:

FROM			TO			MONITORING PERIOD			(20-21)	(22-23)	(24-25)
YEAR	MO	DAY	YEAR	MO	DAY	(26-27)	(28-29)	(30-31)	(20-21)	(22-23)	(24-25)

*** NO DISCHARGE ***
 NOTE: Read instructions before completing this form.

PARAMETER (32-37)		(3 Card Only) (46-53)			(4 Card Only) (38-45)			QUANTITY OR CONCENTRATION (46-53) (54-61)			NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS					
TRICHLOROETHENE	SAMPLE MEASUREMENT	*****	*****	*****	*****	*****	0	ug/l	0	ONE/MONTH	GRAB		
79141 1 0 0 EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****		*****	*****	5			ONE/MONTH	GRAB		
OIL AND GREASE TOTAL RECOVERABLE	SAMPLE MEASUREMENT	*****	*****	*****	*****	0	0	(19)	0	ONE/MONTH	GRAB		
70030 1 0 0 EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****		*****	10	15	MG/L		ONE/MONTH	GRAB		
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												
	SAMPLE MEASUREMENT												
	PERMIT REQUIREMENT												

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER

Jim Harkins, Director MES

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and/or imprisonment for knowing violations.

TELEPHONE DATE

410 729-8350 07 06 27
 AREA CODE NUMBER YEAR MO DAY

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS *(Include Facility Name/Location if different)*
 NAME AG/GFI Hampstead, Inc

ADDRESS 626 Hanover Pike

Hampstead, MD 21074

FACILITY Black and Decker WWTP

LOCATION 626 Hanover Pike

ATTN:

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
 DISCHARGE MONITORING REPORT (DMR)
 (2-16) (17-19)

State Discharge Permit
 02-DP-0022

Form Approved. 12345

OMB No. 2040-0004.

Approval expires 05-31-98

MD0001881	101
PERMIT NUMBER	DISCHARGE NUMBER

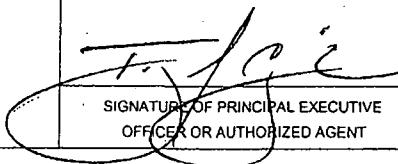
MONITORING PERIOD

FROM	YEAR	MO	DAY	TO	YEAR	MO	DAY
	07	05	01		07	05	31

(20-21) (22-23) (24-25) (26-27) (28-29) (30-31)

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form.

PARAMETER (32-37)	(3 Card Only) (46-53)		QUANTITY OR LOADING (54-61)		(4 Card Only) (38-45)		QUANTITY OR CONCENTRATION (46-53)		NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
	AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS				
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT REPORT	68161	281000	(07)	*****	*****	*****	0	ONE/ MONTH	GRAB	
COLIFORM, FECAL GENERAL 74055 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT REPORT	*****	*****	GPD	*****	*****	*****	*****	ONE/ MONTH	GRAB	
	SAMPLE MEASUREMENT REPORT	*****	*****	*****	*****	*****	2	(30)	0	TWO/ WEEK	GRAB
	SAMPLE MEASUREMENT REPORT	*****	*****	*****	*****	*****	200	MPN	0	TWO/ WEEK	GRAB
	SAMPLE MEASUREMENT REPORT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****
	SAMPLE MEASUREMENT REPORT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****
	SAMPLE MEASUREMENT REPORT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****
	SAMPLE MEASUREMENT REPORT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****
	SAMPLE MEASUREMENT REPORT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****
	SAMPLE MEASUREMENT REPORT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****
	SAMPLE MEASUREMENT REPORT	*****	*****	*****	*****	*****	*****	*****	*****	*****	*****
NAME/TITLE PRINCIPAL EXECUTIVE OFFICER	I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.						TELEPHONE		DATE		
Jim Harkins, Director MES							410	729-8350	07	06	27
TYPED OR PRINTED	SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER OR AUTHORIZED AGENT						AREA CODE	NUMBER	YEAR	MO	DAY

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include Facility Name/Location if different)
NAME AG/GFI Hampstead, Inc.

ADDRESS 626 Hanover Pike

Hampstead, MD 21074

FACILITY Black and Decker WWTP

LOCATION 626 Hanover Pike

ATTN:

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
DISCHARGE MONITORING REPORT (DMR)
(2-16) (17-19)

MD0001881
PERMIT NUMBER

001
DISCHARGE NUMBER

State Discharge Permit
02-DP-0022

Form Approved. 12345

OMB No. 2040-0004.

Approval expires 05-31-98

MONITORING PERIOD						
FROM	YEAR	MO	DAY	TO	YEAR	MO
	07	06	01	TO	07	06
	(20-21)	(22-23)	(24-25)	(26-27)	(28-29)	(30-31)

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form.

PARAMETER (32-37)		(3 Card Only) (46-53)		QUANTITY OR LOADING (54-61)			(4 Card Only) (38-45)			QUANTITY OR CONCENTRATION (46-53) (54-61)			NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)	
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS								
BOD, 5-DAY (20 DEG. C) 00310 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	*****	*****	*****	*****	0	(19)	0	ONE/ MONTH	GRAB	MG/L	TWO/ WEEK	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	*****	*****								
pH 00400 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	*****	6.7	*****	8.3	(12)	0	TWO/ WEEK	GRAB	SU	TWO/ WEEK	GRAB	TWO/ WEEK	GRAB
	PERMIT REQUIREMENT	*****	*****		6.0	*****	8.5									
SOLIDS, TOTAL SUSPENDED 00530 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	*****	*****	6	6	(19)	0	ONE/ MONTH	GRAB	MG/L	ONE/ MONTH	GRAB	ONE/ MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	20	30									
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	89200	103000	(07)	*****	*****	*****	*****	0	MEASURED	RECORD	*****	MEASURED	RECORD	MEASURED	RECORD
	PERMIT REQUIREMENT	REPORT	REPORT		GPD	*****	*****									
CHLORINE, TOTAL RESIDUAL 50060 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	(19)	0	ONE/ MONTH	GRAB	MG/L	ONE/ MONTH	GRAB	ONE/ MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	0.011	0.019									
TETRACHLOROETHYLENE 34475 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	*****	*****	*****	0	*****	0	ONE/ MONTH	GRAB	ug/l	ONE/ MONTH	GRAB	ONE/ MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	*****	*****									
1,1,1-TRICHLOROETHANE 34506 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****	*****	*****	*****	0	*****	0	ONE/ MONTH	GRAB	ug/l	ONE/ MONTH	GRAB	ONE/ MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	*****	5									

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER

Jim Harkins, Director MES

TYPED OR PRINTED

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

SIGNATURE OF PRINCIPAL EXECUTIVE
OFFICER OR AUTHORIZED AGENT

TELEPHONE	DATE
410 729-8350	07 07 25
AREA CODE	NUMBER
YEAR	MO
DAY	

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include Facility Name/Location if different)
NAME AG/GFI Hampstead, Inc

ADDRESS 626 Hanover Pike

Hampstead, MD 21074

FACILITY Black and Decker WWTP

LOCATION 626 Hanover Pike

ATTN:

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
DISCHARGE MONITORING REPORT (DMR)

State Discharge Permit
02-DP-0022

MD0001881

PERMIT NUMBER

001

DISCHARGE NUMBER

MONITORING PERIOD

FROM	YEAR	MO	DAY	TO	YEAR	MO	DAY
	07	06	01		07	06	30
(20-21)	(22-23)	(24-25)		(26-27)	(28-29)	(30-31)	

*** NO DISCHARGE ***
NOTE: Read instructions before completing this form.

Form Approved. 12345

OMB No. 2040-0004.

Approval expires 05-31-98

PARAMETER (32-37)		(3 Card Only) (46-53)			QUANTITY OR LOADING (54-61)			(4 Card Only) (38-45)			QUANTITY OR CONCENTRATION (46-53)			NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)			
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM				
TRICHLOROETHENE	SAMPLE MEASUREMENT	*****	*****		*****	*****	0									0	ONE/MONTH	GRAB	
79141 1 0 0 EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****		*****	*****	5									ug/l	ONE/MONTH	GRAB	
OIL AND GREASE TOTAL RECOVERABLE 70030 1 0 0 EFFLUENT GROSS VALUE	SAMPLE MEASUREMENT	*****	*****		*****	0	0									(19)	0	ONE/MONTH	GRAB
	PERMIT REQUIREMENT	*****	*****		*****	10	15									MG/L	ONE/MONTH	GRAB	
	SAMPLE MEASUREMENT																		
	PERMIT REQUIREMENT																		
	SAMPLE MEASUREMENT																		
	PERMIT REQUIREMENT																		
	SAMPLE MEASUREMENT																		
	PERMIT REQUIREMENT																		
	SAMPLE MEASUREMENT																		
	PERMIT REQUIREMENT																		
	SAMPLE MEASUREMENT																		
	PERMIT REQUIREMENT																		
	SAMPLE MEASUREMENT																		
	PERMIT REQUIREMENT																		

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER

Jim Harkins, Director MES

TYPED OR PRINTED

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

SIGNATURE OF PRINCIPAL EXECUTIVE
OFFICER OR AUTHORIZED AGENT

TELEPHONE DATE

410 729-8350 07 07 25

AREA CODE NUMBER YEAR MO DAY

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include Facility Name/Location if different)
NAME AG/GFI Hampstead, Inc

ADDRESS 626 Hanover Pike

Hampstead, MD 21074

FACILITY Black and Decker WWTP

LOCATION 626 Hanover Pike

ATTN:

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
DISCHARGE MONITORING REPORT (DMR)
(2-16) (17-19)

MD0001881
PERMIT NUMBER

101
DISCHARGE NUMBER

State Discharge Permit
02-DP-0022

Form Approved. 12345

OMB No. 2040-0004.

Approval expires 05-31-98

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form.

MONITORING PERIOD					
YEAR	MO	DAY	YEAR	MO	DAY
07	06	01	07	06	30
(20-21)	(22-23)	(24-25)	(26-27)	(28-29)	(30-31)

PARAMETER (32-37)	SAMPLE MEASUREMENT	(3 Card Only) (46-53)			QUANTITY OR CONCENTRATION (4 Card Only) (38-45)			NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
		AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM			
FLOW, IN CONDUIT OR THRU TREATMENT PLANT 50050 1 0 0	SAMPLE MEASUREMENT	27733	251000	(07)	*****	*****	*****	*****	ONE/ MONTH	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	REPORT *****	REPORT *****	GPD	*****	*****	*****			
COLIFORM, FECAL GENERAL 74055 1 0 0	SAMPLE MEASUREMENT	*****	*****	*****	*****	*****	1	(30)	TWO/ WEEK	GRAB
EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****		*****	*****	200			
	SAMPLE MEASUREMENT			*****						
	PERMIT REQUIREMENT									
	SAMPLE MEASUREMENT			*****						
	PERMIT REQUIREMENT									
	SAMPLE MEASUREMENT			*****						
	PERMIT REQUIREMENT									
	SAMPLE MEASUREMENT			*****						
	PERMIT REQUIREMENT									
	SAMPLE MEASUREMENT			*****						
	PERMIT REQUIREMENT									
	SAMPLE MEASUREMENT			*****						
	PERMIT REQUIREMENT									
	SAMPLE MEASUREMENT			*****						
	PERMIT REQUIREMENT									
	SAMPLE MEASUREMENT			*****						
	PERMIT REQUIREMENT									

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER

Jim Harkins, Director MES

TYPED OR PRINTED

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

SIGNATURE OF PRINCIPAL EXECUTIVE
OFFICER OR AUTHORIZED AGENT

TELEPHONE DATE

410 729-8350 07 07 25

AREA CODE NUMBER YEAR MO DAY

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

PERMITTEE NAME/ADDRESS (Include Facility Name/Location if different)
 NAME AG/GFI Hampstead, Inc

ADDRESS 626 Hanover Pike

Hampstead, MD 21074

FACILITY Black and Decker WWTP

LOCATION 626 Hanover Pike

ATTN:

NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES)
 DISCHARGE MONITORING REPORT (DMR)

State Discharge Permit
 02-DP-0022

MD0001881

PERMIT NUMBER

201

DISCHARGE NUMBER

MONITORING PERIOD

FROM	YEAR	MO	DAY	TO	YEAR	MO	DAY
	07	04	01		07	06	30

(20-21) (22-23) (24-25) (26-27) (28-29) (30-31)

*** NO DISCHARGE ***

NOTE: Read instructions before completing this form.


PARAMETER (32-37)	(3 Card Only) (46-53)		QUANTITY OR LOADING (54-61)		(4 Card Only) (38-45)		QUANTITY OR CONCENTRATION (46-53)		NO. EX (62-63)	FREQUENCY OF ANALYSIS (64-68)	SAMPLE TYPE (69-70)
	AVERAGE	MAXIMUM	UNITS	MINIMUM	AVERAGE	MAXIMUM	UNITS				
FLOW, IN CONDUIT OR THRU TREATMENT PLANT	SAMPLE MEASUREMENT	237367	801180	(07)	*****	*****	*****	GPD	0	MEASURED	RECORD
50050 1 0 0 EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	REPORT	REPORT		*****	*****	*****			*****	MEASURED
TETRACHLOROETHYLENE	SAMPLE MEASUREMENT	*****	*****	*****	*****	0	0	ug/l	0	ONE/ QUARTER	GRAB
34475 1 0 0 EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****		*****	REPORT	REPORT			ONE/ QUARTER	GRAB
1,1,1-TRICHLOROETHANE	SAMPLE MEASUREMENT	*****	*****	*****	*****	0	0	ug/l	0	ONE/ QUARTER	GRAB
34506 1 0 0 EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****		*****	REPORT	REPORT			ONE/ QUARTER	GRAB
TRICHLOROETHENE	SAMPLE MEASUREMENT	*****	*****	*****	*****	0	0	ug/l	0	ONE/ QUARTER	GRAB
79141 1 0 0 EFFLUENT GROSS VALUE	PERMIT REQUIREMENT	*****	*****		*****	REPORT	REPORT			ONE/ QUARTER	GRAB
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										
	SAMPLE MEASUREMENT										
	PERMIT REQUIREMENT										

NAME/TITLE PRINCIPAL EXECUTIVE OFFICER

Jim Harkins, Director MES

TYPED OR PRINTED

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.


 SIGNATURE OF PRINCIPAL EXECUTIVE
 OFFICER OR AUTHORIZED AGENT

TELEPHONE DATE

410 729-8350 07 07 25

AREA CODE NUMBER YEAR MO DAY

COMMENT AND EXPLANATION OF ANY VIOLATIONS (Reference all attachments here)

Quarterly Report!

APPENDIX C
GROUNDWATER TREATMENT SYSTEM ANALYTICAL RESULTS



630 Churchmans Road
Newark, Delaware 19702
302-266-9121 • 454-8720 (FAX)
WWW.AtlanticCoastLabs.COM

REPORT OF ANALYSIS

Maryland Environmental Services (A)
259 Najeles Road
Millersville, MD 21108

Attention: Mr. Jay Janney

Order Number: A07040251
Project Name: Black & Decker WWTP
Receive Date: 4/4/2007
Client Code: MES_A
Project Location: Black & Decker WWTP

Sample # A07040251-01

Sample Date: 4/4/2007 12:00

Site: Black & Decker 001

Matrix: Waste Water

Client Sample ID:

Sample Comments: None

Test	Result	Units	RDL	Method	Analysis Date	Analyst
BOD-5	2	mg/L	2	SM 5210 B	4/5/2007 1:30:00 PM	JMcGuire
Total Suspended Solids	6	mg/L	4	SM 2540D	4/9/2007 11:01:00 AM	YThomas

Sample # A07040251-01A

Sample Date: 4/4/2007 12:00

Site: Black & Decker 001

Matrix: Waste Water

Client Sample ID: A

Sample Comments: None

Test	Result	Units	RDL	Method	Analysis Date	Analyst
Oil and Grease (HEM)	<5	mg/L	5	EPA 1664	4/5/2007 2:30:00 PM	SHess

Sample # A07040251-01B

Sample Date: 4/4/2007 12:00

Site: Black & Decker 001

Matrix: Waste Water

Client Sample ID: B

Sample Comments: None

Test	Result	Units	RDL	Method	Analysis Date	Analyst
1,1,1-Trichloroethane	<1	ug/L	1	EPA 8260B	4/11/2007 2:31:00 AM	IMcMullen
Tetrachloroethene	<1	ug/L	1	EPA 8260B	4/11/2007 2:31:00 AM	IMcMullen
Trichloroethene	<1	ug/L	1	EPA 8260B	4/11/2007 2:31:00 AM	IMcMullen

Approved: *Warren Van Andstell*
Quality Assurance Manager

Reported: 4/24/2007 1:58:46 PM

APR 26 2007


MD Environmental Service

RDL = Reporting Detection Limit

N/A = Not Applicable

Laboratory Certification Numbers:

Delaware - DE00011 Maryland - #138 Pennsylvania - 68-335 New Jersey - DE568



630 Churchmans Road
Newark, Delaware 19702
302-266-9121 • 454-8720 (FAX)
WWW.AtlanticCoastLabs.COM

REPORT OF ANALYSIS

Maryland Environmental Services (A)
259 Najeles Road
Millersville, MD 21108

Attention: Mr. Jay Janney

Order Number: A07040249
Project Name: Black & Decker WWTP
Receive Date: 4/4/2007
Client Code: MES_A
Project Location: Black & Decker WWTP

Sample # A07040249-01

Sample Date: 4/4/2007 12:00

Site: Black & Decker 201

Matrix: Waste Water

Client Sample ID:

Sample Comments: None

<u>Test</u>	<u>Result</u>	<u>Units</u>	<u>RDL</u>	<u>Method</u>	<u>Analysis Date</u>	<u>Analyst</u>
1,1,1-Trichloroethane	<1	ug/L	1	EPA 8260B	4/11/2007 2:00:00 AM	IMcMullen
Tetrachloroethylene	<1	ug/L	1	EPA 8260B	4/11/2007 2:00:00 AM	IMcMullen
Trichloroethylene	<1	ug/L	1	EPA 8260B	4/11/2007 2:00:00 AM	IMcMullen

RECEIVED
4/26/2007

APR 26 2007

Maryland Environmental Service

Approved: *Warren Van Andell*
Quality Assurance Manager

Reported: 4/24/2007 1:58:44 PM

RDL = Reporting Detection Limit N/A = Not Applicable
Laboratory Certification Numbers: Delaware - DE00011 Maryland - #138 Pennsylvania - 68-335 New Jersey - DE568



630 Churchmans Road
Newark, Delaware 19702
302-266-9121 • 454-8720 (FAX)
WWW.AtlanticCoastLabs.com

REPORT OF ANALYSIS

Maryland Environmental Services (A)
259 Najoles Road
Millersville, MD 21108

Attention: Mr. Jay Janney

Order Number: A07050172
Project Name: Black & Decker WWTP
Receive Date: 5/2/2007
Client Code: MES_A
Project Location: Black & Decker WWTP

Sample # A07050172-01

Sample Date: 5/2/2007 11:30

Site: Black & Decker 001

Matrix: Waste Water

Client Sample ID:

Sample Comments: None

Test	Result	Units	RDL	Method	Analysis Date	Analyst
BOD-5	<2	mg/L	2	SM 5210 B	5/3/2007 11:50:00 AM	TOciepa
Total Suspended Solids	<7	mg/L	7	SM 2540D	5/9/2007 2:42:00 PM	YThomas

Sample # A07050172-01A

Sample Date: 5/2/2007 11:30

Site: Black & Decker 001

Matrix: Waste Water

Client Sample ID: A

Sample Comments: None

Test	Result	Units	RDL	Method	Analysis Date	Analyst
Oil and Grease (HEM)	<5	mg/L	5	EPA 1664	5/4/2007 4:00:00 PM	SHess

Sample # A07050172-01B

Sample Date: 5/2/2007 11:30

Site: Black & Decker 001

Matrix: Waste Water

Client Sample ID: B

Sample Comments: None

Test	Result	Units	RDL	Method	Analysis Date	Analyst
1,1,1-Trichloroethane	<1	ug/L	1	EPA 8260B	5/8/2007 1:00:00 AM	IMcMullen
Tetrachloroethene	<1	ug/L	1	EPA 8260B	5/8/2007 1:00:00 AM	IMcMullen
Trichloroethene	<1	ug/L	1	EPA 8260B	5/8/2007 1:00:00 AM	IMcMullen

Approved:

Laboratory Operations Manager

Reported: 5/18/2007 12:32:06 PM

RDL = Reporting Detection Limit N/A = Not Applicable
Laboratory Certification Numbers: Delaware - DE00011 Maryland - #138 Pennsylvania - 68-335 New Jersey - D-568

RECEIVED

MAY 21 2007

Page 1 of 2

Maryland Environmental Service



630 Churchmans Road
Newark, Delaware 19702
302-266-9121 • 454-8720 (FAX)
WWW.AtlanticCoastLabs.com

REPORT OF ANALYSIS

Maryland Environmental Services (A)
259 Najoles Road
Millersville, MD 21108

Attention: Mr. Jay Janney

Order Number: A07050181
Project Name: Black & Decker WWTP
Receive Date: 5/2/2007
Client Code: MES_A
Project Location: Black & Decker WWTP

Sample # A07050181-01

Sample Date: 5/2/2007 11:45

Site: Black & Decker 201

Matrix: Waste Water

Client Sample ID:

Sample Comments: None

Test	Result	Units	RDL	Method	Analysis Date	Analyst
1,1,1-Trichloroethane	<1	ug/L	1	EPA 8260B	5/8/2007 1:31:00 AM	IMcMullen
Tetrachloroethene	<1	ug/L	1	EPA 8260B	5/8/2007 1:31:00 AM	IMcMullen
Trichloroethene	<1	ug/L	1	EPA 8260B	5/8/2007 1:31:00 AM	IMcMullen

RECEIVED

MAY 21 2007

Maryland Environmental Service
03

Approved:
Dor Dilgots
Laboratory Operations Manager

Reported: 5/18/2007 12:32:09 PM

RDL = Reporting Detection Limit N/A = Not Applicable
Laboratory Certification Numbers: Delaware - DE00011 Maryland - #138 Pennsylvania - 68-335 New Jersey - DE568



630 Churchmans Road
Newark, Delaware 19702
302-266-9121 • 454-8720 (FAX)
WWW.AtlanticCoastLabs.com

REPORT OF ANALYSIS

Maryland Environmental Services (A)
259 Najoles Road
Millersville, MD 21108

Attention: Mr. Jay Janney

Order Number: A07060717
Project Name: Black & Decker WWTP
Receive Date: 6/13/2007
Client Code: MES_A
Project Location: Black & Decker WWTP

Sample # A07060717-01

Sample Date: 6/13/2007 10:50

Site: Black & Decker 001

Matrix: Waste Water

Client Sample ID:

Sample Comments: None

Test	Result	Units	RDL	Method	Analysis Date	Analyst
BOD-5	<2	mg/L	2	SM 5210 B	6/14/2007 12:00:00 PM	YThomas
Total Suspended Solids	6	mg/L	4	SM 2540D	6/19/2007 11:22:00 AM	YThomas

Sample # A07060717-01A

Sample Date: 6/13/2007 10:50

Site: Black & Decker 001

Matrix: Waste Water

Client Sample ID: A

Sample Comments: None

Test	Result	Units	RDL	Method	Analysis Date	Analyst
Oil and Grease (HEM)	<5	mg/L	5	EPA 1664	6/13/2007 7:45:00 PM	SHess

Sample # A07060717-01B

Sample Date: 6/13/2007 10:50

Site: Black & Decker 001

Matrix: Waste Water

Client Sample ID: B

Sample Comments: None

Test	Result	Units	RDL	Method	Analysis Date	Analyst
1,1,1-Trichloroethane	<1	ug/L	1	EPA 8260B	6/26/2007 7:08:00 PM	IMcMullen
1,1,2,2-Tetrachloroethane	<1	ug/L	1	EPA 8260B	6/26/2007 7:08:00 PM	IMcMullen
Tetrachloroethene	<1	ug/L	1	EPA 8260B	6/26/2007 7:08:00 PM	IMcMullen
Trichloroethene	<1	ug/L	1	EPA 8260B	6/26/2007 7:08:00 PM	IMcMullen

Approved:

Laboratory Operations Manager

Reported:

7/16/2007 10:30:24 AM

RDL = Reporting Detection Limit N/A = Not Applicable

Laboratory Certification Numbers: Delaware - DE00011 Maryland - #138 Pennsylvania - 68-335 New Jersey - DE568

APPENDIX D
GROUNDWATER ANALYTICAL DATA PACKAGE (MAY 2007)

SEVERN
TRENT

STL

STL Chicago
2417 Bond Street
University Park, IL 60466

Tel: 708 534 5200 Fax: 708 534 5211
www.stl-inc.com

ANALYTICAL REPORT

Job Number: 500-4050-1

262

Job Description: Black and Decker

For:
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Attention: Mr. Tom Cornuet


Eric A. Lang
Project Manager II
elang@stl-inc.com
05/18/2007

Project Manager: Richard C Wright

These test results meet all the requirements of NELAC for accredited parameters.

The Lab Certification ID# is 100201.

All questions regarding this test report should be directed to the STL Project Manager whose signature appears on this report. All pages of this report are integral parts of the analytical data. Therefore, this report should be reproduced only in its entirety.

Reporting limits are adjusted for sample size used, dilutions and moisture content if applicable.

Severn Trent Laboratories, Inc.

STL Chicago 2417 Bond Street, University Park, IL 60466
Tel (708) 534-5200 Fax (708) 534-5211 www.stl-inc.com



Table of Contents

Cover Title Page	1
Report Narrative	3
Executive Summary	4
Method Summary	8
Method / Analyst Summary	9
Sample Summary	10
Sample Results	11
Sample Datasheets	12
Data Qualifiers	70
QC Results	71
Qc Association Summary	72
Surrogate Recovery Report	74
Qc Reports	77
Client Chain of Custody	88
Sample Receipt Checklist	91

Job Narrative
500-J4050-1

- I. Comments
No additional comments.
- II. Receipt
All samples were received in good condition within temperature requirements.
- III. GC/MS VOA
Sample 18 was diluted due to the abundance of target analytes. Elevated reporting limits (RLs) are provided.
No other analytical or quality issues were noted.

EXECUTIVE SUMMARY - Detections

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Lab Sample ID Analyte	Client Sample ID	Result / Qualifier	Reporting Limit	Units	Method
500-4050-1	RFW-1A				
Methylene Chloride		3.4	1.0	ug/L	8260B
500-4050-2	RFW-1B				
Methylene Chloride		2.8	1.0	ug/L	8260B
500-4050-3	RFW-2A				
Methylene Chloride		2.9	1.0	ug/L	8260B
500-4050-4	RFW-2B				
Methylene Chloride		3.1	1.0	ug/L	8260B
500-4050-5	RFW-3B				
Methylene Chloride		3.0	1.0	ug/L	8260B
cis-1,2-Dichloroethene		6.0	1.0	ug/L	8260B
Tetrachloroethene		2.1	1.0	ug/L	8260B
500-4050-6	RFW-4A				
Methylene Chloride		2.8	1.0	ug/L	8260B
Trichloroethene		30	1.0	ug/L	8260B
Tetrachloroethene		26	1.0	ug/L	8260B
500-4050-7	RFW-4B				
Methylene Chloride		3.1	1.0	ug/L	8260B
cis-1,2-Dichloroethene		3.9	1.0	ug/L	8260B
Chloroform		1.5	1.0	ug/L	8260B
Trichloroethene		44	1.0	ug/L	8260B
Tetrachloroethene		74	1.0	ug/L	8260B
500-4050-8	RFW-4B DUP				
Methylene Chloride		2.2	1.0	ug/L	8260B
cis-1,2-Dichloroethene		4.1	1.0	ug/L	8260B
Chloroform		1.6	1.0	ug/L	8260B
Trichloroethene		47	1.0	ug/L	8260B
Tetrachloroethene		80	1.0	ug/L	8260B

EXECUTIVE SUMMARY - Detections

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Lab Sample ID Analyte	Client Sample ID	Result / Qualifier	Reporting Limit	Units	Method
500-4050-9	RFW-6				
Methylene Chloride		1.9	1.0	ug/L	8260B
Trichloroethene		2.3	1.0	ug/L	8260B
Tetrachloroethene		2.3	1.0	ug/L	8260B
500-4050-10	RFW-7				
Methylene Chloride		1.8	1.0	ug/L	8260B
Trichloroethene		3.2	1.0	ug/L	8260B
500-4050-11	RFW-9				
1,1-Dichloroethene		1.1	1.0	ug/L	8260B
Methylene Chloride		1.8	1.0	ug/L	8260B
cis-1,2-Dichloroethene		9.6	1.0	ug/L	8260B
1,1,1-Trichloroethane		1.5	1.0	ug/L	8260B
Trichloroethene		15	1.0	ug/L	8260B
Tetrachloroethene		3.6	1.0	ug/L	8260B
500-4050-12	RFW-11B				
Methylene Chloride		1.9	1.0	ug/L	8260B
Trichloroethene		15	1.0	ug/L	8260B
500-4050-13	RFW-12B				
Methylene Chloride		1.9	1.0	ug/L	8260B
Trichloroethene		20	1.0	ug/L	8260B
Tetrachloroethene		5.0	1.0	ug/L	8260B
500-4050-14	RFW-13				
Methylene Chloride		2.0	1.0	ug/L	8260B
Trichloroethene		3.7	1.0	ug/L	8260B
Tetrachloroethene		16	1.0	ug/L	8260B
500-4050-16	EW-2				
Methylene Chloride		1.6	1.0	ug/L	8260B
cis-1,2-Dichloroethene		2.3	1.0	ug/L	8260B
Trichloroethene		390	10	ug/L	8260B
Tetrachloroethene		64	1.0	ug/L	8260B

EXECUTIVE SUMMARY - Detections

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Lab Sample ID Analyte	Client Sample ID	Result / Qualifier	Reporting Limit	Units	Method
500-4050-17	EW-3				
Methylene Chloride		1.7	1.0	ug/L	8260B
cis-1,2-Dichloroethene		1.8	1.0	ug/L	8260B
Trichloroethene		130	10	ug/L	8260B
Tetrachloroethene		3.1	1.0	ug/L	8260B
500-4050-18	EW-4				
Methylene Chloride		17	10	ug/L	8260B
Trichloroethene		1300	100	ug/L	8260B
Tetrachloroethene		27	10	ug/L	8260B
500-4050-19	EW-5				
1,1,1-Trichloroethane		1.2	1.0	ug/L	8260B
Trichloroethene		160	10	ug/L	8260B
Tetrachloroethene		7.0	1.0	ug/L	8260B
500-4050-20	EW-6				
Trichloroethene		9.2	1.0	ug/L	8260B
Tetrachloroethene		17	1.0	ug/L	8260B
500-4050-21	EW-7				
cis-1,2-Dichloroethene		4.9	1.0	ug/L	8260B
Trichloroethene		4.4	1.0	ug/L	8260B
Tetrachloroethene		8.4	1.0	ug/L	8260B
500-4050-22	EW-8				
cis-1,2-Dichloroethene		16	1.0	ug/L	8260B
Trichloroethene		8.6	1.0	ug/L	8260B
Tetrachloroethene		58	1.0	ug/L	8260B
500-4050-23	EW-9				
Trichloroethene		1.4	1.0	ug/L	8260B
Tetrachloroethene		170	10	ug/L	8260B
500-4050-24	EW-9 DUP				
Trichloroethene		1.4	1.0	ug/L	8260B
Tetrachloroethene		170	10	ug/L	8260B

EXECUTIVE SUMMARY - Detections

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Lab Sample ID Analyte	Client Sample ID	Result / Qualifier	Reporting Limit	Units	Method
500-4050-25 Tetrachloroethene	EW-10	2.5	1.0	ug/L	8260B

METHOD SUMMARY

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Description	Lab Location	Method	Preparation Method
Matrix: Water			
VOC Purge-and-Trap	STL CHI STL CHI	SW846 8260B SW846 5030B	

LAB REFERENCES:

STL CHI = STL Chicago

METHOD REFERENCES:

SW846 - "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986
And Its Updates.

METHOD / ANALYST SUMMARY

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Method	Analyst	Analyst ID
SW846 8260B	Nagel, John D	JDN

SAMPLE SUMMARY

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Lab Sample ID	Client Sample ID	Client Matrix	Date/Time Sampled	Date/Time Received
500-4050-1	RFW-1A	Water	05/03/2007 0735	05/05/2007 0930
500-4050-2	RFW-1B	Water	05/04/2007 0745	05/05/2007 0930
500-4050-3	RFW-2A	Water	05/03/2007 0830	05/05/2007 0930
500-4050-4	RFW-2B	Water	05/03/2007 0855	05/05/2007 0930
500-4050-5	RFW-3B	Water	05/04/2007 0845	05/05/2007 0930
500-4050-6	RFW-4A	Water	05/04/2007 1120	05/05/2007 0930
500-4050-7	RFW-4B	Water	05/04/2007 1110	05/05/2007 0930
500-4050-8	RFW-4B DUP	Water	05/04/2007 1110	05/05/2007 0930
500-4050-9	RFW-6	Water	05/04/2007 0800	05/05/2007 0930
500-4050-10	RFW-7	Water	05/03/2007 1330	05/05/2007 0930
500-4050-11	RFW-9	Water	05/03/2007 1800	05/05/2007 0930
500-4050-12	RFW-11B	Water	05/04/2007 1100	05/05/2007 0930
500-4050-13	RFW-12B	Water	05/04/2007 1410	05/05/2007 0930
500-4050-14	RFW-13	Water	05/03/2007 1610	05/05/2007 0930
500-4050-15	RFW-17	Water	05/03/2007 1255	05/05/2007 0930
500-4050-16	EW-2	Water	05/04/2007 1300	05/05/2007 0930
500-4050-17	EW-3	Water	05/04/2007 0900	05/05/2007 0930
500-4050-18	EW-4	Water	05/04/2007 0845	05/05/2007 0930
500-4050-19	EW-5	Water	05/03/2007 0915	05/05/2007 0930
500-4050-20	EW-6	Water	05/03/2007 1430	05/05/2007 0930
500-4050-21	EW-7	Water	05/03/2007 1440	05/05/2007 0930
500-4050-22	EW-8	Water	05/03/2007 1520	05/05/2007 0930
500-4050-23	EW-9	Water	05/03/2007 1530	05/05/2007 0930
500-4050-24	EW-9 DUP	Water	05/03/2007 1530	05/05/2007 0930
500-4050-25	EW-10	Water	05/03/2007 1550	05/05/2007 0930
500-4050-26	LEISTER-1	Water	05/03/2007 1215	05/05/2007 0930
500-4050-27	LEISTER-2	Water	05/03/2007 1225	05/05/2007 0930
500-4050-28	LEISTER-DAIRY	Water	05/03/2007 1220	05/05/2007 0930
500-4050-29	TRIP BLANK	Water	05/03/2007 0800	05/05/2007 0930

SAMPLE RESULTS

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-1A
Lab Sample ID: 500-4050-1

Date Sampled: 05/03/2007 0735
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0020			
Prep Method: 5030B	Date Prepared:	05/16/2007 0020			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	3.4	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	<1.0	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	<1.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-1A
Lab Sample ID: 500-4050-1

Date Sampled: 05/03/2007 0735
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0020			
Prep Method: 5030B	Date Prepared:	05/16/2007 0020			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	101	%		70 - 125	
Toluene-d8 (Surr)	94	%		75 - 120	
4-Bromofluorobenzene (Surr)	91	%		75 - 120	
Dibromofluoromethane	98	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-1B
Lab Sample ID: 500-4050-2

Date Sampled: 05/04/2007 0745
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0043			
Prep Method: 5030B	Date Prepared:	05/16/2007 0043			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorodifluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	2.8	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	<1.0	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	<1.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-1B
Lab Sample ID: 500-4050-2

Date Sampled: 05/04/2007 0745
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0043			
Prep Method: 5030B	Date Prepared:	05/16/2007 0043			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	102	%		70 - 125	
Toluene-d8 (Surr)	94	%		75 - 120	
4-Bromofluorobenzene (Surr)	92	%		75 - 120	
Dibromofluoromethane	98	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-2A
Lab Sample ID: 500-4050-3

Date Sampled: 05/03/2007 0830
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0106			
Prep Method: 5030B	Date Prepared:	05/16/2007 0106			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	2.9	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	<1.0	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	<1.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-2A
Lab Sample ID: 500-4050-3

Date Sampled: 05/03/2007 0830
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0106			
Prep Method: 5030B	Date Prepared:	05/16/2007 0106			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	103	%		70 - 125	
Toluene-d8 (Surr)	95	%		75 - 120	
4-Bromofluorobenzene (Surr)	93	%		75 - 120	
Dibromofluoromethane	99	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-2B
Lab Sample ID: 500-4050-4

Date Sampled: 05/03/2007 0855
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0129			
Prep Method: 5030B	Date Prepared:	05/16/2007 0129			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	3.1	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	<1.0	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	<1.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-2B
Lab Sample ID: 500-4050-4

Date Sampled: 05/03/2007 0855
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0129			
Prep Method: 5030B	Date Prepared:	05/16/2007 0129			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	102	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	91	%		75 - 120	
Dibromofluoromethane	100	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-3B
Lab Sample ID: 500-4050-5

Date Sampled: 05/04/2007 0845
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0152			
Prep Method: 5030B	Date Prepared:	05/16/2007 0152			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	3.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	6.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	<1.0	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	2.1	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-3B
Lab Sample ID: 500-4050-5

Date Sampled: 05/04/2007 0845
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0152			
Prep Method: 5030B	Date Prepared:	05/16/2007 0152			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	99	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	90	%		75 - 120	
Dibromofluoromethane	99	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-4A
Lab Sample ID: 500-4050-6

Date Sampled: 05/04/2007 1120
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0215			
Prep Method: 5030B	Date Prepared:	05/16/2007 0215			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	2.8	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	30	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	26	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-4A
Lab Sample ID: 500-4050-6

Date Sampled: 05/04/2007 1120
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0215			
Prep Method: 5030B	Date Prepared:	05/16/2007 0215			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	104	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	91	%		75 - 120	
Dibromofluoromethane	101	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-4B
Lab Sample ID: 500-4050-7

Date Sampled: 05/04/2007 1110
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0238			
Prep Method: 5030B	Date Prepared:	05/16/2007 0238			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	3.1	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	3.9	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	1.5	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	44	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	74	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-4B
Lab Sample ID: 500-4050-7

Date Sampled: 05/04/2007 1110
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0238			
Prep Method: 5030B	Date Prepared:	05/16/2007 0238			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	102	%		70 - 125	
Toluene-d8 (Surr)	94	%		75 - 120	
4-Bromofluorobenzene (Surr)	89	%		75 - 120	
Dibromofluoromethane	102	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-4B DUP
Lab Sample ID: 500-4050-8

Date Sampled: 05/04/2007 1110
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0323			
Prep Method: 5030B	Date Prepared:	05/16/2007 0323			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	2.2	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	4.1	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	1.6	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	47	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	80	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-4B DUP
Lab Sample ID: 500-4050-8

Date Sampled: 05/04/2007 1110
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0323			
Prep Method: 5030B	Date Prepared:	05/16/2007 0323			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	103	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	89	%		75 - 120	
Dibromofluoromethane	101	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-6
Lab Sample ID: 500-4050-9

Date Sampled: 05/04/2007 0800
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0409			
Prep Method: 5030B	Date Prepared:	05/16/2007 0409			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	1.9	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	2.3	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	2.3	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-6
Lab Sample ID: 500-4050-9

Date Sampled: 05/04/2007 0800
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0409			
Prep Method: 5030B	Date Prepared:	05/16/2007 0409			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	106	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	89	%		75 - 120	
Dibromofluoromethane	106	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-7
Lab Sample ID: 500-4050-10

Date Sampled: 05/03/2007 1330
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0432			
Prep Method: 5030B	Date Prepared:	05/16/2007 0432			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	1.8	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	3.2	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	<1.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-7
Lab Sample ID: 500-4050-10

Date Sampled: 05/03/2007 1330
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0432			
Prep Method: 5030B	Date Prepared:	05/16/2007 0432			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	106	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	90	%		75 - 120	
Dibromofluoromethane	105	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-9
Lab Sample ID: 500-4050-11

Date Sampled: 05/03/2007 1800
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0455			
Prep Method: 5030B	Date Prepared:	05/16/2007 0455			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	1.1	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	1.8	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	9.6	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	1.5	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	15	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	3.6	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-9
Lab Sample ID: 500-4050-11

Date Sampled: 05/03/2007 1800
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed: 05/16/2007 0455				
Prep Method: 5030B	Date Prepared: 05/16/2007 0455				
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	105	%		70 - 125	
Toluene-d8 (Surr)	94	%		75 - 120	
4-Bromofluorobenzene (Surr)	88	%		75 - 120	
Dibromofluoromethane	104	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-11B
Lab Sample ID: 500-4050-12

Date Sampled: 05/04/2007 1100
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0517			
Prep Method: 5030B	Date Prepared:	05/16/2007 0517			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	1.9	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	15	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	<1.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-11B
Lab Sample ID: 500-4050-12

Date Sampled: 05/04/2007 1100
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0517			
Prep Method: 5030B	Date Prepared:	05/16/2007 0517			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	108	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	90	%		75 - 120	
Dibromofluoromethane	107	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-12B
Lab Sample ID: 500-4050-13

Date Sampled: 05/04/2007 1410
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0540			
Prep Method: 5030B	Date Prepared:	05/16/2007 0540			
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Benzene	<1.0	ug/L	0.23	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	1.9	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	20	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	5.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-12B
Lab Sample ID: 500-4050-13

Date Sampled: 05/04/2007 1410
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0540			
Prep Method: 5030B	Date Prepared:	05/16/2007 0540			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	106	%		70 - 125	
Toluene-d8 (Surr)	94	%		75 - 120	
4-Bromofluorobenzene (Surr)	91	%		75 - 120	
Dibromofluoromethane	109	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-13
Lab Sample ID: 500-4050-14

Date Sampled: 05/03/2007 1610
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0603			
Prep Method: 5030B	Date Prepared:	05/16/2007 0603			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	2.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	3.7	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	16	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-13
Lab Sample ID: 500-4050-14

Date Sampled: 05/03/2007 1610
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0603			
Prep Method: 5030B	Date Prepared:	05/16/2007 0603			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	108	%		70 - 125	
Toluene-d8 (Surr)	91	%		75 - 120	
4-Bromofluorobenzene (Surr)	88	%		75 - 120	
Dibromofluoromethane	109	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-17
Lab Sample ID: 500-4050-15

Date Sampled: 05/03/2007 1255
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0951			
Prep Method: 5030B	Date Prepared:	05/16/2007 0951			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	<1.0	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	<1.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: RFW-17
Lab Sample ID: 500-4050-15

Date Sampled: 05/03/2007 1255
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0951			
Prep Method: 5030B	Date Prepared:	05/16/2007 0951			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	104	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	91	%		75 - 120	
Dibromofluoromethane	99	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-2
Lab Sample ID: 500-4050-16

Date Sampled: 05/04/2007 1300
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0649			
Prep Method: 5030B	Date Prepared:	05/16/2007 0649			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	1.6	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	2.3	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	64	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0
o-Xylene	<1.0	ug/L	0.19	1.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-2
Lab Sample ID: 500-4050-16

Date Sampled: 05/04/2007 1300
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0649			
Prep Method: 5030B	Date Prepared:	05/16/2007 0649			
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	107	%		70 - 125	
Toluene-d8 (Surr)	95	%		75 - 120	
4-Bromofluorobenzene (Surr)	87	%		75 - 120	
Dibromofluoromethane	105	%		75 - 120	
Method: 8260B Run Type: DL	Date Analyzed:	05/16/2007 0711			
Prep Method: 5030B	Date Prepared:	05/16/2007 0711			
Trichloroethene	390	ug/L	1.3	10	10
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	106	%		70 - 125	
Toluene-d8 (Surr)	94	%		75 - 120	
4-Bromofluorobenzene (Surr)	91	%		75 - 120	
Dibromofluoromethane	111	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-3
Lab Sample ID: 500-4050-17

Date Sampled: 05/04/2007 0900
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0734			
Prep Method: 5030B	Date Prepared:	05/16/2007 0734			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	1.7	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	1.8	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	3.1	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0
o-Xylene	<1.0	ug/L	0.19	1.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-3
Lab Sample ID: 500-4050-17

Date Sampled: 05/04/2007 0900
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0734			
Prep Method: 5030B	Date Prepared:	05/16/2007 0734			
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	109	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	87	%		75 - 120	
Dibromofluoromethane	113	%		75 - 120	
Method: 8260B Run Type: DL	Date Analyzed:	05/16/2007 0757			
Prep Method: 5030B	Date Prepared:	05/16/2007 0757			
Trichloroethene	130	ug/L	1.3	10	10
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	105	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	89	%		75 - 120	
Dibromofluoromethane	108	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-4
Lab Sample ID: 500-4050-18

Date Sampled: 05/04/2007 0845
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0820			
Prep Method: 5030B	Date Prepared:	05/16/2007 0820			
Benzene	<10	ug/L	2.3	10	10
Dichlorodifluoromethane	<10	ug/L	1.2	10	10
Chloromethane	<10	ug/L	2.0	10	10
Vinyl chloride	<10	ug/L	1.6	10	10
Bromomethane	<10	ug/L	5.9	10	10
Chloroethane	<10	ug/L	3.2	10	10
Trichlorofluoromethane	<10	ug/L	1.4	10	10
1,1-Dichloroethene	<10	ug/L	2.5	10	10
Carbon disulfide	<50	ug/L	1.5	50	10
Acetone	<50	ug/L	14	50	10
Methylene Chloride	17	ug/L	2.4	10	10
trans-1,2-Dichloroethene	<10	ug/L	2.9	10	10
1,1-Dichloroethane	<10	ug/L	1.5	10	10
2,2-Dichloropropane	<10	ug/L	1.7	10	10
cis-1,2-Dichloroethene	<10	ug/L	2.0	10	10
2-Butanone (MEK)	<50	ug/L	10	50	10
Bromochloromethane	<10	ug/L	2.7	10	10
Chloroform	<10	ug/L	1.4	10	10
1,1,1-Trichloroethane	<10	ug/L	1.7	10	10
1,1-Dichloropropene	<10	ug/L	3.8	10	10
Carbon tetrachloride	<10	ug/L	3.4	10	10
1,2-Dichloroethane	<10	ug/L	2.5	10	10
1,2-Dichloropropane	<10	ug/L	1.9	10	10
Dibromomethane	<10	ug/L	2.1	10	10
Bromodichloromethane	<10	ug/L	2.2	10	10
cis-1,3-Dichloropropene	<10	ug/L	1.5	10	10
4-Methyl-2-pentanone (MIBK)	<50	ug/L	9.2	50	10
Toluene	<10	ug/L	1.8	10	10
trans-1,3-Dichloropropene	<10	ug/L	1.6	10	10
1,1,2-Trichloroethane	<10	ug/L	2.4	10	10
Tetrachloroethene	27	ug/L	1.8	10	10
1,3-Dichloropropane	<10	ug/L	2.2	10	10
2-Hexanone	<50	ug/L	9.9	50	10
Dibromochloromethane	<10	ug/L	2.2	10	10
1,2-Dibromoethane	<10	ug/L	3.3	10	10
Chlorobenzene	<10	ug/L	1.5	10	10
1,1,1,2-Tetrachloroethane	<10	ug/L	3.3	10	10
Ethylbenzene	<10	ug/L	2.1	10	10
m&p-Xylene	<20	ug/L	3.6	20	10
o-Xylene	<10	ug/L	1.9	10	10

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-4
Lab Sample ID: 500-4050-18

Date Sampled: 05/04/2007 0845
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0820			
Prep Method: 5030B	Date Prepared:	05/16/2007 0820			
Styrene	<10	ug/L	1.8	10	10
Bromoform	<10	ug/L	3.2	10	10
Isopropylbenzene	<10	ug/L	2.0	10	10
Bromobenzene	<10	ug/L	2.2	10	10
1,1,2,2-Tetrachloroethane	<10	ug/L	3.4	10	10
1,2,3-Trichloropropane	<10	ug/L	3.5	10	10
N-Propylbenzene	<10	ug/L	1.6	10	10
2-Chlorotoluene	<10	ug/L	1.6	10	10
1,3,5-Trimethylbenzene	<10	ug/L	1.8	10	10
4-Chlorotoluene	<10	ug/L	1.8	10	10
tert-Butylbenzene	<10	ug/L	1.6	10	10
1,2,4-Trimethylbenzene	<10	ug/L	2.6	10	10
sec-Butylbenzene	<10	ug/L	1.9	10	10
1,3-Dichlorobenzene	<10	ug/L	2.1	10	10
p-Isopropyltoluene	<10	ug/L	2.9	10	10
1,4-Dichlorobenzene	<10	ug/L	2.5	10	10
n-Butylbenzene	<10	ug/L	3.5	10	10
1,2-Dichlorobenzene	<10	ug/L	2.9	10	10
1,2-Dibromo-3-Chloropropane	<10	ug/L	4.1	10	10
1,2,4-Trichlorobenzene	<10	ug/L	3.6	10	10
Hexachlorobutadiene	<10	ug/L	3.6	10	10
Naphthalene	<10	ug/L	3.7	10	10
1,2,3-Trichlorobenzene	<10	ug/L	4.3	10	10
Surrogate					
1,2-Dichloroethane-d4 (Surr)	108	%		Acceptance Limits	70 - 125
Toluene-d8 (Surr)	93	%			75 - 120
4-Bromofluorobenzene (Surr)	88	%			75 - 120
Dibromofluoromethane	109	%			75 - 120
Method: 8260B Run Type: DL	Date Analyzed:	05/16/2007 0843			
Prep Method: 5030B	Date Prepared:	05/16/2007 0843			
Trichloroethene	1300	ug/L	13	100	100
Surrogate					
1,2-Dichloroethane-d4 (Surr)	108	%		Acceptance Limits	70 - 125
Toluene-d8 (Surr)	94	%			75 - 120
4-Bromofluorobenzene (Surr)	90	%			75 - 120
Dibromofluoromethane	110	%			75 - 120

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-5
Lab Sample ID: 500-4050-19

Date Sampled: 05/03/2007 0915
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0906			
Prep Method: 5030B	Date Prepared:	05/16/2007 0906			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	1.2	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	7.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0
o-Xylene	<1.0	ug/L	0.19	1.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-5
Lab Sample ID: 500-4050-19

Date Sampled: 05/03/2007 0915
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 0906			
Prep Method: 5030B	Date Prepared:	05/16/2007 0906			
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	103	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	91	%		75 - 120	
Dibromofluoromethane	100	%		75 - 120	
Method: 8260B Run Type: DL	Date Analyzed:	05/16/2007 0928			
Prep Method: 5030B	Date Prepared:	05/16/2007 0928			
Trichloroethene	160	ug/L	1.3	10	10
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	97	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	90	%		75 - 120	
Dibromofluoromethane	97	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-6
Lab Sample ID: 500-4050-20

Date Sampled: 05/03/2007 1430
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1146			
Prep Method: 5030B	Date Prepared:	05/16/2007 1146			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	9.2	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	17	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-6
Lab Sample ID: 500-4050-20

Date Sampled: 05/03/2007 1430
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1146			
Prep Method: 5030B	Date Prepared:	05/16/2007 1146			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	102	%		70 - 125	
Toluene-d8 (Surr)	92	%		75 - 120	
4-Bromofluorobenzene (Surr)	91	%		75 - 120	
Dibromofluoromethane	99	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-7
Lab Sample ID: 500-4050-21

Date Sampled: 05/03/2007 1440
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1208			
Prep Method: 5030B	Date Prepared:	05/16/2007 1208			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	4.9	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	4.4	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	8.4	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-7
Lab Sample ID: 500-4050-21

Date Sampled: 05/03/2007 1440
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007	1208		
Prep Method: 5030B	Date Prepared:	05/16/2007	1208		
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	102	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	89	%		75 - 120	
Dibromofluoromethane	97	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-8
Lab Sample ID: 500-4050-22

Date Sampled: 05/03/2007 1520.
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1231			
Prep Method: 5030B	Date Prepared:	05/16/2007 1231			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	16	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	8.6	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	58	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-8
Lab Sample ID: 500-4050-22

Date Sampled: 05/03/2007 1520
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1231			
Prep Method: 5030B	Date Prepared:	05/16/2007 1231			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	102	%		70 - 125	
Toluene-d8 (Surr)	92	%		75 - 120	
4-Bromofluorobenzene (Surr)	90	%		75 - 120	
Dibromofluoromethane	96	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-9
Lab Sample ID: 500-4050-23

Date Sampled: 05/03/2007 1530
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed: 05/16/2007 1254				
Prep Method: 5030B	Date Prepared: 05/16/2007 1254				
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	1.4	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0
o-Xylene	<1.0	ug/L	0.19	1.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-9
Lab Sample ID: 500-4050-23

Date Sampled: 05/03/2007 1530
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1254			
Prep Method: 5030B	Date Prepared:	05/16/2007 1254			
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate					
1,2-Dichloroethane-d4 (Surr)	103	%		Acceptance Limits	
Toluene-d8 (Surr)	92	%		70 - 125	
4-Bromofluorobenzene (Surr)	89	%		75 - 120	
Dibromofluoromethane	101	%		75 - 120	
Method: 8260B Run Type: DL	Date Analyzed:	05/16/2007 1317			
Prep Method: 5030B	Date Prepared:	05/16/2007 1317			
Tetrachloroethene	170	ug/L	1.8	10	10
Surrogate					
1,2-Dichloroethane-d4 (Surr)	101	%		Acceptance Limits	
Toluene-d8 (Surr)	92	%		70 - 125	
4-Bromofluorobenzene (Surr)	90	%		75 - 120	
Dibromofluoromethane	101	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-9 DUP
Lab Sample ID: 500-4050-24

Date Sampled: 05/03/2007 1530
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1340			
Prep Method: 5030B	Date Prepared:	05/16/2007 1340			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	1.4	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0
o-Xylene	<1.0	ug/L	0.19	1.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-9 DUP
Lab Sample ID: 500-4050-24

Date Sampled: 05/03/2007 1530
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1340			
Prep Method: 5030B	Date Prepared:	05/16/2007 1340			
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	106	%		70 - 125	
Toluene-d8 (Surr)	92	%		75 - 120	
4-Bromofluorobenzene (Surr)	89	%		75 - 120	
Dibromofluoromethane	104	%		75 - 120	
Method: 8260B Run Type: DL	Date Analyzed:	05/16/2007 1403			
Prep Method: 5030B	Date Prepared:	05/16/2007 1403			
Tetrachloroethene	170	ug/L	1.8	10	10
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	102	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	89	%		75 - 120	
Dibromofluoromethane	103	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-10
Lab Sample ID: 500-4050-25

Date Sampled: 05/03/2007 1550
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed: 05/16/2007 1426				
Prep Method: 5030B	Date Prepared: 05/16/2007 1426				
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	<1.0	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	2.5	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: EW-10
Lab Sample ID: 500-4050-25

Date Sampled: 05/03/2007 1550
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007	1426		
Prep Method: 5030B	Date Prepared:	05/16/2007	1426		
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	105	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	90	%		75 - 120	
Dibromofluoromethane	103	%		75 - 120	

Mr. Tom Cornuet
 Weston Solutions, Inc.
 1400 Weston Way
 PO BOX 2653
 West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: LEISTER-1
Lab Sample ID: 500-4050-26

Date Sampled: 05/03/2007 1215
 Date Received: 05/05/2007 0930
 Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed: 05/16/2007 1449				
Prep Method: 5030B	Date Prepared: 05/16/2007 1449				
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorodifluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	<1.0	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	<1.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: LEISTER-1
Lab Sample ID: 500-4050-26

Date Sampled: 05/03/2007 1215
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1449			
Prep Method: 5030B	Date Prepared:	05/16/2007 1449			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	110	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	91	%		75 - 120	
Dibromofluoromethane	103	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: LEISTER-2
Lab Sample ID: 500-4050-27

Date Sampled: 05/03/2007 1225
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1511			
Prep Method: 5030B	Date Prepared:	05/16/2007 1511			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromoform	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	<1.0	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	<1.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: LEISTER-2
Lab Sample ID: 500-4050-27

Date Sampled: 05/03/2007 1225
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1511			
Prep Method: 5030B	Date Prepared:	05/16/2007 1511			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	109	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	90	%		75 - 120	
Dibromofluoromethane	107	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: LEISTER-DAIRY
Lab Sample ID: 500-4050-28

Date Sampled: 05/03/2007 1220
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1534			
Prep Method: 5030B	Date Prepared:	05/16/2007 1534			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	<1.0	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	<1.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: LEISTER-DAIRY
Lab Sample ID: 500-4050-28

Date Sampled: 05/03/2007 1220
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007	1534		
Prep Method: 5030B	Date Prepared:	05/16/2007	1534		
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	108	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	88	%		75 - 120	
Dibromofluoromethane	107	%		75 - 120	

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: TRIP BLANK
Lab Sample ID: 500-4050-29

Date Sampled: 05/03/2007 0800
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1557			
Prep Method: 5030B	Date Prepared:	05/16/2007 1557			
Benzene	<1.0	ug/L	0.23	1.0	1.0
Dichlorodifluoromethane	<1.0	ug/L	0.12	1.0	1.0
Chloromethane	<1.0	ug/L	0.20	1.0	1.0
Vinyl chloride	<1.0	ug/L	0.16	1.0	1.0
Bromomethane	<1.0	ug/L	0.59	1.0	1.0
Chloroethane	<1.0	ug/L	0.32	1.0	1.0
Trichlorofluoromethane	<1.0	ug/L	0.14	1.0	1.0
1,1-Dichloroethene	<1.0	ug/L	0.25	1.0	1.0
Carbon disulfide	<5.0	ug/L	0.15	5.0	1.0
Acetone	<5.0	ug/L	1.4	5.0	1.0
Methylene Chloride	<1.0	ug/L	0.24	1.0	1.0
trans-1,2-Dichloroethene	<1.0	ug/L	0.29	1.0	1.0
1,1-Dichloroethane	<1.0	ug/L	0.15	1.0	1.0
2,2-Dichloropropane	<1.0	ug/L	0.17	1.0	1.0
cis-1,2-Dichloroethene	<1.0	ug/L	0.20	1.0	1.0
2-Butanone (MEK)	<5.0	ug/L	1.0	5.0	1.0
Bromochloromethane	<1.0	ug/L	0.27	1.0	1.0
Chloroform	<1.0	ug/L	0.14	1.0	1.0
1,1,1-Trichloroethane	<1.0	ug/L	0.17	1.0	1.0
1,1-Dichloropropene	<1.0	ug/L	0.38	1.0	1.0
Carbon tetrachloride	<1.0	ug/L	0.34	1.0	1.0
1,2-Dichloroethane	<1.0	ug/L	0.25	1.0	1.0
Trichloroethene	<1.0	ug/L	0.13	1.0	1.0
1,2-Dichloropropane	<1.0	ug/L	0.19	1.0	1.0
Dibromomethane	<1.0	ug/L	0.21	1.0	1.0
Bromodichloromethane	<1.0	ug/L	0.22	1.0	1.0
cis-1,3-Dichloropropene	<1.0	ug/L	0.15	1.0	1.0
4-Methyl-2-pentanone (MIBK)	<5.0	ug/L	0.92	5.0	1.0
Toluene	<1.0	ug/L	0.18	1.0	1.0
trans-1,3-Dichloropropene	<1.0	ug/L	0.16	1.0	1.0
1,1,2-Trichloroethane	<1.0	ug/L	0.24	1.0	1.0
Tetrachloroethene	<1.0	ug/L	0.18	1.0	1.0
1,3-Dichloropropane	<1.0	ug/L	0.22	1.0	1.0
2-Hexanone	<5.0	ug/L	0.99	5.0	1.0
Dibromochloromethane	<1.0	ug/L	0.22	1.0	1.0
1,2-Dibromoethane	<1.0	ug/L	0.33	1.0	1.0
Chlorobenzene	<1.0	ug/L	0.15	1.0	1.0
1,1,1,2-Tetrachloroethane	<1.0	ug/L	0.33	1.0	1.0
Ethylbenzene	<1.0	ug/L	0.21	1.0	1.0
m&p-Xylene	<2.0	ug/L	0.36	2.0	1.0

Mr. Tom Cornuet
Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Job Number: 500-4050-1

Client Sample ID: TRIP BLANK
Lab Sample ID: 500-4050-29

Date Sampled: 05/03/2007 0800
Date Received: 05/05/2007 0930
Client Matrix: Water

Analyte	Result/Qualifier	Unit	MDL	RL	Dilution
Method: 8260B	Date Analyzed:	05/16/2007 1557			
Prep Method: 5030B	Date Prepared:	05/16/2007 1557			
o-Xylene	<1.0	ug/L	0.19	1.0	1.0
Styrene	<1.0	ug/L	0.18	1.0	1.0
Bromoform	<1.0	ug/L	0.32	1.0	1.0
Isopropylbenzene	<1.0	ug/L	0.20	1.0	1.0
Bromobenzene	<1.0	ug/L	0.22	1.0	1.0
1,1,2,2-Tetrachloroethane	<1.0	ug/L	0.34	1.0	1.0
1,2,3-Trichloropropane	<1.0	ug/L	0.35	1.0	1.0
N-Propylbenzene	<1.0	ug/L	0.16	1.0	1.0
2-Chlorotoluene	<1.0	ug/L	0.16	1.0	1.0
1,3,5-Trimethylbenzene	<1.0	ug/L	0.18	1.0	1.0
4-Chlorotoluene	<1.0	ug/L	0.18	1.0	1.0
tert-Butylbenzene	<1.0	ug/L	0.16	1.0	1.0
1,2,4-Trimethylbenzene	<1.0	ug/L	0.26	1.0	1.0
sec-Butylbenzene	<1.0	ug/L	0.19	1.0	1.0
1,3-Dichlorobenzene	<1.0	ug/L	0.21	1.0	1.0
p-Isopropyltoluene	<1.0	ug/L	0.29	1.0	1.0
1,4-Dichlorobenzene	<1.0	ug/L	0.25	1.0	1.0
n-Butylbenzene	<1.0	ug/L	0.35	1.0	1.0
1,2-Dichlorobenzene	<1.0	ug/L	0.29	1.0	1.0
1,2-Dibromo-3-Chloropropane	<1.0	ug/L	0.41	1.0	1.0
1,2,4-Trichlorobenzene	<1.0	ug/L	0.36	1.0	1.0
Hexachlorobutadiene	<1.0	ug/L	0.36	1.0	1.0
Naphthalene	<1.0	ug/L	0.37	1.0	1.0
1,2,3-Trichlorobenzene	<1.0	ug/L	0.43	1.0	1.0
Surrogate				Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	111	%		70 - 125	
Toluene-d8 (Surr)	93	%		75 - 120	
4-Bromofluorobenzene (Surr)	92	%		75 - 120	
Dibromofluoromethane	109	%		75 - 120	

DATA REPORTING QUALIFIERS

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Lab Section	Qualifier	Description
GC/MS VOA	F	RPD of the MS and MSD exceeds the control limits

QUALITY CONTROL RESULTS

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

QC Association Summary

Lab Sample ID	Client Sample ID	Report Basis	Client Matrix	Method	Prep Batch
GC/MS VOA					
Analysis Batch:500-15035					
LCS 500-15035/30	Lab Control Spike	T	Water	8260B	
MB 500-15035/29	Method Blank	T	Water	8260B	
500-4050-1	RFW-1A	T	Water	8260B	
500-4050-2	RFW-1B	T	Water	8260B	
500-4050-3	RFW-2A	T	Water	8260B	
500-4050-4	RFW-2B	T	Water	8260B	
500-4050-5	RFW-3B	T	Water	8260B	
500-4050-6	RFW-4A	T	Water	8260B	
500-4050-7	RFW-4B	T	Water	8260B	
500-4050-8	RFW-4B DUP	T	Water	8260B	
500-4050-9	RFW-6	T	Water	8260B	
500-4050-10	RFW-7	T	Water	8260B	
500-4050-11	RFW-9	T	Water	8260B	
500-4050-12	RFW-11B	T	Water	8260B	
500-4050-13	RFW-12B	T	Water	8260B	
500-4050-14	RFW-13	T	Water	8260B	
500-4050-15	RFW-17	T	Water	8260B	
500-4050-16	EW-2	T	Water	8260B	
500-4050-16DL	EW-2	T	Water	8260B	
500-4050-17	EW-3	T	Water	8260B	
500-4050-17DL	EW-3	T	Water	8260B	
500-4050-18	EW-4	T	Water	8260B	
500-4050-18DL	EW-4	T	Water	8260B	
500-4050-19	EW-5	T	Water	8260B	
500-4050-19DL	EW-5	T	Water	8260B	
Analysis Batch:500-15097					
LCS 500-15097/26	Lab Control Spike	T	Water	8260B	
MB 500-15097/25	Method Blank	T	Water	8260B	
500-4050-20	EW-6	T	Water	8260B	
500-4050-21	EW-7	T	Water	8260B	
500-4050-22	EW-8	T	Water	8260B	
500-4050-23	EW-9	T	Water	8260B	
500-4050-23DL	EW-9	T	Water	8260B	
500-4050-24	EW-9 DUP	T	Water	8260B	
500-4050-24DL	EW-9 DUP	T	Water	8260B	
500-4050-25	EW-10	T	Water	8260B	
500-4050-26	LEISTER-1	T	Water	8260B	
500-4050-27	LEISTER-2	T	Water	8260B	
500-4050-28	LEISTER-DAIRY	T	Water	8260B	
500-4050-28MS	Matrix Spike	T	Water	8260B	
500-4050-28MSD	Matrix Spike Duplicate	T	Water	8260B	
500-4050-29	TRIP BLANK	T	Water	8260B	

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

QC Association Summary

Lab Sample ID	Client Sample ID	Report Basis	Client Matrix	Method	Prep Batch
---------------	------------------	--------------	---------------	--------	------------

Report Basis

T = Total

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Surrogate Recovery Report**8260B VOC****Client Matrix: Water**

<u>Lab Sample ID</u>	<u>Client Sample ID</u>	(BFB) (%Rec)	(DCE) (%Rec)	(DFM) (%Rec)	(TOL) (%Rec)
500-4050-1	RFW-1A	91	101	98	94
500-4050-2	RFW-1B	92	102	98	94
500-4050-3	RFW-2A	93	103	99	95
500-4050-4	RFW-2B	91	102	100	93
500-4050-5	RFW-3B	90	99	99	93
500-4050-6	RFW-4A	91	104	101	93
500-4050-7	RFW-4B	89	102	102	94
500-4050-8	RFW-4B DUP	89	103	101	93
500-4050-9	RFW-6	89	106	106	93
500-4050-10	RFW-7	90	106	105	93
500-4050-11	RFW-9	88	105	104	94
500-4050-12	RFW-11B	90	108	107	93
500-4050-13	RFW-12B	91	106	109	94
500-4050-14	RFW-13	88	108	109	91
500-4050-15	RFW-17	91	104	99	93
500-4050-16	EW-2	87	107	105	95
500-4050-16 DL	EW-2	91	106	111	94
500-4050-17	EW-3	87	109	113	93

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Surrogate Recovery Report**8260B VOC****Client Matrix: Water**

			(BFB) (%Rec)	(DCE) (%Rec)	(DFM) (%Rec)	(TOL) (%Rec)
500-4050-17 DL	EW-3		89	105	108	93
500-4050-18	EW-4		88	108	109	93
500-4050-18 DL	EW-4		90	108	110	94
500-4050-19	EW-5		91	103	100	93
500-4050-19 DL	EW-5		90	97	97	93
500-4050-20	EW-6		91	102	99	92
500-4050-21	EW-7		89	102	97	93
500-4050-22	EW-8		90	102	96	92
500-4050-23	EW-9		89	103	101	92
500-4050-23 DL	EW-9		90	101	101	92
500-4050-24	EW-9 DUP		89	106	104	92
500-4050-24 DL	EW-9 DUP		89	102	103	93
500-4050-25	EW-10		90	105	103	93
500-4050-26	LEISTER-1		91	110	103	93
500-4050-27	LEISTER-2		90	109	107	93
500-4050-28	LEISTER-DAIRY		88	108	107	93
500-4050-29	TRIP BLANK		92	111	109	93
500-4050-28 MS	LEISTER-DAIRY		95	103	103	95

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Surrogate Recovery Report

8260B VOC

Client Matrix: Water

		(BFB) (%Rec)	(DCE) (%Rec)	(DFM) (%Rec)	(TOL) (%Rec)
500-4050-28 MSD	LEISTER-DAIRY	94	104	101	94
LCS 500-15035/30		99	98	100	95
LCS 500-15097/26		97	98	95	95
MB 500-15035/29		90	99	99	93
MB 500-15097/25		90	99	96	92

Surrogate	Acceptance Limits
(BFB) 4-Bromofluorobenzene (Surr)	75 - 120
(DCE) 1,2-Dichloroethane-d4 (Surr)	70 - 125
(DFM) Dibromofluoromethane	75 - 120
(TOL) Toluene-d8 (Surr)	75 - 120

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Method Blank - Batch: 500-15035

Lab Sample ID: MB 500-15035/29
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/15/2007 2335
Date Prepared: 05/15/2007 2335

Analysis Batch: 500-15035
Prep Batch: N/A
Units: ug/L

Method: 8260B
Preparation: 5030B

Instrument ID: Agilent 6890N GC - 5973N
Lab File ID: 6M0515A.D
Initial Weight/Volume: 10 mL
Final Weight/Volume: 10 mL

Analyte	Result	Qual	MDL	RL
Benzene	<1.0		0.23	1.0
Dichlorodifluoromethane	<1.0		0.12	1.0
Chloromethane	<1.0		0.20	1.0
Vinyl chloride	<1.0		0.16	1.0
Bromomethane	<1.0		0.59	1.0
Chloroethane	<1.0		0.32	1.0
Trichlorofluoromethane	<1.0		0.14	1.0
1,1-Dichloroethene	<1.0		0.25	1.0
Carbon disulfide	<5.0		0.15	5.0
Acetone	<5.0		1.4	5.0
Methylene Chloride	<1.0		0.24	1.0
trans-1,2-Dichloroethene	<1.0		0.29	1.0
1,1-Dichloroethane	<1.0		0.15	1.0
2,2-Dichloropropane	<1.0		0.17	1.0
cis-1,2-Dichloroethene	<1.0		0.20	1.0
2-Butanone (MEK)	<5.0		1.0	5.0
Bromochloromethane	<1.0		0.27	1.0
Chloroform	<1.0		0.14	1.0
1,1,1-Trichloroethane	<1.0		0.17	1.0
1,1-Dichloropropene	<1.0		0.38	1.0
Carbon tetrachloride	<1.0		0.34	1.0
1,2-Dichloroethane	<1.0		0.25	1.0
Trichloroethene	<1.0		0.13	1.0
1,2-Dichloropropane	<1.0		0.19	1.0
Dibromomethane	<1.0		0.21	1.0
Bromodichloromethane	<1.0		0.22	1.0
cis-1,3-Dichloropropene	<1.0		0.15	1.0
4-Methyl-2-pentanone (MIBK)	<5.0		0.92	5.0
Toluene	<1.0		0.18	1.0
trans-1,3-Dichloropropene	<1.0		0.16	1.0
1,1,2-Trichloroethane	<1.0		0.24	1.0
Tetrachloroethene	<1.0		0.18	1.0
1,3-Dichloropropane	<1.0		0.22	1.0
2-Hexanone	<5.0		0.99	5.0
Dibromochloromethane	<1.0		0.22	1.0
1,2-Dibromoethane	<1.0		0.33	1.0
Chlorobenzene	<1.0		0.15	1.0
1,1,1,2-Tetrachloroethane	<1.0		0.33	1.0
Ethylbenzene	<1.0		0.21	1.0
m&p-Xylene	<2.0		0.36	2.0
o-Xylene	<1.0		0.19	1.0

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Method Blank - Batch: 500-15035

Method: 8260B

Preparation: 5030B

Lab Sample ID: MB 500-15035/29
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/15/2007 2335
Date Prepared: 05/15/2007 2335

Analysis Batch: 500-15035
Prep Batch: N/A
Units: ug/L

Instrument ID: Agilent 6890N GC - 5973N
Lab File ID: 6M0515A.D
Initial Weight/Volume: 10 mL
Final Weight/Volume: 10 mL

Analyte	Result	Qual	MDL	RL
Styrene	<1.0		0.18	1.0
Bromoform	<1.0		0.32	1.0
Isopropylbenzene	<1.0		0.20	1.0
Bromobenzene	<1.0		0.22	1.0
1,1,2,2-Tetrachloroethane	<1.0		0.34	1.0
1,2,3-Trichloropropane	<1.0		0.35	1.0
N-Propylbenzene	<1.0		0.16	1.0
2-Chlorotoluene	<1.0		0.16	1.0
1,3,5-Trimethylbenzene	<1.0		0.18	1.0
4-Chlorotoluene	<1.0		0.18	1.0
tert-Butylbenzene	<1.0		0.16	1.0
1,2,4-Trimethylbenzene	<1.0		0.26	1.0
sec-Butylbenzene	<1.0		0.19	1.0
1,3-Dichlorobenzene	<1.0		0.21	1.0
p-Isopropyltoluene	<1.0		0.29	1.0
1,4-Dichlorobenzene	<1.0		0.25	1.0
n-Butylbenzene	<1.0		0.35	1.0
1,2-Dichlorobenzene	<1.0		0.29	1.0
1,2-Dibromo-3-Chloropropane	<1.0		0.41	1.0
1,2,4-Trichlorobenzene	<1.0		0.36	1.0
Hexachlorobutadiene	<1.0		0.36	1.0
Naphthalene	<1.0		0.37	1.0
1,2,3-Trichlorobenzene	<1.0		0.43	1.0
Surrogate	% Rec		Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	99		70 - 125	
Toluene-d8 (Surr)	93		75 - 120	
4-Bromofluorobenzene (Surr)	90		75 - 120	
Dibromofluoromethane	99		75 - 120	

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Lab Control Spike - Batch: 500-15035

Method: 8260B

Preparation: 5030B

Lab Sample ID: LCS 500-15035/30
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/15/2007 2358
Date Prepared: 05/15/2007 2358

Analysis Batch: 500-15035
Prep Batch: N/A
Units: ug/L

Instrument ID: Agilent 6890N GC - 5973N
Lab File ID: 6S0515A.D
Initial Weight/Volume: 10 mL
Final Weight/Volume: 10 mL

Analyte	Spike Amount	Result	% Rec.	Limit	Qual
Benzene	25.0	19.6	79	68 - 120	
Dichlorodifluoromethane	25.0	18.2	73	21 - 178	
Chloromethane	25.0	22.4	89	50 - 140	
Vinyl chloride	25.0	22.1	88	57 - 135	
Bromomethane	25.0	26.7	107	61 - 172	
Chloroethane	25.0	23.1	92	56 - 152	
Trichlorofluoromethane	25.0	17.8	71	58 - 147	
1,1-Dichloroethene	25.0	16.3	65	50 - 121	
Carbon disulfide	25.0	11.4	46	33 - 120	
Acetone	25.0	13.2	53	22 - 175	
Methylene Chloride	25.0	22.7	91	52 - 126	
trans-1,2-Dichloroethene	25.0	20.5	82	57 - 122	
1,1-Dichloroethane	25.0	20.3	81	63 - 121	
2,2-Dichloropropane	25.0	18.6	74	56 - 134	
cis-1,2-Dichloroethene	25.0	23.4	94	62 - 127	
2-Butanone (MEK)	25.0	18.5	74	36 - 157	
Bromochloromethane	25.0	20.6	82	61 - 125	
Chloroform	25.0	21.1	84	65 - 127	
1,1,1-Trichloroethane	25.0	20.2	81	65 - 129	
1,1-Dichloropropene	25.0	19.5	78	62 - 122	
Carbon tetrachloride	25.0	17.4	70	67 - 121	
1,2-Dichloroethane	25.0	21.6	87	68 - 120	
Trichloroethene	25.0	18.9	76	73 - 120	
1,2-Dichloropropane	25.0	21.7	87	72 - 120	
Dibromomethane	25.0	21.4	86	71 - 120	
Bromodichloromethane	25.0	23.4	94	71 - 131	
cis-1,3-Dichloropropene	26.9	19.9	74	60 - 120	
4-Methyl-2-pentanone (MIBK)	25.0	29.9	120	65 - 128	
Toluene	25.0	22.7	91	75 - 120	
trans-1,3-Dichloropropene	24.3	19.1	79	61 - 120	
1,1,2-Trichloroethane	25.0	25.3	101	59 - 135	
Tetrachloroethene	25.0	17.2	69	65 - 120	
1,3-Dichloropropane	25.0	22.3	89	73 - 120	
2-Hexanone	25.0	28.6	115	54 - 139	
Dibromochloromethane	25.0	23.9	96	57 - 132	
1,2-Dibromoethane	25.0	22.8	91	68 - 125	
Chlorobenzene	25.0	20.6	82	75 - 120	
1,1,1,2-Tetrachloroethane	25.0	21.6	86	72 - 120	
Ethylbenzene	25.0	20.7	83	75 - 120	
m&p-Xylene	50.0	44.3	89	75 - 120	
o-Xylene	25.0	23.4	94	75 - 120	

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Lab Control Spike - Batch: 500-15035

Method: 8260B

Preparation: 5030B

Lab Sample ID: LCS 500-15035/30
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/15/2007 2358
Date Prepared: 05/15/2007 2358

Analysis Batch: 500-15035
Prep Batch: N/A
Units: ug/L

Instrument ID: Agilent 6890N GC - 5973N
Lab File ID: 6S0515A.D
Initial Weight/Volume: 10 mL
Final Weight/Volume: 10 mL

Analyte	Spike Amount	Result	% Rec.	Limit	Qual
Styrene	25.0	23.3	93	77 - 120	
Bromoform	25.0	20.1	80	55 - 120	
Isopropylbenzene	25.0	19.0	76	68 - 120	
Bromobenzene	25.0	22.8	91	76 - 120	
1,1,2,2-Tetrachloroethane	25.0	23.5	94	68 - 120	
1,2,3-Trichloropropane	25.0	23.0	92	70 - 120	
N-Propylbenzene	25.0	22.2	89	74 - 120	
2-Chlorotoluene	25.0	22.4	90	74 - 120	
1,3,5-Trimethylbenzene	25.0	21.5	86	76 - 120	
4-Chlorotoluene	25.0	22.3	89	75 - 120	
tert-Butylbenzene	25.0	21.8	87	75 - 120	
1,2,4-Trimethylbenzene	25.0	22.1	88	76 - 120	
sec-Butylbenzene	25.0	18.7	75	73 - 120	
1,3-Dichlorobenzene	25.0	21.1	84	76 - 120	
p-Isopropyltoluene	25.0	19.2	77	71 - 120	
1,4-Dichlorobenzene	25.0	20.6	82	74 - 120	
n-Butylbenzene	25.0	21.5	86	68 - 120	
1,2-Dichlorobenzene	25.0	22.4	90	74 - 120	
1,2-Dibromo-3-Chloropropane	25.0	23.0	92	60 - 120	
1,2,4-Trichlorobenzene	25.0	21.3	85	63 - 120	
Hexachlorobutadiene	25.0	18.5	74	54 - 131	
Naphthalene	25.0	23.5	94	50 - 120	
1,2,3-Trichlorobenzene	25.0	23.2	93	62 - 120	
Surrogate		% Rec		Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)		98		70 - 125	
Toluene-d8 (Surr)		95		75 - 120	
4-Bromofluorobenzene (Surr)		99		75 - 120	
Dibromofluoromethane		100		75 - 120	

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Method Blank - Batch: 500-15097

Method: 8260B

Preparation: 5030B

Lab Sample ID: MB 500-15097/25
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/16/2007 1100
Date Prepared: 05/16/2007 1100

Analysis Batch: 500-15097
Prep Batch: N/A
Units: ug/L

Instrument ID: Agilent 6890N GC - 5973N
Lab File ID: 6M0516.D
Initial Weight/Volume: 10 mL
Final Weight/Volume: 10 mL

Analyte	Result	Qual	MDL	RL
Benzene	<1.0		0.23	1.0
Dichlorodifluoromethane	<1.0		0.12	1.0
Chloromethane	<1.0		0.20	1.0
Vinyl chloride	<1.0		0.16	1.0
Bromomethane	<1.0		0.59	1.0
Chloroethane	<1.0		0.32	1.0
Trichlorofluoromethane	<1.0		0.14	1.0
1,1-Dichloroethene	<1.0		0.25	1.0
Carbon disulfide	<5.0		0.15	5.0
Acetone	<5.0		1.4	5.0
Methylene Chloride	<1.0		0.24	1.0
trans-1,2-Dichloroethene	<1.0		0.29	1.0
1,1-Dichloroethane	<1.0		0.15	1.0
2,2-Dichloropropane	<1.0		0.17	1.0
cis-1,2-Dichloroethene	<1.0		0.20	1.0
2-Butanone (MEK)	<5.0		1.0	5.0
Bromochloromethane	<1.0		0.27	1.0
Chloroform	<1.0		0.14	1.0
1,1,1-Trichloroethane	<1.0		0.17	1.0
1,1-Dichloropropene	<1.0		0.38	1.0
Carbon tetrachloride	<1.0		0.34	1.0
1,2-Dichloroethane	<1.0		0.25	1.0
Trichloroethene	<1.0		0.13	1.0
1,2-Dichloropropane	<1.0		0.19	1.0
Dibromomethane	<1.0		0.21	1.0
Bromodichloromethane	<1.0		0.22	1.0
cis-1,3-Dichloropropene	<1.0		0.15	1.0
4-Methyl-2-pentanone (MIBK)	<5.0		0.92	5.0
Toluene	<1.0		0.18	1.0
trans-1,3-Dichloropropene	<1.0		0.16	1.0
1,1,2-Trichloroethane	<1.0		0.24	1.0
Tetrachloroethene	<1.0		0.18	1.0
1,3-Dichloropropane	<1.0		0.22	1.0
2-Hexanone	<5.0		0.99	5.0
Dibromochloromethane	<1.0		0.22	1.0
1,2-Dibromoethane	<1.0		0.33	1.0
Chlorobenzene	<1.0		0.15	1.0
1,1,1,2-Tetrachloroethane	<1.0		0.33	1.0
Ethylbenzene	<1.0		0.21	1.0
m&p-Xylene	<2.0		0.36	2.0
o-Xylene	<1.0		0.19	1.0

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Method Blank - Batch: 500-15097

Method: 8260B

Preparation: 5030B

Lab Sample ID: MB 500-15097/25
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/16/2007 1100
Date Prepared: 05/16/2007 1100

Analysis Batch: 500-15097
Prep Batch: N/A
Units: ug/L

Instrument ID: Agilent 6890N GC - 5973N
Lab File ID: 6M0516.D
Initial Weight/Volume: 10 mL
Final Weight/Volume: 10 mL

Analyte	Result	Qual	MDL	RL
Styrene	<1.0		0.18	1.0
Bromoform	<1.0		0.32	1.0
Isopropylbenzene	<1.0		0.20	1.0
Bromobenzene	<1.0		0.22	1.0
1,1,2,2-Tetrachloroethane	<1.0		0.34	1.0
1,2,3-Trichloropropane	<1.0		0.35	1.0
N-Propylbenzene	<1.0		0.16	1.0
2-Chlorotoluene	<1.0		0.16	1.0
1,3,5-Trimethylbenzene	<1.0		0.18	1.0
4-Chlorotoluene	<1.0		0.18	1.0
tert-Butylbenzene	<1.0		0.16	1.0
1,2,4-Trimethylbenzene	<1.0		0.26	1.0
sec-Butylbenzene	<1.0		0.19	1.0
1,3-Dichlorobenzene	<1.0		0.21	1.0
p-Isopropyltoluene	<1.0		0.29	1.0
1,4-Dichlorobenzene	<1.0		0.25	1.0
n-Butylbenzene	<1.0		0.35	1.0
1,2-Dichlorobenzene	<1.0		0.29	1.0
1,2-Dibromo-3-Chloropropane	<1.0		0.41	1.0
1,2,4-Trichlorobenzene	<1.0		0.36	1.0
Hexachlorobutadiene	<1.0		0.36	1.0
Naphthalene	<1.0		0.37	1.0
1,2,3-Trichlorobenzene	<1.0		0.43	1.0
Surrogate	% Rec		Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)	99		70 - 125	
Toluene-d8 (Surr)	92		75 - 120	
4-Bromofluorobenzene (Surr)	90		75 - 120	
Dibromofluoromethane	96		75 - 120	

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Lab Control Spike - Batch: 500-15097

Method: 8260B

Preparation: 5030B

Lab Sample ID: LCS 500-15097/26
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/16/2007 1123
Date Prepared: 05/16/2007 1123

Analysis Batch: 500-15097
Prep Batch: N/A
Units: ug/L

Instrument ID: Agilent 6890N GC - 5973N
Lab File ID: 6S0516.D
Initial Weight/Volume: 10 mL
Final Weight/Volume: 10 mL

Analyte	Spike Amount	Result	% Rec.	Limit	Qual
Benzene	25.0	22.0	88	68 - 120	
Dichlorodifluoromethane	25.0	21.7	87	21 - 178	
Chloromethane	25.0	22.7	91	50 - 140	
Vinyl chloride	25.0	23.7	95	57 - 135	
Bromomethane	25.0	26.9	108	61 - 172	
Chloroethane	25.0	27.3	109	56 - 152	
Trichlorofluoromethane	25.0	22.5	90	58 - 147	
1,1-Dichloroethene	25.0	19.0	76	50 - 121	
Carbon disulfide	25.0	12.5	50	33 - 120	
Acetone	25.0	11.5	46	22 - 175	
Methylene Chloride	25.0	22.3	89	52 - 126	
trans-1,2-Dichloroethene	25.0	21.9	87	57 - 122	
1,1-Dichloroethane	25.0	21.3	85	63 - 121	
2,2-Dichloropropane	25.0	22.0	88	56 - 134	
cis-1,2-Dichloroethene	25.0	23.9	96	62 - 127	
2-Butanone (MEK)	25.0	27.8	111	36 - 157	
Bromochloromethane	25.0	18.3	73	61 - 125	
Chloroform	25.0	22.1	88	65 - 127	
1,1,1-Trichloroethane	25.0	22.7	91	65 - 129	
1,1-Dichloropropene	25.0	21.0	84	62 - 122	
Carbon tetrachloride	25.0	22.1	88	67 - 121	
1,2-Dichloroethane	25.0	24.2	97	68 - 120	
Trichloroethene	25.0	21.9	88	73 - 120	
1,2-Dichloropropane	25.0	23.2	93	72 - 120	
Dibromomethane	25.0	24.4	98	71 - 120	
Bromodichloromethane	25.0	26.3	105	71 - 131	
cis-1,3-Dichloropropene	26.9	21.8	81	60 - 120	
4-Methyl-2-pentanone (MIBK)	25.0	29.3	117	65 - 128	
Toluene	25.0	25.6	102	75 - 120	
trans-1,3-Dichloropropene	24.3	20.5	84	61 - 120	
1,1,2-Trichloroethane	25.0	24.0	96	59 - 135	
Tetrachloroethene	25.0	21.3	85	65 - 120	
1,3-Dichloropropane	25.0	23.7	95	73 - 120	
2-Hexanone	25.0	25.9	104	54 - 139	
Dibromochloromethane	25.0	26.9	108	57 - 132	
1,2-Dibromoethane	25.0	23.6	94	68 - 125	
Chlorobenzene	25.0	23.4	94	75 - 120	
1,1,1,2-Tetrachloroethane	25.0	25.4	102	72 - 120	
Ethylbenzene	25.0	24.1	96	75 - 120	
m&p-Xylene	50.0	52.0	104	75 - 120	
o-Xylene	25.0	26.3	105	75 - 120	

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Lab Control Spike - Batch: 500-15097

Method: 8260B
Preparation: 5030B

Lab Sample ID: LCS 500-15097/26
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/16/2007 1123
Date Prepared: 05/16/2007 1123

Analysis Batch: 500-15097
Prep Batch: N/A
Units: ug/L

Instrument ID: Agilent 6890N GC - 5973N
Lab File ID: 6S0516.D
Initial Weight/Volume: 10 mL
Final Weight/Volume: 10 mL

Analyte	Spike Amount	Result	% Rec.	Limit	Qual
Styrene	25.0	26.0	104	77 - 120	
Bromoform	25.0	21.9	88	55 - 120	
Isopropylbenzene	25.0	21.2	85	68 - 120	
Bromobenzene	25.0	24.0	96	76 - 120	
1,1,2,2-Tetrachloroethane	25.0	23.3	93	68 - 120	
1,2,3-Trichloropropane	25.0	22.8	91	70 - 120	
N-Propylbenzene	25.0	25.5	102	74 - 120	
2-Chlorotoluene	25.0	24.8	99	74 - 120	
1,3,5-Trimethylbenzene	25.0	24.6	98	76 - 120	
4-Chlorotoluene	25.0	24.8	99	75 - 120	
tert-Butylbenzene	25.0	24.5	98	75 - 120	
1,2,4-Trimethylbenzene	25.0	24.3	97	76 - 120	
sec-Butylbenzene	25.0	21.9	87	73 - 120	
1,3-Dichlorobenzene	25.0	23.3	93	76 - 120	
p-Isopropyltoluene	25.0	22.6	90	71 - 120	
1,4-Dichlorobenzene	25.0	22.7	91	74 - 120	
n-Butylbenzene	25.0	26.7	107	68 - 120	
1,2-Dichlorobenzene	25.0	23.7	95	74 - 120	
1,2-Dibromo-3-Chloropropane	25.0	24.4	98	60 - 120	
1,2,4-Trichlorobenzene	25.0	24.0	96	63 - 120	
Hexachlorobutadiene	25.0	24.1	97	54 - 131	
Naphthalene	25.0	22.9	91	50 - 120	
1,2,3-Trichlorobenzene	25.0	24.4	98	62 - 120	
Surrogate		% Rec		Acceptance Limits	
1,2-Dichloroethane-d4 (Surr)		98		70 - 125	
Toluene-d8 (Surr)		95		75 - 120	
4-Bromofluorobenzene (Surr)		97		75 - 120	
Dibromofluoromethane		95		75 - 120	

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Matrix Spike/ Matrix Spike Duplicate Recovery Report - Batch: 500-15097

Method: 8260B

Preparation: 5030B

MS Lab Sample ID: 500-4050-28 Analysis Batch: 500-15097
 Client Matrix: Water Prep Batch: N/A
 Dilution: 1.0
 Date Analyzed: 05/16/2007 2117
 Date Prepared: 05/16/2007 2117

Instrument ID: Agilent 6890N GC - 5973I
 Lab File ID: 4050-28S.D
 Initial Weight/Volume: 10 mL
 Final Weight/Volume: 10 mL

MSD Lab Sample ID: 500-4050-28 Analysis Batch: 500-15097
 Client Matrix: Water Prep Batch: N/A
 Dilution: 1.0
 Date Analyzed: 05/16/2007 2140
 Date Prepared: 05/16/2007 2140

Instrument ID: Agilent 6890N GC - 5973N
 Lab File ID: 4050-28T.D
 Initial Weight/Volume: 10 mL
 Final Weight/Volume: 10 mL

Analyte	% Rec.		RPD	RPD Limit	MS Qual	MSD Qual
	MS	MSD				
Benzene	84	86	68 - 120	3	20	
Dichlorodifluoromethane	82	87	21 - 178	7	20	
Chloromethane	99	100	50 - 140	0	20	
Vinyl chloride	103	93	57 - 135	11	20	
Bromomethane	126	121	61 - 172	4	20	
Chloroethane	110	108	56 - 152	2	20	
Trichlorofluoromethane	92	88	58 - 147	5	20	
1,1-Dichloroethene	74	75	50 - 121	2	20	
Carbon disulfide	48	49	33 - 120	4	20	
Acetone	57	56	22 - 175	1	20	
Methylene Chloride	90	91	52 - 126	1	20	
trans-1,2-Dichloroethene	86	87	57 - 122	1	20	
1,1-Dichloroethane	88	89	63 - 121	1	20	
2,2-Dichloropropane	82	85	56 - 134	3	20	
cis-1,2-Dichloroethene	95	99	62 - 127	4	20	
2-Butanone (MEK)	108	74	36 - 157	38	20	F
Bromochloromethane	79	84	61 - 125	6	20	
Chloroform	93	94	65 - 127	2	20	
1,1,1-Trichloroethane	93	93	65 - 129	0	20	
1,1-Dichloropropene	83	83	62 - 122	0	20	
Carbon tetrachloride	83	84	67 - 121	0	20	
1,2-Dichloroethane	100	100	68 - 120	1	20	
Trichloroethene	80	81	73 - 120	1	20	
1,2-Dichloropropane	89	91	72 - 120	2	20	
Dibromomethane	97	93	71 - 120	4	20	
Bromodichloromethane	103	105	71 - 131	2	20	
cis-1,3-Dichloropropene	74	75	60 - 120	1	20	
4-Methyl-2-pentanone (MIBK)	113	119	65 - 128	6	20	
Toluene	97	98	75 - 120	1	20	

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Matrix Spike/ Matrix Spike Duplicate Recovery Report - Batch: 500-15097

Method: 8260B
Preparation: 5030B

MS Lab Sample ID:	500-4050-28	Analysis Batch:	500-15097	Instrument ID:	Agilent 6890N GC - 5973I
Client Matrix:	Water	Prep Batch:	N/A	Lab File ID:	4050-28S.D
Dilution:	1.0			Initial Weight/Volume:	10 mL
Date Analyzed:	05/16/2007 2117			Final Weight/Volume:	10 mL
Date Prepared:	05/16/2007 2117				
MSD Lab Sample ID:	500-4050-28	Analysis Batch:	500-15097	Instrument ID:	Agilent 6890N GC - 5973N
Client Matrix:	Water	Prep Batch:	N/A	Lab File ID:	4050-28T.D
Dilution:	1.0			Initial Weight/Volume:	10 mL
Date Analyzed:	05/16/2007 2140			Final Weight/Volume:	10 mL
Date Prepared:	05/16/2007 2140				

Analyte	% Rec.		Limit	RPD	RPD Limit	MS Qual	MSD Qual
	MS	MSD					
trans-1,3-Dichloropropene	80	82	61 - 120	3	20		
1,1,2-Trichloroethane	105	104	59 - 135	1	20		
Tetrachloroethene	77	78	65 - 120	1	20		
1,3-Dichloropropane	93	93	73 - 120	0	20		
2-Hexanone	107	103	54 - 139	4	20		
Dibromochloromethane	106	108	57 - 132	2	20		
1,2-Dibromoethane	92	97	68 - 125	5	20		
Chlorobenzene	90	90	75 - 120	0	20		
1,1,1,2-Tetrachloroethane	98	97	72 - 120	1	20		
Ethylbenzene	89	88	75 - 120	1	20		
m&p-Xylene	97	97	75 - 120	0	20		
o-Xylene	100	101	75 - 120	2	20		
Styrene	97	80	77 - 120	20	20		
Bromoform	89	87	55 - 120	2	20		
Isopropylbenzene	80	81	68 - 120	2	20		
Bromobenzene	95	96	76 - 120	1	20		
1,1,2,2-Tetrachloroethane	96	98	68 - 120	2	20		
1,2,3-Trichloropropane	97	98	70 - 120	1	20		
N-Propylbenzene	96	97	74 - 120	1	20		
2-Chlorotoluene	96	97	74 - 120	1	20		
1,3,5-Trimethylbenzene	92	92	76 - 120	1	20		
4-Chlorotoluene	95	96	75 - 120	1	20		
tert-Butylbenzene	94	95	75 - 120	1	20		
1,2,4-Trimethylbenzene	94	95	76 - 120	0	20		
sec-Butylbenzene	82	82	73 - 120	1	20		
1,3-Dichlorobenzene	90	90	76 - 120	0	20		
p-Isopropyltoluene	84	85	71 - 120	0	20		
1,4-Dichlorobenzene	88	89	74 - 120	1	20		
n-Butylbenzene	94	95	68 - 120	0	20		

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Matrix Spike/ Matrix Spike Duplicate Recovery Report - Batch: 500-15097

Method: 8260B
Preparation: 5030B

MS Lab Sample ID: 500-4050-28
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/16/2007 2117
Date Prepared: 05/16/2007 2117

Analysis Batch: 500-15097
Prep Batch: N/A

Instrument ID: Agilent 6890N GC - 5973I
Lab File ID: 4050-28S.D
Initial Weight/Volume: 10 mL
Final Weight/Volume: 10 mL

MSD Lab Sample ID: 500-4050-28
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/16/2007 2140
Date Prepared: 05/16/2007 2140

Analysis Batch: 500-15097
Prep Batch: N/A

Instrument ID: Agilent 6890N GC - 5973N
Lab File ID: 4050-28T.D
Initial Weight/Volume: 10 mL
Final Weight/Volume: 10 mL

Analyte	% Rec.		Limit	RPD	RPD Limit	MS Qual	MSD Qual
	MS	MSD					
1,2-Dichlorobenzene	95	95	74 - 120	1	20		
1,2-Dibromo-3-Chloropropane	99	102	60 - 120	3	20		
1,2,4-Trichlorobenzene	88	91	63 - 120	3	20		
Hexachlorobutadiene	85	87	54 - 131	3	20		
Naphthalene	91	96	50 - 120	5	20		
1,2,3-Trichlorobenzene	96	99	62 - 120	3	20		
Surrogate	MS % Rec		MSD % Rec		Acceptance Limits		
1,2-Dichloroethane-d4 (Surr)	103		104		70 - 125		
Toluene-d8 (Surr)	95		94		75 - 120		
4-Bromofluorobenzene (Surr)	95		94		75 - 120		
Dibromofluoromethane	103		101		75 - 120		

Calculations are performed before rounding to avoid round-off errors in calculated results.

SEVERN
TRENT

STL

STL Chicago
2417 Bond Street
University Park, IL 60466
Phone: 708-534-5200
Fax: 708-534-5211

Report To:		Bill To:		Shaded Areas For Internal Use Only / of 3	
Contact: <u>Greg Flasinski</u>	Company: <u>Wesler</u>	Contact: _____	Company: _____	Lab Lot# <u>500-4050</u>	Sample Sealed <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
Address: _____	Address: _____	Address: _____	Address: _____	Samples Sealed <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Received on Ice <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
Phone: <u>610.701.7243</u>	Fax: _____	Phone: _____	Fax: _____	Temperature °C of Cooler <u>40</u>	Sample Intact <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No
E-Mail: _____	PO#: _____	Quote: _____	Within Hold Time <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Preserv. Indicated <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No NA	
Sampler Name: <u>Greg Flasinski</u>	Signature: _____	Matrix # <u>HCl</u>	Volume <u>10ml</u>	pH Check OK <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No NA	Res Cl ₂ Check OK <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No NA
Project Name: <u>Black + Decker</u>	Project Number: <u>02501.004.004.0700</u>	Preserv. <u>HCl</u>	Comp/Grab <u>V</u>	Sample Labels and COC Agree <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No COC not present	
Project Location: <u>Hempstead MD</u>	Date Required	Matrix <u>W</u>	Comp/Grab <u>O</u>		
Lab RM: <u>Dick Wright</u>	Hard Copy: <u>/ /</u>	Time <u>5:35</u>	A		
Fax: <u>/ /</u>					
Laboratory ID	MS-MSD	Client Sample ID	Sampling Date Time		Additional Analyses / Remarks
1		RFW-1A	5/3	535	
2		RFW-1B	5/4	745	
3		RFW-2A	5/3	830	
4		RFW-2B	5/3	855	
5		RFW-3B	5/4	845	
6		RFW-4A	5/4	1120	
7		RFW-4R	5/4	1110	
8		RFW-4R Dup	5/4	1110	
9		RFW-6	5/4/07	800	
10		RFW-7	5/3/07	1330	
11		RFW-9	5/3/07	1800	
12		RFW-11B	5/4	1100	

RELINQUISHED BY	COMPANY	DATE	TIME	RECEIVED BY	COMPANY	DATE	TIME
<u>Wesler</u>		<u>5/4/07</u>	<u>1600</u>	<u>JLT</u>	<u>SL</u>	<u>5/5/07</u>	<u>0830</u>
RELINQUISHED BY	COMPANY	DATE	TIME	RECEIVED BY	COMPANY	DATE	TIME

Matrix Key
 WW = Wastewater
 W = Water
 S = Soil
 SL = Sludge
 MS = Miscellaneous
 OL = Oil
 A = Air

Container Key.
 SE = Sediment
 SO = Solid
 DS = Drum Solid
 DL = Drum Liquid
 L = Leachate
 WI = Wipe
 O =

Preservative Key
 1. Plastic
 2. VOA Vial
 3. Sterile Plastic
 4. Amber Glass
 5. Widemouth Glass
 6. Other
 7. None

COMMENTS	Date Received <u>5/5/07</u>
	Courier: <input checked="" type="checkbox"/> FX Hand Delivered <input type="checkbox"/>
	Bill of Lading <u>see attach</u>

SEVERN
TRENT

STL

STL Chicago
 2417 Bond Street
 University Park, IL 60466
 Phone: 708-534-5200
 Fax: 708-534-5211

Report To:		Bill To:		Shaded Areas For Internal Use Only <u>2</u> of <u>3</u>	
Contact:	Company:	Contact:	Company:		
Address: <i>Seepage</i>		Address:			
Phone:	Fax:	Phone:	Fax:		
E-Mail:		PO#:	Quote:		
				Lab Lot# <i>500-4050</i>	
				Packaged Sealed	Samples Sealed
				Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>
				Received on Ice	Samples Intact
				Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>
				Temperature °C of Container	

Sampler Name:		Signature:		Date	Time	Matrix	Comp/Grab	U	O	A	Within Hold Time	Preserv. Indicated
Project Name:		Project Number:		Date Required		Volume	Present				pH Check OK	Res Cl ₂ Check OK
Project Location:				Hard Copy:							Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA	Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> NA
Lab PW:		Fax:		Date							Sample Labels and COC Agree	
Laboratory ID	MS-MSD	Client Sample ID		Sampling Date	Time						Additional Analyses / Remarks	
13		RFW-12B		5/4	1400	W						
14		RFW-13		5/3/07	1610							
15		RFW-17		5/3	1255							
16		EW-2		5/4	1300							
17		EW-3		5/4	900							
18		EW-4		5/4	845							
19		EW-5		5/3	915							
20		EW-6		5/3/07	1430							
21		EW-7		5/3	1440							
22		EW-8		5/3	1520							
23		EW-9		5/3	1530							
24		EW-9 DUP		5/3	1530	+	+					

RELINQUISHED BY <i>[Signature]</i>	COMPANY <i>Wester</i>	DATE <i>5/4/07</i>	TIME <i>1600</i>	RECEIVED BY <i>JLT</i>	COMPANY <i>SN</i>	DATE <i>5/5/07</i>	TIME <i>0930</i>
RELINQUISHED BY	COMPANY	DATE	TIME	RECEIVED BY	COMPANY	DATE	TIME

Matrix Key
 WW = Wastewater
 W = Water
 S = Soil
 SL = Sludge
 MS = Miscellaneous
 OL = Oil
 A = Air

Container Key.
 SE = Sediment
 SO = Solid
 DS = Drum Solid
 DL = Drum Liquid
 L = Leachate
 WI = Wipe
 O =

Preservative Key
 1. Plastic
 2. VOA Vial
 3. Sterile Plastic
 4. Amber Glass
 5. Widemouth Glass
 6. Other
 7. None

Comments

Date Received *5/5/07*
Courier: *FX* **Hand Delivered**
Bill of Lading

SEVERN
TRENT

STL

STL Chicago
2417 Bond Street
University Park, IL 60466
Phone: 708-534-5200
Fax: 708-534-5211

~~RELINQUISHED BY~~

J. S. Johnson
COMPANY

5 DATE
467
DATE

11

RECEIVED BY

COMPANY
82
COMPANY

DATE 5/5/07 TIME 0930
DATE TIME

Matrix Key	Container Key.	Preservative Key	Comments	Date Received
WW = Wastewater	SE = Sediment	1. Plastic	1. HCl, Cool to 4°	5/5/07
W = Water	SO= Solid	2. VOA Vial	2. H2SO4, Cool to 4°	
S = Soil	DS = Drum Solid	3. Sterile Plastic	3. HNO3, Cool to 4°	
SL = Sludge	DL = Drum Liquid	4. Amber Glass	4. NaOH, Cool to 4°	
MS = Miscellaneous	L = Leachate	5. Widemouth Glass	5. NaOH/Zn, Cool to 4°	
OL = Oil	WI = Wipe	6. Other	6. Cool to 4°	
				Courier: <input checked="" type="checkbox"/> Hand Delivered <input type="checkbox"/>
				Bill of Lading

LOGIN SAMPLE RECEIPT CHECK LIST

Client: Weston Solutions, Inc.

Job Number: 500-4050-1

Login Number: 4050

Question	T/F/NA	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	4.0
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time.	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	

STL

ANALYTICAL REPORT

Job Number: 680-26461-1

Job Description: Black & Decker

For:

Weston Solutions, Inc.
1400 Weston Way
PO BOX 2653
West Chester, PA 19380

Attention: Mr. Tom Cornuet

Kathryn Smith

Kathryn Smith
Project Manager I
kesmith@stl-inc.com
05/17/2007

Project Manager: Abbie Page

The test results in this report meet all NELAP requirements for parameters for which accreditation is required or available. Any exceptions to NELAP requirements are noted in this report. Pursuant to NELAP, this report may not be reproduced, except in full, without the written approval of the laboratory. All questions regarding this report should be directed to the STL Project Manager who signed this report.

Severn Trent Laboratories, Inc.

STL Savannah 5102 LaRoche Avenue, Savannah, GA 31404
Tel (912) 354-7858 Fax (912) 351-3673 www.stl-inc.com



METHOD SUMMARY

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Description	Lab Location	Method	Preparation Method
Matrix: Water Purgeable Organic Compounds in Water by GC/MS	STL SAV	EPA-DW 524.2	

LAB REFERENCES:

STL SAV = STL Savannah

METHOD REFERENCES:

EPA-DW - "Methods For The Determination Of Organic Compounds In Drinking Water", EPA/600/4-88/039, December 1988 And Its Supplements.

SAMPLE SUMMARY

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Lab Sample ID	Client Sample ID	Client Matrix	Date/Time Sampled	Date/Time Received
680-26461-1	RFW-20	Water	05/03/2007 1830	05/05/2007 0900
680-26461-2	RFW-21	Water	05/03/2007 1200	05/05/2007 0900
680-26461-3	Hamp-22	Water	05/03/2007 1050	05/05/2007 0900
680-26461-4	Hamp-23	Water	05/03/2007 1055	05/05/2007 0900
680-26461-5TB	Trip Blank	Water	05/03/2007 0800	05/05/2007 0900

Analytical Data

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Client Sample ID: RFW-20

Lab Sample ID: 680-26461-1

Date Sampled: 05/03/2007 1830

Client Matrix: Water

Date Received: 05/05/2007 0900

524.2 Purgeable Organic Compounds in Water by GC/MS

Method:	524.2	Analysis Batch:	680-74702	Instrument ID:	GC/MS Volatiles - U
Preparation:	N/A			Lab File ID:	u4617.d
Dilution:	1.0			Initial Weight/Volume:	5 mL
Date Analyzed:	05/10/2007 1126			Final Weight/Volume:	5 mL
Date Prepared:	N/A				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Acetone	<10		5.0	10
Benzene	<0.50		0.20	0.50
Bromobenzene	<0.50		0.20	0.50
Bromoform	<0.50		0.26	0.50
Bromomethane	<1.0		0.50	1.0
Carbbn tetrachloride	<0.50		0.20	0.50
Chlorobenzene	<0.50		0.20	0.50
Chlorobromomethane	<0.50		0.20	0.50
Chlorodibromomethane	<0.50		0.23	0.50
Chloroethane	<1.0		0.50	1.0
Chloroform	<0.50		0.19	0.50
Chloromethane	<0.50		0.40	0.50
2-Chlorotoluene	<0.50		0.20	0.50
4-Chlorotoluene	<0.50		0.20	0.50
cis-1,2-Dichloroethene	<0.50		0.20	0.50
cis-1,3-Dichloropropene	<0.50		0.20	0.50
1,2-Dibromo-3-Chloropropane	<0.50		0.35	0.50
Dibromomethane	<0.50		0.20	0.50
1,2-Dichlorobenzene	<0.50		0.20	0.50
1,3-Dichlorobenzene	<0.50		0.20	0.50
1,4-Dichlorobenzene	<0.50		0.21	0.50
Dichlorobromomethane	<0.50		0.20	0.50
Dichlorodifluoromethane	<0.50		0.20	0.50
1,2-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethene	<0.50		0.22	0.50
1,3-Dichloropropane	<0.50		0.20	0.50
2,2-Dichloropropane	<0.50		0.36	0.50
1,2-Dichloropropane	<0.50		0.20	0.50
1,1-Dichloropropene	<0.50		0.20	0.50
1,3-Dichloropropene, Total	<0.50		0.20	0.50
Diisopropyl ether	<0.50		0.21	0.50
Ethylbenzene	<0.50		0.20	0.50
Ethylene Dibromide	<0.50		0.20	0.50
Freon 113	<0.50		0.33	0.50
Hexachlorobutadiene	<0.50		0.36	0.50
2-Hexanone	<10		5.0	10
Isopropylbenzene	<0.50		0.20	0.50
4-Isopropyltoluene	<0.50		0.22	0.50
Methylene Chloride	<0.50		0.30	0.50
Methyl Ethyl Ketone	<10		5.0	10
m-Isobutyl ketone	<10		5.0	10
m-Xylene & p-Xylene	<0.50		0.31	0.50

Analytical Data

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Client Sample ID: RFW-20

Lab Sample ID: 680-26461-1

Date Sampled: 05/03/2007 1830

Client Matrix: Water

Date Received: 05/05/2007 0900

524.2 Purgeable Organic Compounds in Water by GC/MS

Method:	524.2	Analysis Batch:	680-74702	Instrument ID:	GC/MS Volatiles - U
Preparation:	N/A			Lab File ID:	u4617.d
Dilution:	1.0			Initial Weight/Volume:	5 mL
Date Analyzed:	05/10/2007 1126			Final Weight/Volume:	5 mL
Date Prepared:	N/A				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Naphthalene	<1.0		0.24	1.0
n-Butylbenzene	<0.50		0.24	0.50
N-Propylbenzene	<0.50		0.20	0.50
o-Xylene	<0.50		0.21	0.50
sec-Butylbenzene	<0.50		0.20	0.50
Styrene	<0.50		0.21	0.50
Tert-amyl methyl ether	<0.50		0.32	0.50
tert-Butyl alcohol	<2.0		2.0	2.0
tert-Butylbenzene	<0.50		0.20	0.50
Tert-butyl ethyl ether	<0.50		0.31	0.50
1,1,2,2-Tetrachloroethane	<0.50		0.20	0.50
1,1,1,2-Tetrachloroethane	<0.50		0.20	0.50
Tetrachloroethene	<0.50		0.27	0.50
Toluene	<0.50		0.20	0.50
trans-1,2-Dichloroethene	<0.50		0.26	0.50
trans-1,3-Dichloropropene	<0.50		0.20	0.50
1,2,4-Trichlorobenzene	<0.50		0.33	0.50
1,2,3-Trichlorobenzene	<0.50		0.26	0.50
1,1,2-Trichloroethane	<0.50		0.20	0.50
1,1,1-Trichloroethane	<0.50		0.20	0.50
Trichloroethene	0.64		0.26	0.50
Trichlorofluoromethane	<0.50		0.20	0.50
1,2,3-Trichloropropane	<0.50		0.25	0.50
Trihalomethanes, Total	<0.50		0.26	0.50
1,2,4-Trimethylbenzene	<0.50		0.22	0.50
1,3,5-Trimethylbenzene	<0.50		0.20	0.50
Vinyl chloride	<0.50		0.20	0.50
Xylenes, Total	<0.50		0.31	0.50
Surrogate	%Rec		Acceptance Limits	
4-Bromofluorobenzene	95		70 - 130	
1,2-Dichlorobenzene-d4	88		70 - 130	

Analytical Data

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Client Sample ID: RFW-21

Lab Sample ID: 680-26461-2

Date Sampled: 05/03/2007 1200

Client Matrix: Water

Date Received: 05/05/2007 0900

524.2 Purgeable Organic Compounds in Water by GC/MS

Method:	524.2	Analysis Batch:	680-74702	Instrument ID:	GC/MS Volatiles - U
Preparation:	N/A			Lab File ID:	u4618.d
Dilution:	1.0			Initial Weight/Volume:	5 mL
Date Analyzed:	05/10/2007 1145			Final Weight/Volume:	5 mL
Date Prepared:	N/A				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Acetone	<10		5.0	10
Benzene	<0.50		0.20	0.50
Bromobenzene	<0.50		0.20	0.50
Bromoform	<0.50		0.26	0.50
Bromomethane	<1.0		0.50	1.0
Carbon tetrachloride	<0.50		0.20	0.50
Chlorobenzene	<0.50		0.20	0.50
Chlorobromomethane	<0.50		0.20	0.50
Chlorodibromomethane	<0.50		0.23	0.50
Chloroethane	<1.0		0.50	1.0
Chloroform	<0.50		0.19	0.50
Chloromethane	<0.50		0.40	0.50
2-Chlorotoluene	<0.50		0.20	0.50
4-Chlorotoluene	<0.50		0.20	0.50
cis-1,2-Dichloroethene	<0.50		0.20	0.50
cis-1,3-Dichloropropene	<0.50		0.20	0.50
1,2-Dibromo-3-Chloropropane	<0.50		0.35	0.50
Dibromomethane	<0.50		0.20	0.50
1,2-Dichlorobenzene	<0.50		0.20	0.50
1,3-Dichlorobenzene	<0.50		0.20	0.50
1,4-Dichlorobenzene	<0.50		0.21	0.50
Dichlorobromomethane	<0.50		0.20	0.50
Dichlorodifluoromethane	<0.50		0.20	0.50
1,2-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethene	<0.50		0.22	0.50
1,3-Dichloropropane	<0.50		0.20	0.50
2,2-Dichloropropane	<0.50		0.36	0.50
1,2-Dichloropropane	<0.50		0.20	0.50
1,1-Dichloropropene	<0.50		0.20	0.50
1,3-Dichloropropene, Total	<0.50		0.20	0.50
Diisopropyl ether	<0.50		0.21	0.50
Ethylbenzene	<0.50		0.20	0.50
Ethylene Dibromide	<0.50		0.20	0.50
Freon 113	<0.50		0.33	0.50
Hexachlorobutadiene	<0.50		0.36	0.50
2-Hexanone	<10		5.0	10
Isopropylbenzene	<0.50		0.20	0.50
4-Isopropyltoluene	<0.50		0.22	0.50
Methylene Chloride	<0.50		0.30	0.50
Methyl Ethyl Ketone	<10		5.0	10
methyl isobutyl ketone	<10		5.0	10
m-Xylene & p-Xylene	<0.50		0.31	0.50

Analytical Data

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Client Sample ID: RFW-21

Lab Sample ID: 680-26461-2

Date Sampled: 05/03/2007 1200

Client Matrix: Water

Date Received: 05/05/2007 0900

524.2 Purgeable Organic Compounds in Water by GC/MS

Method:	524.2	Analysis Batch:	680-74702	Instrument ID:	GC/MS Volatiles - U
Preparation:	N/A			Lab File ID:	u4618.d
Dilution:	1.0			Initial Weight/Volume:	5 mL
Date Analyzed:	05/10/2007 1145			Final Weight/Volume:	5 mL
Date Prepared:	N/A				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Naphthalene	<1.0		0.24	1.0
n-Butylbenzene	<0.50		0.24	0.50
N-Propylbenzene	<0.50		0.20	0.50
o-Xylene	<0.50		0.21	0.50
sec-Butylbenzene	<0.50		0.20	0.50
Styrene	<0.50		0.21	0.50
Tert-amyl methyl ether	<0.50		0.32	0.50
tert-Butyl alcohol	<2.0		2.0	2.0
tert-Butylbenzene	<0.50		0.20	0.50
Tert-butyl ethyl ether	<0.50		0.31	0.50
1,1,2,2-Tetrachloroethane	<0.50		0.20	0.50
1,1,1,2-Tetrachloroethane	<0.50		0.20	0.50
Tetrachloroethylene	<0.50		0.27	0.50
Toluene	<0.50		0.20	0.50
trans-1,2-Dichloroethene	<0.50		0.26	0.50
trans-1,3-Dichloropropene	<0.50		0.20	0.50
1,2,4-Trichlorobenzene	<0.50		0.33	0.50
1,2,3-Trichlorobenzene	<0.50		0.26	0.50
1,1,2-Trichloroethane	<0.50		0.20	0.50
1,1,1-Trichloroethane	<0.50		0.20	0.50
Trichloroethylene	<0.50		0.26	0.50
Trichlorofluoromethane	<0.50		0.20	0.50
1,2,3-Trichloropropane	<0.50		0.25	0.50
Trihalomethanes, Total	<0.50		0.26	0.50
1,2,4-Trimethylbenzene	<0.50		0.22	0.50
1,3,5-Trimethylbenzene	<0.50		0.20	0.50
Vinyl chloride	<0.50		0.20	0.50
Xylenes, Total	<0.50		0.31	0.50
Surrogate	%Rec	Acceptance Limits		
4-Bromofluorobenzene	93	70 - 130		
1,2-Dichlorobenzene-d4	88	70 - 130		

Analytical Data

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Client Sample ID: **Hamp-22**

Lab Sample ID: 680-26461-3

Date Sampled: 05/03/2007 1050

Client Matrix: Water

Date Received: 05/05/2007 0900

524.2 Purgeable Organic Compounds in Water by GC/MS

Method:	524.2	Analysis Batch:	680-74702	Instrument ID:	GC/MS Volatiles - U
Preparation:	N/A			Lab File ID:	u4619.d
Dilution:	1.0			Initial Weight/Volume:	5 mL
Date Analyzed:	05/10/2007 1207			Final Weight/Volume:	5 mL
Date Prepared:	N/A				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Acetone	<10		5.0	10
Benzene	<0.50		0.20	0.50
Bromobenzene	<0.50		0.20	0.50
Bromoform	<0.50		0.26	0.50
Bromomethane	<1.0		0.50	1.0
Carbon tetrachloride	<0.50		0.20	0.50
Chlorobenzene	<0.50		0.20	0.50
Chlorobromomethane	<0.50		0.20	0.50
Chlorodibromomethane	<0.50		0.23	0.50
Chloroethane	<1.0		0.50	1.0
Chloroform	<0.50		0.19	0.50
Chloromethane	<0.50		0.40	0.50
2-Chlorotoluene	<0.50		0.20	0.50
4-Chlorotoluene	<0.50		0.20	0.50
cis-1,2-Dichloroethene	<0.50		0.20	0.50
cis-1,3-Dichloropropene	<0.50		0.20	0.50
1,2-Dibromo-3-Chloropropane	<0.50		0.35	0.50
Dibromomethane	<0.50		0.20	0.50
1,2-Dichlorobenzene	<0.50		0.20	0.50
1,3-Dichlorobenzene	<0.50		0.20	0.50
1,4-Dichlorobenzene	<0.50		0.21	0.50
Dichlorobromomethane	<0.50		0.20	0.50
Dichlorodifluoromethane	<0.50		0.20	0.50
1,2-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethene	<0.50		0.22	0.50
1,3-Dichloropropane	<0.50		0.20	0.50
2,2-Dichloropropane	<0.50		0.36	0.50
1,2-Dichloropropane	<0.50		0.20	0.50
1,1-Dichloropropene	<0.50		0.20	0.50
1,3-Dichloropropene, Total	<0.50		0.20	0.50
Diisopropyl ether	<0.50		0.21	0.50
Ethylbenzene	<0.50		0.20	0.50
Ethylene Dibromide	<0.50		0.20	0.50
Freon 113	<0.50		0.33	0.50
Hexachlorobutadiene	<0.50		0.36	0.50
2-Hexanone	<10		5.0	10
Isopropylbenzene	<0.50		0.20	0.50
4-Isopropyltoluene	<0.50		0.22	0.50
Methylene Chloride	<0.50		0.30	0.50
Methyl Ethyl Ketone	<10		5.0	10
m-isobutyl ketone	<10		5.0	10
m-Xylene & p-Xylene	<0.50		0.31	0.50

Analytical Data

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Client Sample ID: Hamp-22

Lab Sample ID: 680-26461-3

Client Matrix: Water

Date Sampled: 05/03/2007 1050

Date Received: 05/05/2007 0900

524.2 Purgeable Organic Compounds in Water by GC/MS

Method:	524.2	Analysis Batch: 680-74702	Instrument ID:	GC/MS Volatiles - U
Preparation:	N/A		Lab File ID:	u4619.d
Dilution:	1.0		Initial Weight/Volume:	5 mL
Date Analyzed:	05/10/2007 1207		Final Weight/Volume:	5 mL
Date Prepared:	N/A			

Analyte	Result (ug/L)	Qualifier	MDL	RL
Naphthalene	<1.0		0.24	1.0
n-Butylbenzene	<0.50		0.24	0.50
N-Propylbenzene	<0.50		0.20	0.50
o-Xylene	<0.50		0.21	0.50
sec-Butylbenzene	<0.50		0.20	0.50
Styrene	<0.50		0.21	0.50
Tert-amyl methyl ether	<0.50		0.32	0.50
tert-Butyl alcohol	<2.0		2.0	2.0
tert-Butylbenzene	<0.50		0.20	0.50
Tert-butyl ethyl ether	<0.50		0.31	0.50
1,1,2,2-Tetrachloroethane	<0.50		0.20	0.50
1,1,1,2-Tetrachloroethane	<0.50		0.20	0.50
Tetrachloroethene	<0.50		0.27	0.50
Toluene	<0.50		0.20	0.50
trans-1,2-Dichloroethene	<0.50		0.26	0.50
trans-1,3-Dichloropropene	<0.50		0.20	0.50
1,2,4-Trichlorobenzene	<0.50		0.33	0.50
1,2,3-Trichlorobenzene	<0.50		0.26	0.50
1,1,2-Trichloroethane	<0.50		0.20	0.50
1,1,1-Trichloroethane	<0.50		0.20	0.50
Trichloroethene	<0.50		0.26	0.50
Trichlorofluoromethane	<0.50		0.20	0.50
1,2,3-Trichloropropane	<0.50		0.25	0.50
Trihalomethanes, Total	<0.50		0.26	0.50
1,2,4-Trimethylbenzene	<0.50		0.22	0.50
1,3,5-Trimethylbenzene	<0.50		0.20	0.50
Vinyl chloride	<0.50		0.20	0.50
Xylenes, Total	<0.50		0.31	0.50
Surrogate	%Rec	Acceptance Limits		
4-Bromofluorobenzene	94	70 - 130		
1,2-Dichlorobenzene-d4	88	70 - 130		

Analytical Data

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Client Sample ID: Hamp-23

Lab Sample ID: 680-26461-4

Date Sampled: 05/03/2007 1055

Client Matrix: Water

Date Received: 05/05/2007 0900

524.2 Purgeable Organic Compounds in Water by GC/MS

Method:	524.2	Analysis Batch:	680-74702	Instrument ID:	GC/MS Volatiles - U
Preparation:	N/A			Lab File ID:	u4620.d
Dilution:	1.0			Initial Weight/Volume:	5 mL
Date Analyzed:	05/10/2007 1226			Final Weight/Volume:	5 mL
Date Prepared:	N/A				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Acetone	6.6	J	5.0	10
Benzene	<0.50		0.20	0.50
Bromobenzene	<0.50		0.20	0.50
Bromoform	<0.50		0.26	0.50
Bromomethane	<1.0		0.50	1.0
Carbon tetrachloride	<0.50		0.20	0.50
Chlorobenzene	<0.50		0.20	0.50
Chlorobromomethane	<0.50		0.20	0.50
Chlorodibromomethane	<0.50		0.23	0.50
Chloroethane	<1.0		0.50	1.0
Chloroform	<0.50		0.19	0.50
Chloromethane	<0.50		0.40	0.50
2-Chlorotoluene	<0.50		0.20	0.50
4-Chlorotoluene	<0.50		0.20	0.50
cis-1,2-Dichloroethene	<0.50		0.20	0.50
cis-1,3-Dichloropropene	<0.50		0.20	0.50
1,2-Dibromo-3-Chloropropane	<0.50		0.35	0.50
Dibromomethane	<0.50		0.20	0.50
1,2-Dichlorobenzene	<0.50		0.20	0.50
1,3-Dichlorobenzene	<0.50		0.20	0.50
1,4-Dichlorobenzene	<0.50		0.21	0.50
Dichlorobromomethane	<0.50		0.20	0.50
Dichlorodifluoromethane	<0.50		0.20	0.50
1,2-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethene	<0.50		0.22	0.50
1,3-Dichloropropane	<0.50		0.20	0.50
2,2-Dichloropropane	<0.50		0.36	0.50
1,2-Dichloropropane	<0.50		0.20	0.50
1,1-Dichloropropene	<0.50		0.20	0.50
1,3-Dichloropropene, Total	<0.50		0.20	0.50
Diisopropyl ether	<0.50		0.21	0.50
Ethylbenzene	<0.50		0.20	0.50
Ethylene Dibromide	<0.50		0.20	0.50
Freon 113	<0.50		0.33	0.50
Hexachlorobutadiene	<0.50		0.36	0.50
2-Hexanone	<10		5.0	10
Isopropylbenzene	<0.50		0.20	0.50
4-Isopropyltoluene	<0.50		0.22	0.50
Methylene Chloride	<0.50		0.30	0.50
Methyl Ethyl Ketone	<10		5.0	10
m-isobutyl ketone	<10		5.0	10
m-Xylene & p-Xylene	<0.50		0.31	0.50

Analytical Data

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Client Sample ID: Hamp-23

Lab Sample ID: 680-26461-4

Client Matrix: Water

Date Sampled: 05/03/2007 1055

Date Received: 05/05/2007 0900

524.2 Purgeable Organic Compounds in Water by GC/MS

Method:	524.2	Analysis Batch:	680-74702	Instrument ID:	GC/MS Volatiles - U
Preparation:	N/A			Lab File ID:	u4620.d
Dilution:	1.0			Initial Weight/Volume:	5 mL
Date Analyzed:	05/10/2007 1226			Final Weight/Volume:	5 mL
Date Prepared:	N/A				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Naphthalene	<1.0		0.24	1.0
n-Butylbenzene	<0.50		0.24	0.50
N-Propylbenzene	<0.50		0.20	0.50
o-Xylene	<0.50		0.21	0.50
sec-Butylbenzene	<0.50		0.20	0.50
Styrene	<0.50		0.21	0.50
Tert-amyl methyl ether	<0.50		0.32	0.50
tert-Butyl alcohol	<2.0		2.0	2.0
tert-Butylbenzene	<0.50		0.20	0.50
Tert-butyl ethyl ether	<0.50		0.31	0.50
1,1,2,2-Tetrachloroethane	<0.50		0.20	0.50
1,1,1,2-Tetrachloroethane	<0.50		0.20	0.50
Tetrachloroethene	<0.50		0.27	0.50
Toluene	<0.50		0.20	0.50
trans-1,2-Dichloroethene	<0.50		0.26	0.50
trans-1,3-Dichloropropene	<0.50		0.20	0.50
1,2,4-Trichlorobenzene	<0.50		0.33	0.50
1,2,3-Trichlorobenzene	<0.50		0.26	0.50
1,1,2-Trichloroethane	<0.50		0.20	0.50
1,1,1-Trichloroethane	<0.50		0.20	0.50
Trichloroethene	<0.50		0.26	0.50
Trichlorofluoromethane	<0.50		0.20	0.50
1,2,3-Trichloropropane	<0.50		0.25	0.50
Trihalomethanes, Total	<0.50		0.26	0.50
1,2,4-Trimethylbenzene	<0.50		0.22	0.50
1,3,5-Trimethylbenzene	<0.50		0.20	0.50
Vinyl chloride	<0.50		0.20	0.50
Xylenes, Total	<0.50		0.31	0.50
Surrogate	%Rec	Acceptance Limits		
4-Bromofluorobenzene	92	70 - 130		
1,2-Dichlorobenzene-d4	89	70 - 130		

Analytical Data

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Client Sample ID: **Trip Blank**Lab Sample ID: 680-26461-5TB
Client Matrix: WaterDate Sampled: 05/03/2007 0800
Date Received: 05/05/2007 0900**524.2 Purgeable Organic Compounds in Water by GC/MS**

Method:	524.2	Analysis Batch:	680-74702	Instrument ID:	GC/MS Volatiles - U
Preparation:	N/A			Lab File ID:	u4616.d
Dilution:	1.0			Initial Weight/Volume:	5 mL
Date Analyzed:	05/10/2007 1106			Final Weight/Volume:	5 mL
Date Prepared:	N/A				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Acetone	<10		5.0	10
Benzene	<0.50		0.20	0.50
Bromobenzene	<0.50		0.20	0.50
Bromoform	<0.50		0.26	0.50
Bromomethane	<1.0		0.50	1.0
Carbon tetrachloride	<0.50		0.20	0.50
Chlorobenzene	<0.50		0.20	0.50
Chlorobromomethane	<0.50		0.20	0.50
Chlorodibromomethane	<0.50		0.23	0.50
Chloroethane	<1.0		0.50	1.0
Chloroform	<0.50		0.19	0.50
Chloromethane	<0.50		0.40	0.50
2-Chlorotoluene	<0.50		0.20	0.50
4-Chlorotoluene	<0.50		0.20	0.50
cis-1,2-Dichloroethene	<0.50		0.20	0.50
cis-1,3-Dichloropropene	<0.50		0.20	0.50
1,2-Dibromo-3-Chloropropane	<0.50		0.35	0.50
Dibromomethane	<0.50		0.20	0.50
1,2-Dichlorobenzene	<0.50		0.20	0.50
1,3-Dichlorobenzene	<0.50		0.20	0.50
1,4-Dichlorobenzene	<0.50		0.21	0.50
Dichlorobromomethane	<0.50		0.20	0.50
Dichlorodifluoromethane	<0.50		0.20	0.50
1,2-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethene	<0.50		0.22	0.50
1,3-Dichloropropane	<0.50		0.20	0.50
2,2-Dichloropropane	<0.50		0.36	0.50
1,2-Dichloropropane	<0.50		0.20	0.50
1,1-Dichloropropene	<0.50		0.20	0.50
1,3-Dichloropropene, Total	<0.50		0.20	0.50
Diisopropyl ether	<0.50		0.21	0.50
Ethylbenzene	<0.50		0.20	0.50
Ethylene Dibromide	<0.50		0.20	0.50
Freon 113	<0.50		0.33	0.50
Hexachlorobutadiene	<0.50		0.36	0.50
2-Hexanone	<10		5.0	10
Isopropylbenzene	<0.50		0.20	0.50
4-Isopropyltoluene	<0.50		0.22	0.50
Methylene Chloride	0.64		0.30	0.50
Methyl Ethyl Ketone	<10		5.0	10
m-isobutyl ketone	<10		5.0	10
m-Xylene & p-Xylene	<0.50		0.31	0.50

Analytical Data

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Client Sample ID: Trip Blank

Lab Sample ID: 680-26461-5TB

Date Sampled: 05/03/2007 0800

Client Matrix: Water

Date Received: 05/05/2007 0900

524.2 Purgeable Organic Compounds in Water by GC/MS

Method:	524.2	Analysis Batch:	680-74702	Instrument ID:	GC/MS Volatiles - U
Preparation:	N/A			Lab File ID:	u4616.d
Dilution:	1.0			Initial Weight/Volume:	5 mL
Date Analyzed:	05/10/2007 1106			Final Weight/Volume:	5 mL
Date Prepared:	N/A				

Analyte	Result (ug/L)	Qualifier	MDL	RL
Naphthalene	<1.0		0.24	1.0
n-Butylbenzene	<0.50		0.24	0.50
N-Propylbenzene	<0.50		0.20	0.50
o-Xylene	<0.50		0.21	0.50
sec-Butylbenzene	<0.50		0.20	0.50
Styrene	<0.50		0.21	0.50
Tert-amyl methyl ether	<0.50		0.32	0.50
tert-Butyl alcohol	<2.0		2.0	2.0
tert-Butylbenzene	<0.50		0.20	0.50
Tert-butyl ethyl ether	<0.50		0.31	0.50
1,1,2,2-Tetrachloroethane	<0.50		0.20	0.50
1,1,1,2-Tetrachloroethane	<0.50		0.20	0.50
Tetrachloroethene	<0.50		0.27	0.50
Toluene	<0.50		0.20	0.50
trans-1,2-Dichloroethene	<0.50		0.26	0.50
trans-1,3-Dichloropropene	<0.50		0.20	0.50
1,2,4-Trichlorobenzene	<0.50		0.33	0.50
1,2,3-Trichlorobenzene	<0.50		0.26	0.50
1,1,2-Trichloroethane	<0.50		0.20	0.50
1,1,1-Trichloroethane	<0.50		0.20	0.50
Trichloroethene	<0.50		0.26	0.50
Trichlorofluoromethane	<0.50		0.20	0.50
1,2,3-Trichloropropane	<0.50		0.25	0.50
Trihalomethanes, Total	<0.50		0.26	0.50
1,2,4-Trimethylbenzene	<0.50		0.22	0.50
1,3,5-Trimethylbenzene	<0.50		0.20	0.50
Vinyl chloride	<0.50		0.20	0.50
Xylenes, Total	<0.50		0.31	0.50
Surrogate	%Rec	Acceptance Limits		
4-Bromofluorobenzene	91	70 - 130		
1,2-Dichlorobenzene-d4	85	70 - 130		

DATA REPORTING QUALIFIERS

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Lab Section	Qualifier	Description
GC/MS VOA	J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Surrogate Recovery Report**524.2 Purgeable Organic Compounds in Water by GC/MS****Client Matrix: Water**

Lab Sample ID	Client Sample ID	(BFB) (%Rec)	(DCB) (%Rec)
LCS 680-74702/4		99	96
MB 680-74702/5		92	88
680-26461-1	RFW-20	95	88
680-26461-2	RFW-21	93	88
680-26461-3	Hamp-22	94	88
680-26461-4	Hamp-23	92	89
680-26461-5	Trip Blank	91	85

Surrogate	Acceptance Limits
(BFB)	4-Bromofluorobenzene
(DCB)	1,2-Dichlorobenzene-d4

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Method Blank - Batch: 680-74702

Method: 524.2

Preparation: N/A

Lab Sample ID: MB 680-74702/5
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/10/2007 1000
Date Prepared: N/A

Analysis Batch: 680-74702
Prep Batch: N/A
Units: ug/L

Instrument ID: GC/MS Volatiles - U
Lab File ID: uq1759.d
Initial Weight/Volume: 5 mL
Final Weight/Volume: 5 mL

Analyte	Result	Qual	MDL	RL
Acetone	<10		5.0	10
Benzene	<0.50		0.20	0.50
Bromobenzene	<0.50		0.20	0.50
Bromoform	<0.50		0.26	0.50
Bromomethane	<1.0		0.50	1.0
Carbon tetrachloride	<0.50		0.20	0.50
Chlorobenzene	<0.50		0.20	0.50
Chlorobromomethane	<0.50		0.20	0.50
Chlorodibromomethane	<0.50		0.23	0.50
Chloroethane	<1.0		0.50	1.0
Chloroform	<0.50		0.19	0.50
Chloromethane	<0.50		0.40	0.50
4-Chlorotoluene	<0.50		0.20	0.50
2-Chlorotoluene	<0.50		0.20	0.50
cis-1,2-Dichloroethene	<0.50		0.20	0.50
cis-1,3-Dichloropropene	<0.50		0.20	0.50
1,2-Dibromo-3-Chloropropane	<0.50		0.35	0.50
Dibromomethane	<0.50		0.20	0.50
1,4-Dichlorobenzene	<0.50		0.21	0.50
1,3-Dichlorobenzene	<0.50		0.20	0.50
1,2-Dichlorobenzene	<0.50		0.20	0.50
Dichlorobromomethane	<0.50		0.20	0.50
Dichlorodifluoromethane	<0.50		0.20	0.50
1,2-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethane	<0.50		0.20	0.50
1,1-Dichloroethene	<0.50		0.22	0.50
1,3-Dichloropropane	<0.50		0.20	0.50
2,2-Dichloropropane	<0.50		0.36	0.50
1,2-Dichloropropane	<0.50		0.20	0.50
1,1-Dichloropropene	<0.50		0.20	0.50
1,3-Dichloropropene, Total	<0.50		0.20	0.50
Diisopropyl ether	<0.50		0.21	0.50
Ethylbenzene	<0.50		0.20	0.50
Ethylene Dibromide	<0.50		0.20	0.50
Freon 113	<0.50		0.33	0.50
Hexachlorobutadiene	<0.50		0.36	0.50
2-Hexanone	<10		5.0	10
Isopropylbenzene	<0.50		0.20	0.50
4-Isopropyltoluene	<0.50		0.22	0.50
Methylene Chloride	<0.50		0.30	0.50
Methyl Ethyl Ketone	<10		5.0	10

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Method Blank - Batch: 680-74702

Method: 524.2

Preparation: N/A

Lab Sample ID: MB 680-74702/5
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/10/2007 1000
Date Prepared: N/A

Analysis Batch: 680-74702
Prep Batch: N/A
Units: ug/L

Instrument ID: GC/MS Volatiles - U
Lab File ID: uq1759.d
Initial Weight/Volume: 5 mL
Final Weight/Volume: 5 mL

Analyte	Result	Qual	MDL	RL
methyl isobutyl ketone	<10		5.0	10
m-Xylene & p-Xylene	<0.50		0.31	0.50
Naphthalene	<1.0		0.24	1.0
n-Butylbenzene	<0.50		0.24	0.50
N-Propylbenzene	<0.50		0.20	0.50
o-Xylene	<0.50		0.21	0.50
sec-Butylbenzene	<0.50		0.20	0.50
Styrene	<0.50		0.21	0.50
Tert-amyl methyl ether	<0.50		0.32	0.50
tert-Butyl alcohol	<2.0		2.0	2.0
tert-Butylbenzene	<0.50		0.20	0.50
Tert-butyl ethyl ether	<0.50		0.31	0.50
1,1,1,2-Tetrachloroethane	<0.50		0.20	0.50
1,1,2,2-Tetrachloroethane	<0.50		0.20	0.50
Tetrachloroethene	<0.50		0.27	0.50
Toluene	<0.50		0.20	0.50
trans-1,2-Dichloroethene	<0.50		0.26	0.50
trans-1,3-Dichloropropene	<0.50		0.20	0.50
1,2,4-Trichlorobenzene	<0.50		0.33	0.50
1,2,3-Trichlorobenzene	<0.50		0.26	0.50
1,1,1-Trichloroethane	<0.50		0.20	0.50
1,1,2-Trichloroethane	<0.50		0.20	0.50
Trichloroethene	<0.50		0.26	0.50
Trichlorofluoromethane	<0.50		0.20	0.50
1,2,3-Trichloropropane	<0.50		0.25	0.50
Trihalomethanes, Total	<0.50		0.26	0.50
1,3,5-Trimethylbenzene	<0.50		0.20	0.50
1,2,4-Trimethylbenzene	<0.50		0.22	0.50
Vinyl chloride	<0.50		0.20	0.50
Xylenes, Total	<0.50		0.31	0.50
Surrogate	% Rec	Acceptance Limits		
4-Bromofluorobenzene	92	70 - 130		
1,2-Dichlorobenzene-d4	88	70 - 130		

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Lab Control Spike - Batch: 680-74702

Method: 524.2

Preparation: N/A

Lab Sample ID: LCS 680-74702/4
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/10/2007 0921
Date Prepared: N/A

Analysis Batch: 680-74702
Prep Batch: N/A
Units: ug/L

Instrument ID: GC/MS Volatiles - U
Lab File ID: uq1758.d
Initial Weight/Volume: 5 mL
Final Weight/Volume: 5 mL

Analyte	Spike Amount	Result	% Rec.	Limit	Qual
Acetone	40.0	37.1	93	70 - 130	
Benzene	20.0	18.3	91	70 - 130	
Bromobenzene	20.0	17.8	89	70 - 130	
Bromoform	20.0	17.5	87	70 - 130	
Bromomethane	20.0	20.8	104	70 - 130	
Carbon tetrachloride	20.0	17.3	87	70 - 130	
Chlorobenzene	20.0	17.7	89	70 - 130	
Chlorobromomethane	20.0	17.6	88	70 - 130	
Chlorodibromomethane	20.0	17.9	90	70 - 130	
Chloroethane	20.0	24.8	124	70 - 130	
Chloroform	20.0	18.0	90	70 - 130	
Chloromethane	20.0	17.9	89	70 - 130	
2-Chlorotoluene	20.0	21.0	105	70 - 130	
4-Chlorotoluene	20.0	18.8	94	70 - 130	
cis-1,2-Dichloroethene	20.0	18.3	91	70 - 130	
cis-1,3-Dichloropropene	20.0	19.1	95	70 - 130	
1,2-Dibromo-3-Chloropropane	20.0	16.7	83	70 - 130	
Dibromomethane	20.0	18.0	90	70 - 130	
1,2-Dichlorobenzene	20.0	18.1	91	70 - 130	
1,3-Dichlorobenzene	20.0	18.1	91	70 - 130	
1,4-Dichlorobenzene	20.0	18.5	93	70 - 130	
Dichlorobromomethane	20.0	18.9	95	70 - 130	
Dichlorodifluoromethane	20.0	17.0	85	70 - 130	
1,1-Dichloroethane	20.0	18.2	91	70 - 130	
1,2-Dichloroethane	20.0	19.2	96	70 - 130	
1,1-Dichloroethene	20.0	21.3	107	70 - 130	
1,2-Dichloropropane	20.0	18.8	94	70 - 130	
1,3-Dichloropropane	20.0	17.9	90	70 - 130	
2,2-Dichloropropane	20.0	17.7	88	70 - 130	
1,1-Dichloropropene	20.0	19.3	97	70 - 130	
1,3-Dichloropropene, Total	40.0	37.9	95	70 - 130	
Diisopropyl ether	16.0	15.6	97	70 - 130	
Ethylbenzene	20.0	18.8	94	70 - 130	
Ethylene Dibromide	20.0	17.6	88	70 - 130	
Freon 113	16.0	18.2	114	70 - 130	
Hexachlorobutadiene	20.0	18.9	94	70 - 130	
2-Hexanone	40.0	36.9	92	70 - 130	
Isopropylbenzene	20.0	18.4	92	70 - 130	
4-Isopropyltoluene	20.0	19.5	97	70 - 130	
Methylene Chloride	20.0	17.9	89	70 - 130	
Methyl Ethyl Ketone	40.0	38.3	96	70 - 130	

Calculations are performed before rounding to avoid round-off errors in calculated results.

Quality Control Results

Client: Weston Solutions, Inc.

Job Number: 680-26461-1

Lab Control Spike - Batch: 680-74702

Method: 524.2

Preparation: N/A

Lab Sample ID: LCS 680-74702/4
Client Matrix: Water
Dilution: 1.0
Date Analyzed: 05/10/2007 0921
Date Prepared: N/A

Analysis Batch: 680-74702
Prep Batch: N/A
Units: ug/L

Instrument ID: GC/MS Volatiles - U
Lab File ID: uq1758.d
Initial Weight/Volume: 5 mL
Final Weight/Volume: 5 mL

Analyte	Spike Amount	Result	% Rec.	Limit	Qual
methyl isobutyl ketone	40.0	38.5	96	70 - 130	
m-Xylene & p-Xylene	40.0	37.0	92	70 - 130	
Naphthalene	20.0	17.0	85	70 - 130	
n-Butylbenzene	20.0	19.9	99	70 - 130	
N-Propylbenzene	20.0	19.3	97	70 - 130	
o-Xylene	20.0	19.1	95	70 - 130	
sec-Butylbenzene	20.0	19.4	97	70 - 130	
Styrene	20.0	21.4	107	70 - 130	
Tert-amyl methyl ether	16.0	12.4	77	70 - 130	
tert-Butyl alcohol	80.0	72.5	91	70 - 130	
tert-Butylbenzene	20.0	18.4	92	70 - 130	
Tert-butyl ethyl ether	16.0	13.7	86	70 - 130	
1,1,1,2-Tetrachloroethane	20.0	18.0	90	70 - 130	
1,1,2,2-Tetrachloroethane	20.0	18.1	91	70 - 130	
Tetrachloroethylene	20.0	17.1	86	70 - 130	
Toluene	20.0	16.5	83	70 - 130	
trans-1,2-Dichloroethylene	20.0	18.1	91	70 - 130	
trans-1,3-Dichloropropene	20.0	18.9	94	70 - 130	
1,2,3-Trichlorobenzene	20.0	17.3	87	70 - 130	
1,2,4-Trichlorobenzene	20.0	17.6	88	70 - 130	
1,1,1-Trichloroethane	20.0	17.5	88	70 - 130	
1,1,2-Trichloroethane	20.0	18.9	94	70 - 130	
Trichloroethylene	20.0	17.5	88	70 - 130	
Trichlorofluoromethane	20.0	21.2	106	70 - 130	
1,2,3-Trichloropropane	20.0	18.3	91	70 - 130	
Trihalomethanes, Total	80.0	72.0	90	70 - 130	
1,2,4-Trimethylbenzene	20.0	19.2	96	70 - 130	
1,3,5-Trimethylbenzene	20.0	19.5	97	70 - 130	
Vinyl chloride	20.0	19.0	95	70 - 130	
Xylenes, Total	60.0	56.0	93	70 - 130	

Surrogate	% Rec	Acceptance Limits
4-Bromofluorobenzene	99	70 - 130
1,2-Dichlorobenzene-d4	96	70 - 130

Calculations are performed before rounding to avoid round-off errors in calculated results.

SEVERN
TRENT

STL

STL Chicago
2417 Bond Street
University Park, IL 60466
Phone: 708-534-5200
Fax: 708-534-5211

Report To:

Bill To:

Shaded Areas For Internal Use Only

Contact: <u>Greg Flasinski</u>	Phone: _____	Shaded Areas For Internal Use Only _____ of _____					
Company: <u>Western Solution I</u>	Contact: _____						
Address: <u>1400 Western Way</u>	Company: _____						
<u>W. Chester PA 19380</u>	Address: _____						
Phone: <u>(610) 701-7293</u>	Phone: _____						
Fax: _____	Fax: _____						
E-Mail: _____	PO#: _____	Quote: _____					
Lab Lot#							
Package Sealed		Samples Sealed		Received on Ice		Samples Intact	
Yes	No	Yes	No	Yes	No	Yes	No
Temperature °C of Cooler							

TEMP.: 5.4
~~680-2628661
36461~~

RELINQUISHED BY <i>[Signature]</i>	COMPANY <i>[Signature]</i>	DATE <i>5/4/07</i>	TIME <i>1600</i>	RECEIVED BY <i>[Signature]</i>	COMPANY <i>STL/SAN</i>	DATE <i>5/5/07</i>	TIME <i>0900</i>
RELINQUISHED BY <i>[Signature]</i>	COMPANY <i>[Signature]</i>	DATE <i></i>	TIME <i></i>	RECEIVED BY <i></i>	COMPANY <i></i>	DATE <i></i>	TIME <i></i>

Matrix Key

WW = Wastewater
W = Water
S = Soil
SL = Sludge
MS = Miscellaneous
OL = Oil
A = Air

W COMPANY

DATE 5/4/07 TIME 1600
DATE TIME

RECEIVED BY

COMPAGNIA

DATE
5/5/07

TIME
0907

Container Key

- | Container Key | Preservative Key |
|----------------------|-------------------------|
| 1. Plastic | 1. HCl, Cool to 4° |
| 2. VOA Vial | 2. H2SO4, Cool to 4° |
| 3. Sterile Plastic | 3. HNO3, Cool to 4° |
| 4. Amber Glass | 4. NaOH, Cool to 4° |
| 5. Widemouth Glass | 5. NaOH/Zn, Cool to 4° |
| 6. Other | 6. Cool to 4° |
| | 7. None |

Preservative Key

- Preservative Key**

 1. HCl, Cool to 4°
 2. H₂SO₄, Cool to 4°
 3. HNO₃, Cool to 4°
 4. NaOH, Cool to 4°
 5. NaOH/Zn, Cool to 4°
 6. Cool to 4°
 7. None

COMMENTS

COMMENTS	Date Received	/	/
	Courier:	Hand Delivered	<input type="checkbox"/>
	Bill of Lading		