

ANNUAL REPORT

Prepared for

STANLEY BLACK & DECKER (U.S.), INC.

Hampstead, Maryland

July 2012

Prepared by

WESTON SOLUTIONS, INC.

West Chester, Pennsylvania 19380-1499

W.O. No. 02501.004.004.0700

TABLE OF CONTENTS

Section	Page
1. INTRODUCTION.....	1-1
2. SITE CHARACTERISTICS.....	2-1
2.1 HYDRAULIC PROPERTIES	2-1
2.2 EFFLUENT CHARACTERISTICS	2-1
2.3 GROUNDWATER QUALITY DATA	2-1
3. OPERATION AND MAINTENANCE OF THE TREATMENT SYSTEM.....	3-1
4. TREATMENT SYSTEM PERFORMANCE EVALUATION.....	4-1
5. RECOMMENDATIONS.....	5-1

LIST OF APPENDICES

APPENDIX A – WITHDRAWAL REPORTS

APPENDIX B – DISCHARGE MONITORING REPORTS

APPENDIX C – GROUNDWATER TREATMENT SYSTEM ANALYTICAL RESULTS

APPENDIX D - GROUNDWATER ANALYTICAL DATA PACKAGE (MAY 2012)

LIST OF FIGURES

Figure	Page
Figure 2-1 Groundwater Elevation Contour Map Under Pumping Conditions (June 2012).....	2-6

LIST OF TABLES

Table	Page
Table 2-1 Treatment System Pumping Records (July 2011 through June 2012)	2-2
Table 2-2 Groundwater Elevation Data (July 2011 through June 2012)	2-3
Table 2-3 Effluent Characteristics Summary (July 2011 through June 2012).....	2-7
Table 2-4 Summary of Groundwater Analytical Results – August 2011	2-10
Table 2-5 Summary of Groundwater Analytical Results – November 2011	2-13
Table 2-6 Summary of Groundwater Analytical Results – February 2012	2-16
Table 2-7 Summary of Groundwater Analytical Results – May 2012	2-19
Table 3-1 Treatment System Maintenance Activities (July 2011 through June 2012).....	3-2

1. INTRODUCTION

This Annual Report has been prepared to meet the requirements of Condition IV.L of the Administrative Consent Order between the State of Maryland Department of the Environment (MDE) and Black & Decker (U.S.) Inc. (April 1995) (Consent Order) and the Addendum to Administrative Consent Order dated 29 June 1995. Specifically, Condition IV.L calls for preparation of an Annual Report containing a summary of the information contained in the Discharge Monitoring Reports (Table 2-3), a summary of all analyses of water samples (Tables 2-4 to 2-7), an explanation of all problems encountered and the manner in which they were resolved (Table 3-1), a performance evaluation of the treatment system (Section 4), and recommendations for continuation of, or changes to, the treatment system (Section 5). This document is one of several that are being prepared in response to the Consent Order; each of these documents are to be submitted to the MDE in accordance with the schedule outlined in the Consent Order. This document will become part of the Administrative Record for the site, which is maintained at the Hampstead Public Library.

2. SITE CHARACTERISTICS

2.1 HYDRAULIC PROPERTIES

In accordance with the Consent Order and the Water Appropriation Permit issued to the Black & Decker (U.S.) Inc. Hampstead, Maryland, facility, the following pumping and water level information is included for the period of July 2011 through June 2012.

Pumping records showing the total gallons pumped per month of treatment system operation are presented in Table 2-1. Copies of the Withdrawal Reports, for the periods of July through December 2011 and January through June 2012, are included in Appendix A.

Water levels (Water Level Monitoring Report) for wells included in the water level monitoring plan are presented in Table 2-2. Based on the June 2012 water levels, a representative groundwater elevation contour map under pumping conditions is presented in Figure 2-1. At the time the data were collected, the extraction wells were pumping at a combined rate of approximately 183 gpm.

2.2 EFFLUENT CHARACTERISTICS

Effluent characteristics of the NPDES discharge points are recorded monthly on Discharge Monitoring Reports (DMRs) and are submitted to MDE, Water Management Administration on a quarterly basis. A summary of the sample results from the DMRs is presented in Table 2-3. DMRs for the period of July 2011 through June 2012 are included in Appendix B.

2.3 GROUNDWATER QUALITY DATA

For the reporting period of July 2011 through June 2012, approximately 49.7 pounds (lbs) of total volatile organic compounds (VOCs) were removed from the groundwater by the extraction and treatment system. In general, the total VOCs were comprised of trichloroethene (TCE) (83.8%) and tetrachloroethene (PCE) (16.2%). Analytical results for the air stripper discharge for the period of July 2011 through June 2012 are included in Appendix C.

Table 2-1
Treatment System Pumping Records
(July 2011 through June 2012)

Black & Decker
Hampstead, Maryland

Date	Water Pumped (gallons)
July 2011	6,548,053
August 2011	6,654,014
September 2011	5,361,690
October 2011	6,695,740
November 2011	7,261,636
December 2011	7,622,161
January 2012	7,785,318
February 2012	7,319,653
March 2012	7,752,273
April 2012	7,541,394
May 2012	7,485,014
June 2012	7,361,950

Table 2-2
Groundwater Elevation Data (July 2011 through June 2012)
Black & Decker
Hampstead, Maryland

WELL NO.	TOC ELEV	TOTAL DEPTH	7/16/2011		8/24/2011		9/27/2011		10/22/2011	
			DTW	ELEV	DTW	ELEV	DTW	ELEV	DTW	ELEV
EW-1	847.21	55	DRY	NC	DRY	NC	DRY	NC	DRY	NC
EW-2	849.21	110	91.43	757.78	91.86	757.35	91.23	757.98	91.41	757.80
EW-3	846.64	118	88.43	758.21	88.82	757.82	88.76	757.88	88.80	757.84
EW-4	858.01	97.5	PC	NC	PC	NC	PC	NC	PC	NC
EW-5	864.17	98	90.50	773.67	89.87	774.30	90.43	773.74	89.84	774.33
EW-6	831.98	115	103.00	728.98	100.33	731.65	103.21	728.77	101.00	730.98
EW-7	818.38	78	71.60	746.78	71.34	747.04	70.77	747.61	71.60	746.78
EW-8	811.13	98	91.50	719.63	93.00	718.13	30.66*	811.13	43.20*	811.13
EW-9	811.35	141	102.50	708.85	102.62	708.73	103.00	708.35	102.50	708.85
EW-10	807.74	NA	46.22	761.52	52.26	755.48	47.48	760.26	53.61	754.13
RFW-1A	864.37	78	51.15	813.22	52.81	811.56	52.68	811.69	51.96	812.41
RFW-1B	864.23	200	51.18	813.05	52.86	811.37	52.73	811.50	51.97	812.26
RFW-2A	857.41	35	13.10	844.31	17.32	840.09	16.94	840.47	15.26	842.15
RFW-2B	857.73	75	13.65	844.08	17.98	839.75	17.28	840.45	15.61	842.12
RFW-3B	839.21	153	37.41	801.80	37.26	801.95	34.32	804.89	37.83	801.38
RFW-4A	830.37	62	36.12	794.25	38.57	791.80	36.92	793.45	37.04	793.33
RFW-4B	830.37	120	36.05	794.32	38.52	791.85	36.85	793.52	36.90	793.47
RFW-5A	817.50	30	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-6	785.04	120	4.10	780.94	4.89	780.15	3.90	781.14	3.64	781.40
RFW-7	805.14	29	7.94	797.20	7.10	798.04	6.98	798.16	8.19	796.95
RFW-8	860.07	53	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-9	862.02	49	25.47	836.55	27.97	834.05	25.26	836.76	26.23	835.79
RFW-10	852.06	58	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-11A	849.32	72	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
RFW-11B	849.62	116	64.23	785.39	64.58	785.04	64.08	785.54	64.35	785.27
RFW-12B	844.87	264	51.87	793.00	51.11	793.76	51.34	793.53	51.64	793.23
RFW-13	849.11	150	65.43	783.68	65.78	783.33	65.70	783.41	65.66	783.45
RFW-14B	812.39	281	58.47	753.92	49.77	762.62	52.63	759.76	53.60	758.79
RFW-16	856.14	41	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-17	834.66	60.5	26.41	808.25	27.43	807.23	27.58	807.08	26.94	807.72
RFW-20	842.29	142	33.13	809.16	35.03	807.26	36.71	805.58	33.08	809.21
RFW-21	832.65	102	20.68	811.97	22.22	810.43	22.63	810.02	21.43	811.22
PH-7	805.94	89	33.30	772.64	34.26	771.68	24.22	781.72	34.02	771.92
PH-9	814.94	98	51.02	763.92	54.71	760.23	51.30	763.64	50.62	764.32
PH-11	820.68	78	49.62	771.06	47.60	773.08	43.22	777.46	52.73	767.95
PH-12	828.35	87	49.83	778.52	53.63	774.72	51.51	776.84	48.11	780.24
B-3	803.02	83	10.40	792.62	10.60	792.42	10.38	792.64	9.61	793.41
Amoco	842.29	NA	NA	NC	NA	NC	NA	NC	NA	NC
Hamp. Town #22	804.96	NA	0.96	804.00	2.34	802.62	3.31	801.65	2.16	802.80
Pembroke #1	NA	NA	11.36	NC	10.96	NC	10.87	NC	11.26	NC
Pembroke #2	NA	NA	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
N. Houcks. Rd.	NA	NA	11.43	NC	10.88	NC	10.98	NC	10.08	NC
E. Century St.	NA	NA	19.24	NC	19.24	NC	19.21	NC	19.21	NC
Lwr. Beckleys. Rd.	NA	NA	55.67	NC	56.13	NC	55.48	NC	55.87	NC

Table 2-2
Groundwater Elevation Data (July 2011 through June 2012)
Black & Decker
Hampstead, Maryland

WELL NO.	TOC ELEV	TOTAL DEPTH	11/17/2011		12/22/2011		1/23/2012		2/16/2012	
			DTW	ELEV	DTW	ELEV	DTW	ELEV	DTW	ELEV
EW-1	847.21	55	DRY	NC	DRY	NC	DRY	NC	DRY	NC
EW-2	849.21	110	91.73	757.48	91.64	757.57	91.58	757.63	90.78	758.43
EW-3	846.64	118	88.78	757.86	85.67	760.97	81.70	764.94	86.11	760.53
EW-4	858.01	97.5	PC	NC	PC	NC	PC	NC	PC	NC
EW-5	864.17	98	90.25	773.92	90.27	773.90	90.36	773.81	90.26	773.91
EW-6	831.98	115	102.00	729.98	101.57	730.41	94.27	737.71	101.74	730.24
EW-7	818.38	78	68.26	750.12	66.84	751.54	62.43	755.95	71.00	747.38
EW-8	811.13	98	91.45	719.68	91.47	719.66	91.42	719.71	93.00	718.13
EW-9	811.35	141	103.00	708.35	103.00	708.35	103.00	708.35	104.00	707.35
EW-10	807.74	NA	46.98	760.76	46.63	761.11	44.76	762.98	74.08	733.66
RFW-1A	864.37	78	49.16	815.21	49.36	815.01	50.11	814.26	47.51	816.86
RFW-1B	864.23	200	49.23	815.00	49.38	814.85	50.18	814.05	47.61	816.62
RFW-2A	857.41	35	12.71	844.70	13.96	843.45	12.37	845.04	12.59	844.82
RFW-2B	857.73	75	13.38	844.35	14.24	843.49	12.88	844.85	13.33	844.40
RFW-3B	839.21	153	37.41	801.80	35.43	803.78	29.79	809.42	29.36	809.85
RFW-4A	830.37	62	36.92	793.45	36.40	793.97	35.15	795.22	36.17	794.20
RFW-4B	830.37	120	36.89	793.48	36.31	794.06	35.03	795.34	35.83	794.54
RFW-5A	817.50	30	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-6	785.04	120	4.03	781.01	3.84	781.20	2.84	782.20	3.08	781.96
RFW-7	805.14	29	5.92	799.22	7.12	798.02	6.13	799.01	5.09	800.05
RFW-8	860.07	53	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-9	862.02	49	24.97	837.05	25.13	836.89	24.80	837.22	24.38	837.64
RFW-10	852.06	58	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-11A	849.32	72	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
RFW-11B	849.62	116	63.89	785.73	63.36	786.26	62.09	787.53	63.36	786.26
RFW-12B	844.87	264	50.08	794.79	50.42	794.45	50.26	794.61	50.89	793.98
RFW-13	849.11	150	64.72	784.39	64.23	784.88	63.02	786.09	62.27	786.84
RFW-14B	812.39	281	53.49	758.90	53.37	759.02	52.94	759.45	53.61	758.78
RFW-16	856.14	41	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-17	834.66	60.5	26.03	808.63	26.10	808.56	26.31	808.35	24.55	810.11
RFW-20	842.29	142	32.81	809.48	32.11	810.18	32.47	809.82	31.58	810.71
RFW-21	832.65	102	20.52	812.13	21.26	811.39	20.47	812.18	19.81	812.84
PH-7	805.94	89	25.07	780.87	24.86	781.08	21.31	784.63	20.61	785.33
PH-9	814.94	98	52.04	762.90	50.22	764.72	50.42	764.52	50.60	764.34
PH-11	820.68	78	51.71	768.97	51.63	769.05	50.21	770.47	50.42	770.26
PH-12	828.35	87	47.84	780.51	46.27	782.08	42.47	785.88	43.59	784.76
B-3	803.02	83	10.11	792.91	10.20	792.82	10.12	792.90	9.96	793.06
Amoco	842.29	NA	NA	NC	NA	NC	NA	NC	NA	NC
Hamp. Town #22	804.96	NA	4.88	800.08	4.19	800.77	2.12	802.84	1.92	803.04
Pembroke #1	NA	NA	10.98	NC	11.18	NC	10.43	NC	10.89	NC
Pembroke #2	NA	NA	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
N. Houcks. Rd.	NA	NA	10.27	NC	10.94	NC	10.07	NC	10.58	NC
E. Century St.	NA	NA	19.20	NC	19.19	NC	19.23	NC	19.21	NC
Lwr. Beckleys. Rd.	NA	NA	55.42	NC	55.12	NC	54.89	NC	54.80	NC

Table 2-2
Groundwater Elevation Data (July 2011 through June 2012)
Black & Decker
Hampstead, Maryland

WELL NO.	TOC ELEV	TOTAL DEPTH	3/23/2012		4/18/2012		5/24/2012		6/7/2012	
			DTW	ELEV	DTW	ELEV	DTW	ELEV	DTW	ELEV
EW-1	847.21	55	DRY	NC	DRY	NC	DRY	NC	DRY	NC
EW-2	849.21	110	91.10	758.11	91.40	757.81	93.67	755.54	93.48	755.73
EW-3	846.64	118	87.42	759.22	87.50	759.14	87.30	759.34	87.08	759.56
EW-4	858.01	97.5	PC	NC	PC	NC	PC	NC	PC	NC
EW-5	864.17	98	90.31	773.86	90.27	773.90	90.01	774.16	89.87	774.30
EW-6	831.98	115	102.02	729.96	102.19	729.79	102.00	729.98	102.50	729.48
EW-7	818.38	78	71.00	747.38	71.00	747.38	71.00	747.38	71.00	747.38
EW-8	811.13	98	93.00	718.13	93.00	718.13	95.80	715.33	93.00	718.13
EW-9	811.35	141	103.50	707.85	103.50	707.85	103.50	707.85	103.00	708.35
EW-10	807.74	NA	73.98	733.76	74.14	733.60	48.50	759.24	49.94	757.80
RFW-1A	864.37	78	48.19	816.18	48.73	815.64	50.23	814.14	50.31	814.06
RFW-1B	864.23	200	48.23	816.00	48.77	815.46	50.36	813.87	50.38	813.85
RFW-2A	857.41	35	13.12	844.29	14.21	843.20	13.11	844.30	13.17	844.24
RFW-2B	857.73	75	13.71	844.02	14.56	843.17	13.92	843.81	13.99	843.74
RFW-3B	839.21	153	29.70	809.51	29.83	809.38	31.34	807.87	31.41	807.80
RFW-4A	830.37	62	36.43	793.94	36.83	793.54	37.02	793.35	38.10	792.27
RFW-4B	830.37	120	36.19	794.18	36.99	793.38	37.83	792.54	38.82	791.55
RFW-5A	817.50	30	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-6	785.04	120	4.11	780.93	4.97	780.07	3.18	781.86	4.17	780.87
RFW-7	805.14	29	7.57	797.57	7.87	797.27	5.36	799.78	7.83	797.31
RFW-8	860.07	53	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-9	862.02	49	25.67	836.35	26.04	835.98	25.33	836.69	25.82	836.20
RFW-10	852.06	58	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-11A	849.32	72	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
RFW-11B	849.62	116	63.40	786.22	63.47	786.15	63.71	785.91	64.03	785.59
RFW-12B	844.87	264	50.49	794.38	50.51	794.36	49.88	794.99	50.10	794.77
RFW-13	849.11	150	64.73	784.38	64.83	784.28	61.70	787.41	61.88	787.23
RFW-14B	812.39	281	52.91	759.48	53.66	758.73	52.98	759.41	53.59	758.80
RFW-16	856.14	41	DRY	NC	DRY	NC	DRY	NC	DRY	NC
RFW-17	834.66	60.5	26.51	808.15	27.02	807.64	26.00	808.66	26.13	808.53
RFW-20	842.29	142	32.39	809.90	32.44	809.85	33.26	809.03	33.34	808.95
RFW-21	832.65	102	21.74	810.91	21.83	810.82	20.35	812.30	20.42	812.23
PH-7	805.94	89	25.17	780.77	26.60	779.34	20.20	785.74	20.48	785.46
PH-9	814.94	98	50.70	764.24	51.04	763.90	52.43	762.51	52.62	762.32
PH-11	820.68	78	51.53	769.15	51.59	769.09	52.64	768.04	52.99	767.69
PH-12	828.35	87	46.41	781.94	47.02	781.33	49.83	778.52	50.67	777.68
B-3	803.02	83	9.83	793.19	8.96	794.06	9.26	793.76	9.41	793.61
Amoco	842.29	NA	NA	NC	NA	NC	NA	NC	NA	NC
Hamp. Town #22	804.96	NA	1.48	803.48	1.69	803.27	1.42	NC	1.17	803.79
Pembroke #1	NA	NA	11.08	NC	10.87	NC	10.94	NC	11.13	NC
Pembroke #2	NA	NA	Damaged	NC	Damaged	NC	Damaged	NC	Damaged	NC
N. Houcks. Rd.	NA	NA	10.41	NC	10.38	NC	10.22	NC	10.42	NC
E. Century St.	NA	NA	19.26	NC	19.27	NC	19.29	NC	19.26	NC
Lwr. Beckleys. Rd.	NA	NA	55.23	NC	56.42	NC	55.81	NC	55.67	NC

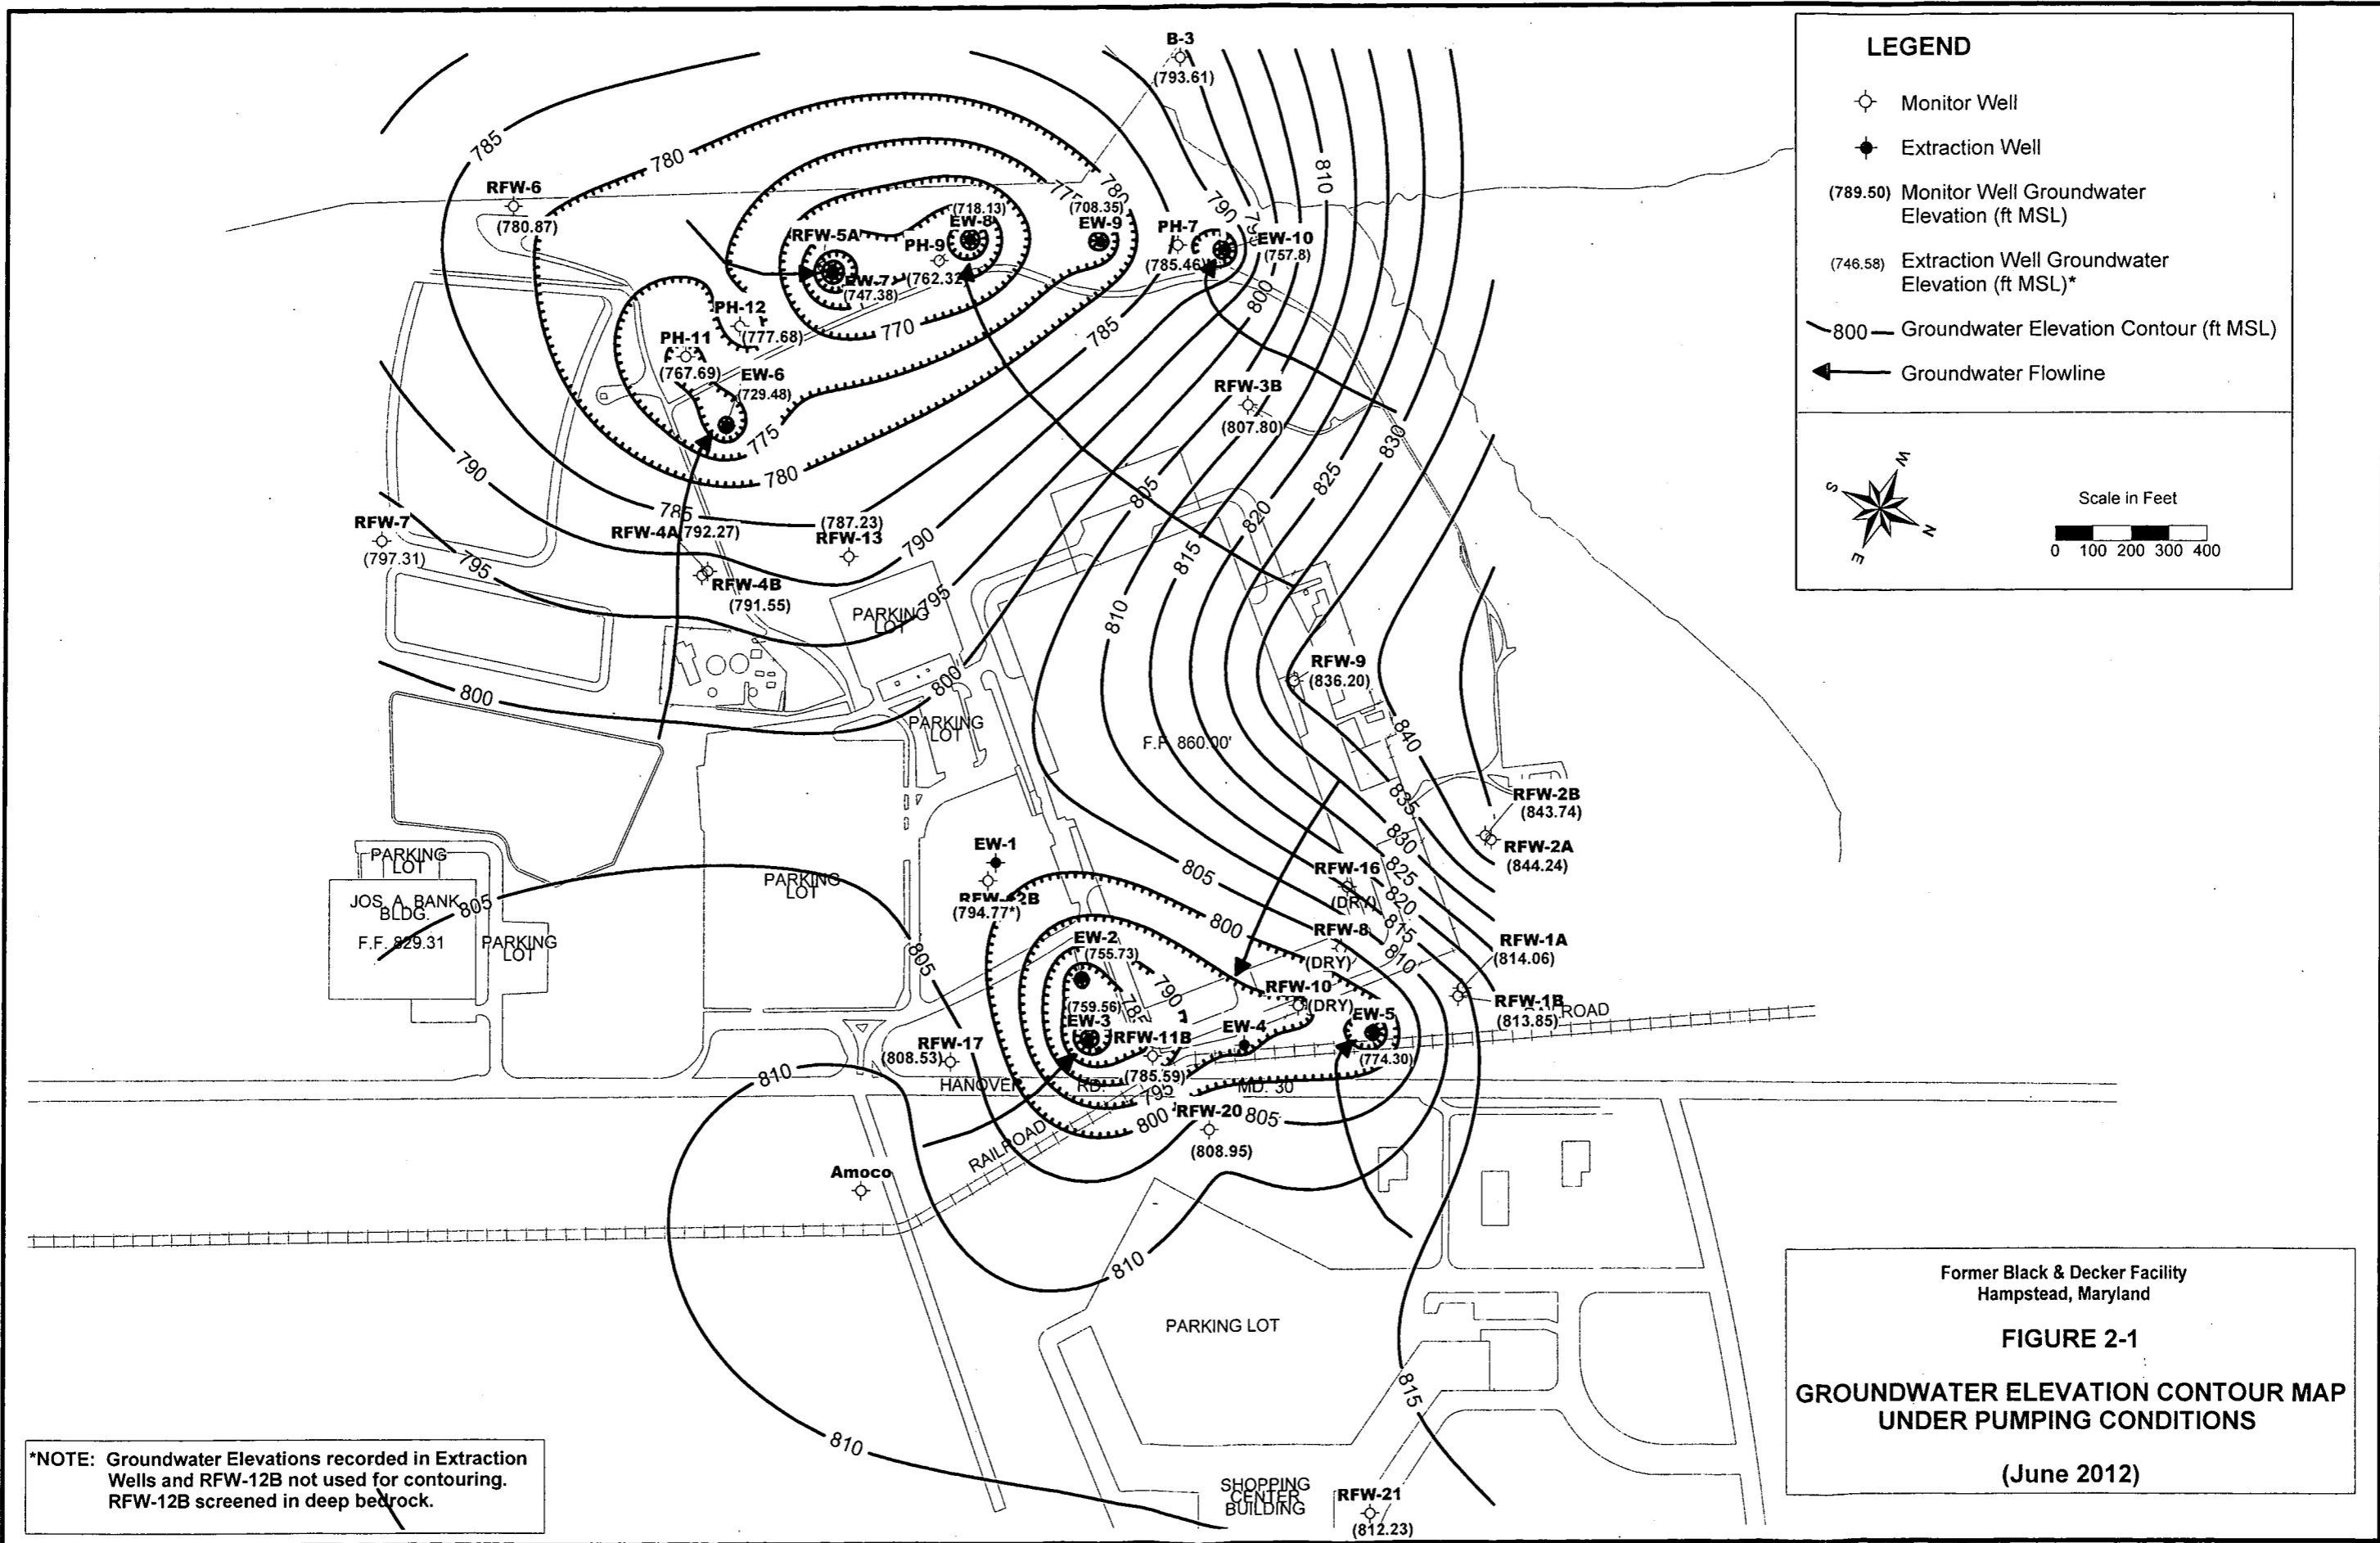


Table 2-3
 Effluent Characteristics Summary (July 2011 through June 2012)
 Black & Decker
 Hampstead, Maryland

Discharge Number	Parameter	Units	Permit Limits	DMR DATE					
				July 2011	August 2011	September 2011	October 2011	November 2011	December 2011
001	FLOW average	MGD	NA	0.111	0.166	0.288	0.140	0.225	0.212
	FLOW maximum	MGD	NA	0.133	0.410	1.470	0.276	0.970	1.040
	1,1,1-Trichloroethane	ug/l	5	<1	<1	<1	<1	<1	<1
	Tetrachloroethylene	ug/l	5	<1	<1	<1	<1	<1	<1
	Trichloroethylene	ug/l	5	<1	<1	<1	<1	<1	<1
	Total Residual Chlorine	mg/l	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1	<0.1
	Oil & Grease maximum	mg/l	15	<5	<5	<5	<5	<5	<5
	Oil & Grease monthly average	mg/l	10	<5	<5	<5	<5	<5	<5
	pH minimum	STD	6.0	6.6	6.3	6.1	6.3	6.5	6.4
	pH maximum	STD	8.5	7.0	8.5	7.3	6.9	7.0	7.4
BOD	mg/l	15	4.0	5.0	0.0	2.0	3.0	<1	
TSS maximum	mg/l	30	9.0	20.0	5.0	0.0	<1	<1	
TSS monthly average	mg/l	20	9.0	20.0	5.0	0.0	<1	<1	
101 (Monitoring Point)	FLOW average	MGD	NA	0.178	0.208	0.208	0.213	0.246	0.293
	FLOW maximum	MGD	NA	0.223	0.325	0.255	0.240	0.305	0.345
	Fecal Coliform	MPN/100ml	200	2.0	1.0	5.0	5.0	1.0	1.0
201 (Monitoring Point)	FLOW average	MGD	NA	NR	NR	0.202	NR	NR	0.235
	FLOW maximum	MGD	NA	NR	NR	0.268	NR	NR	0.300
	1,1,1-Trichloroethane	ug/l	NA	NR	NR	<1	NR	NR	<1
	Tetrachloroethylene	ug/l	NA	NR	NR	<1	NR	NR	<1
Trichloroethylene	ug/l	NA	NR	NR	<1	NR	NR	<1	

DMR - Discharge Monitoring Report

NA - Not Applicable

NR - Not Reported

Table 2-3
 Effluent Characteristics Summary (July 2011 through June 2012)
 Black & Decker
 Hampstead, Maryland

Discharge Number	Parameter	Units	Permit Limits	DMR DATE					
				January 2012	February 2012	March 2012	April 2012	May 2012	June 2012
001	FLOW average	MGD	NA	0.187	0.140	0.222	0.177	0.176	0.180
	maximum	MGD	NA	0.668	0.238	0.703	0.350	0.100	1.103
	1,1,1-Trichloroethane	ug/l	5	< 1	< 1	< 1	< 1	< 1	< 1
	Tetrachloroethylene	ug/l	5	< 1	< 1	< 1	< 1	< 1	< 1
	Trichloroethylene	ug/l	5	< 1	< 1	< 1	< 1	< 1	< 1
	Total Residual Chlorine	mg/l	<0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1	< 0.1
	Oil & Grease maximum	mg/l	15	< 5	< 5	< 5	< 5	< 5	< 5
	monthly average	mg/l	10	< 5	< 5	< 5	< 5	< 5	< 5
	pH minimum	STD	6.0	6.4	6.20	6.60	6.7	6.4	6.9
	maximum	STD	8.5	6.9	8.00	7.50	7.5	8.2	7.6
BOD	mg/l	15	3.0	< 2	2.0	2.0	< 2	7.0	
TSS maximum	mg/l	30	< 4	4.0	4.0	0.0	0.0	12.0	
monthly average	mg/l	20	< 4	4.0	4.0	0.0	0.0	12.0	
101 (Monitoring Point)	FLOW average	MGD	NA	0.308	0.286	0.363	0.320	0.247	0.195
	maximum	MGD	NA	0.382	0.407	0.452	0.401	0.322	0.262
	Fecal Coliform	MPN/100ml	200	2.0	2.0	< 1.8	8.0	130.0	13.0
201 (Monitoring Point)	FLOW average	MGD	NA	NR	NR	0.251	NR	NR	0.246
	maximum	MGD	NA	NR	NR	0.297	NR	NR	0.392
	1,1,1-Trichloroethane	ug/l	NA	NR	NR	< 1	NR	NR	< 1
	Tetrachloroethylene	ug/l	NA	NR	NR	< 1	NR	NR	< 1
	Trichloroethylene	ug/l	NA	NR	NR	< 1	NR	NR	< 1

DMR - Discharge Monitoring Report

NA - Not Applicable

NR - Not Reported

2012 are included in Tables 2-4, 2-5, 2-6, and 2-7, respectively. As found in earlier sampling events at the Black & Decker facility, TCE and PCE were the primary VOCs detected at the highest concentrations in the groundwater samples. The highest concentrations of TCE were detected in the groundwater samples collected from wells EW-2 and EW-4 and the highest concentrations of PCE were detected in the groundwater samples collected from well EW-9. The remainder of the detected VOCs, were detected at levels well below the Federal Maximum Concentration Levels (MCLs). The second quarter 2012 (May 2012) analytical data package is included in Appendix D. Analytical data packages for the remaining quarters are included in the respective Quarterly Groundwater Monitoring Reports.

Table 2-4

Summary of Groundwater Analytical Results - August 2011
 Black & Decker
 Hampstead, Maryland

PARAMETER	Units	EW-1	EW-2	EW-3	EW-4	EW-5	EW-6	EW-7	EW-8	EW-9	EW-9 (DUP)	EW-10
Chloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromomethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Vinyl Chloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Methylene Chloride	ug/L	NS	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U	2 U
Acetone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Carbon Disulfide	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1-Dichloroethene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	0.9 J	0.9 J	1 U	1 U	1 U
1,2-Dichloroethene (total)	ug/L	NS	4.5	1 U	1 U	1 U	1 U	9	25	1 U	1 U	1 U
Chloroform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
2-Butanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
1,1,1-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Carbon Tetrachloride	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromodichloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,2-Dichloropropane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
cis-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trichloroethene	ug/L	NS	280	73	770	120	6.7	6.6	9.1	0.8	0.8	1 U
Dibromochloromethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
1,1,2-Trichloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Benzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Trans-1,3-Dichloropropene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Bromoform	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
4-Methyl-2-pentanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
2-Hexanone	ug/L	NS	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U	5 U
Tetrachloroethene	ug/L	NS	55	2.3	13	3.4	13	14	62	100	110	1 U
1,1,2,2-Tetrachloroethane	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Toluene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Chlorobenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Ethylbenzene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Styrene	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U
Xylene (total)	ug/L	NS	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U	1 U

Notes: U = Compound was analyzed for but not detected. Value shown is the method detection limit for quantification.

J = Indicates an estimated value.

NS = Not Sampled